


POWER WORK NOTES


- ① 20A, 2-POLE, MOTOR RATED SWITCH, FLUSH MOUNTED IN WALL AT 48" AFF; CONTRACTOR SHALL COORDINATE EXACT SWITCH LOCATION WITH EQUIPMENT SUPPLIER AND ARCHITECT PRIOR TO ROUGH-IN.
- ② CONTRACTOR SHALL PROVIDE EMPTY 3/4" CONDUIT FOR CONTROLS AND POWER WIRING BETWEEN INDOOR UNIT (SAC) AND CORRESPONDING OUTDOOR UNIT (SCU). POWER AND CONTROLS FROM OUTDOOR UNIT TO INDOOR UNIT SHALL BE PROVIDED BY MECHANICAL CONTRACTOR. COORDINATE EQUIPMENT LOCATION WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.
- ③ REFER TO PANEL SCHEDULES ON SHEET E3.1 FOR FURTHER INFORMATION.

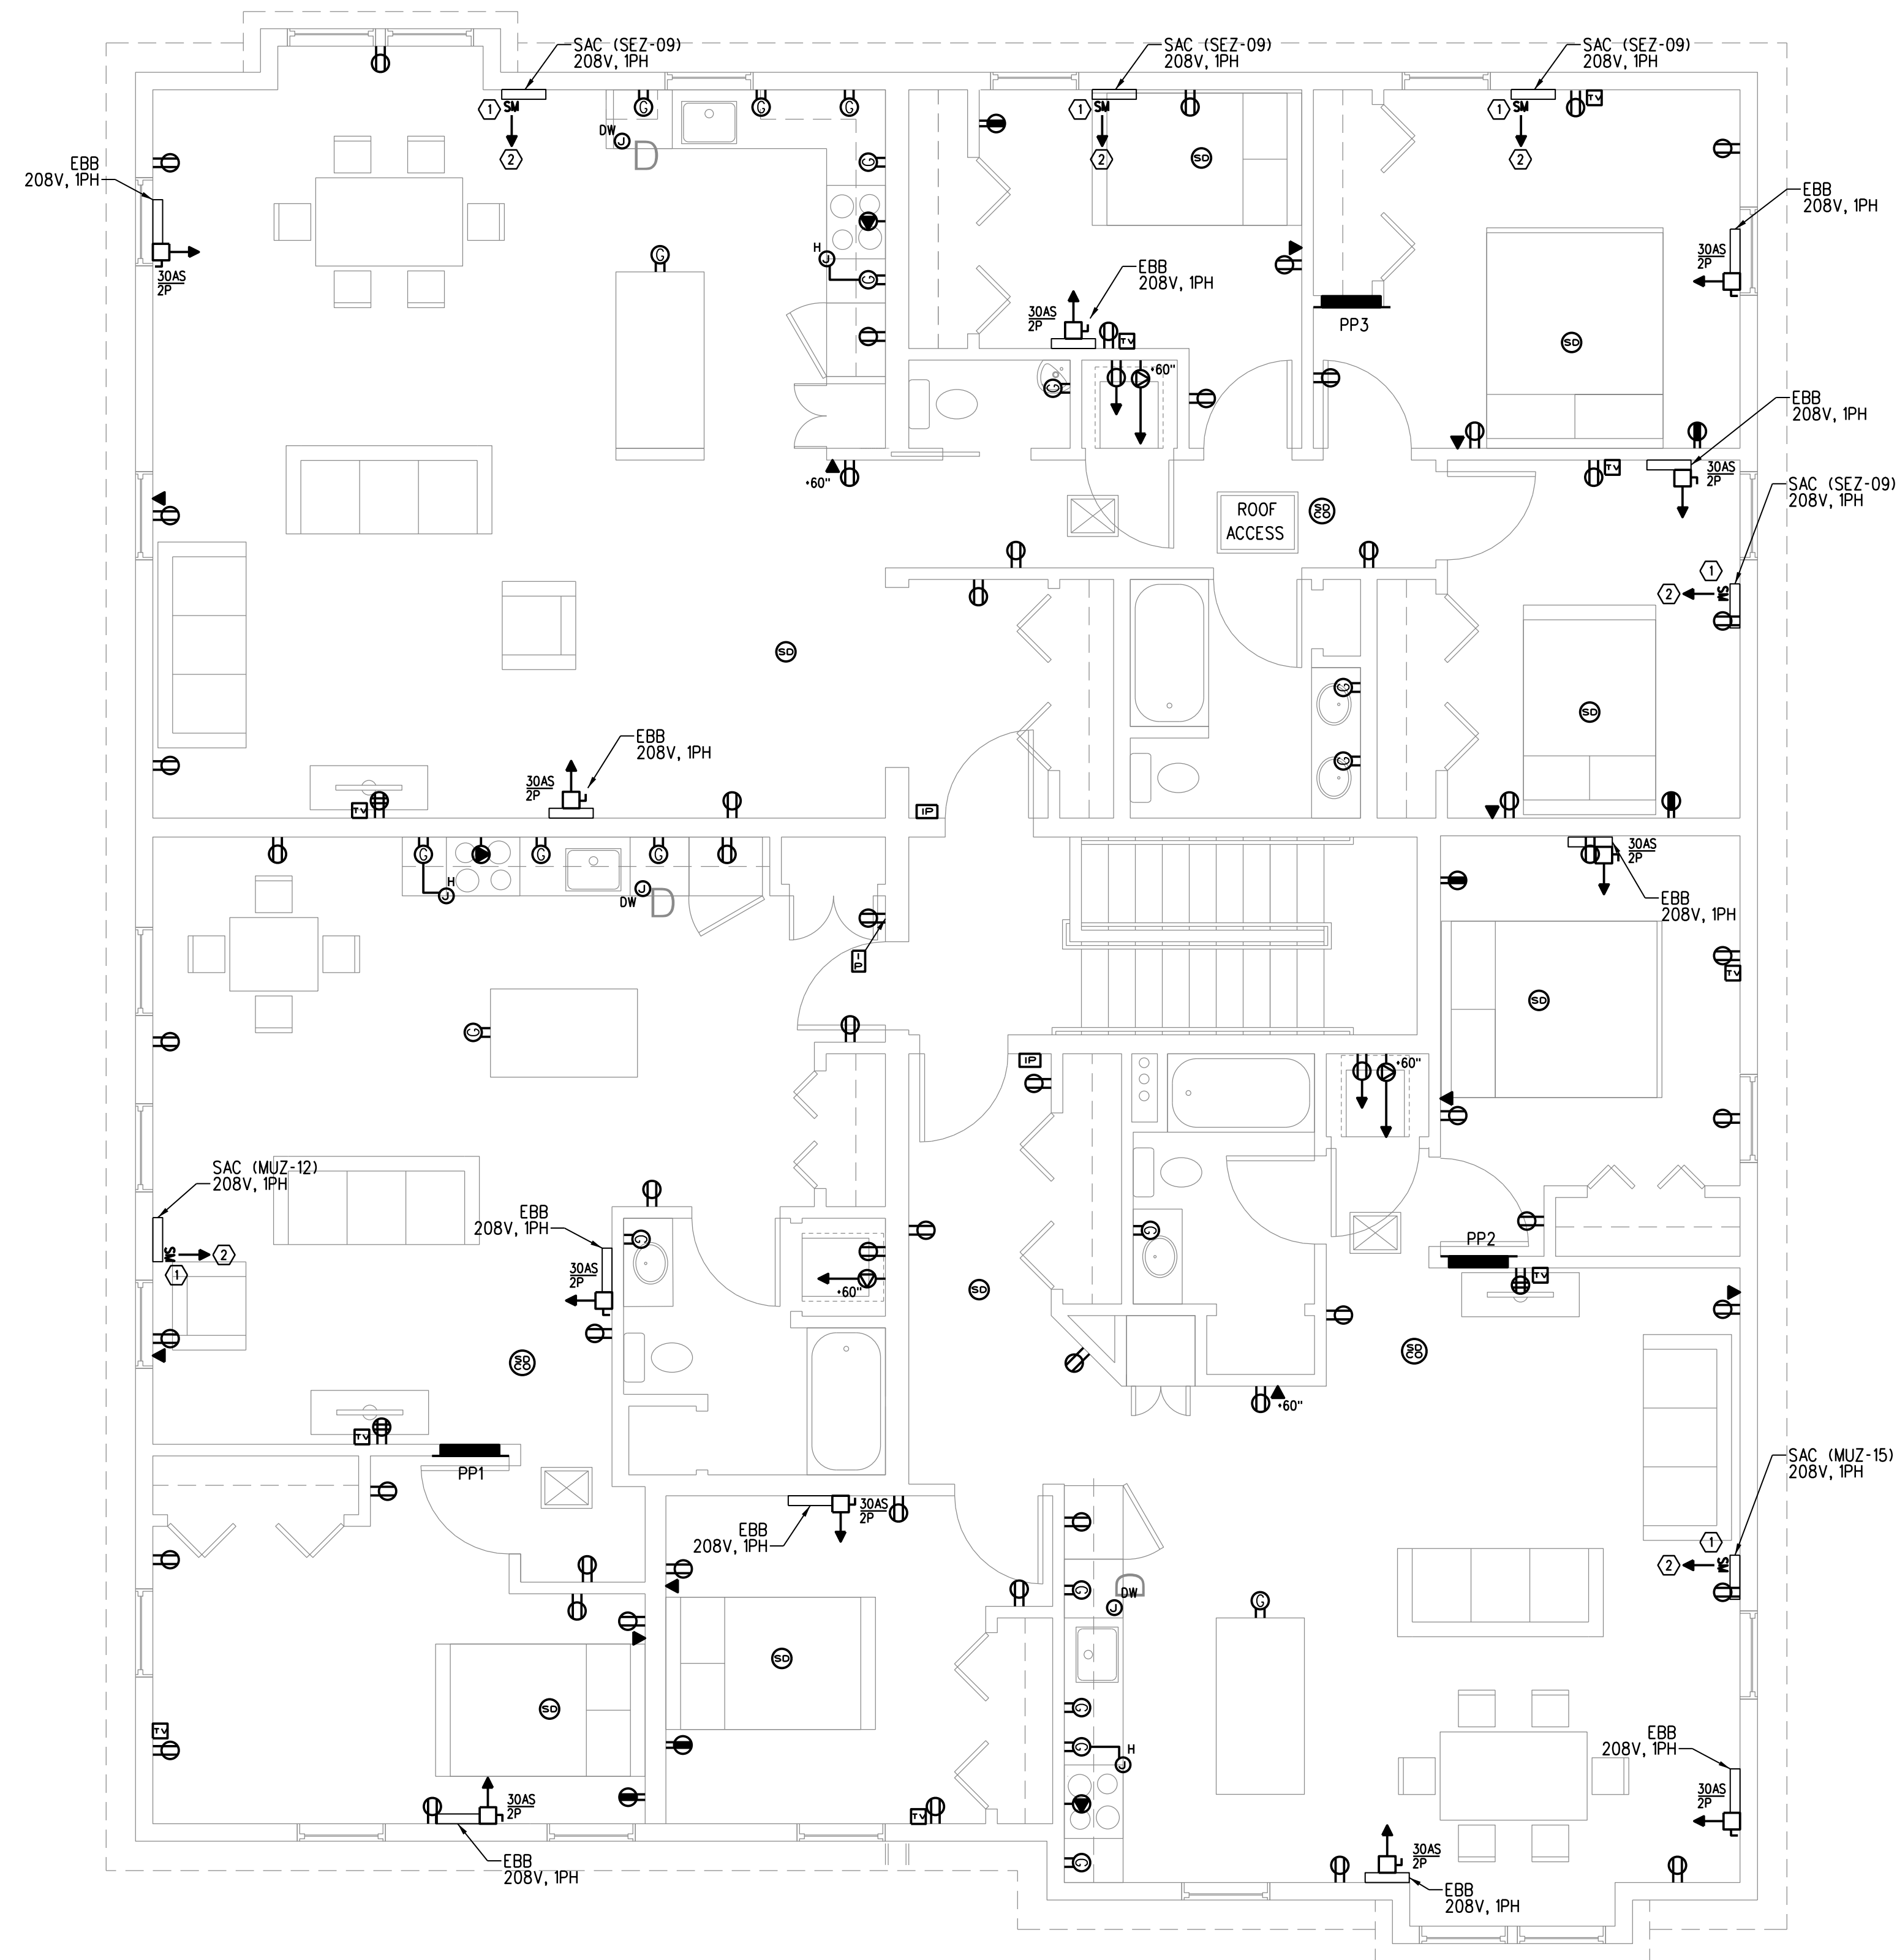

THIRD FLOOR POWER PLAN

SCALE: 1/4" = 1'-0"

PROGRESS PRINT
 NOT FOR CONSTRUCTION

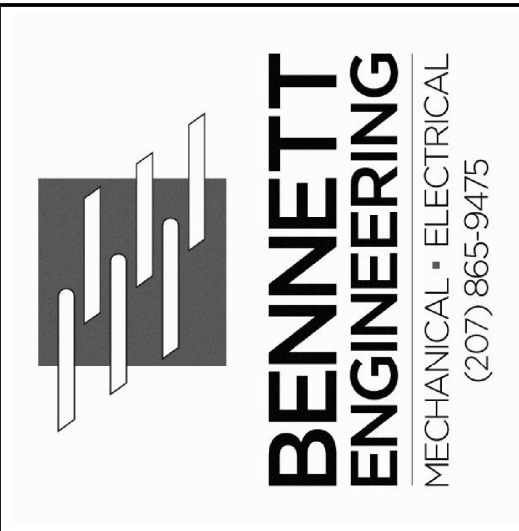

IDEAL ELECTRIC
 86 China Rd.
 Winslow, ME 04901

65 MUNJOY ST. APARTMENTS
 65 Munjoy St., Portland, ME 04101
THIRD FLOOR POWER PLAN

Date Drawn: 09/16/2016

Drawn By: CAT

Checked By: SAJ

Revision:	
1.	
2.	
3.	
4.	
5.	
6.	
7.	

BEI Project No: 3936

Scale: AS NOTED

Sht Num: E2.2