


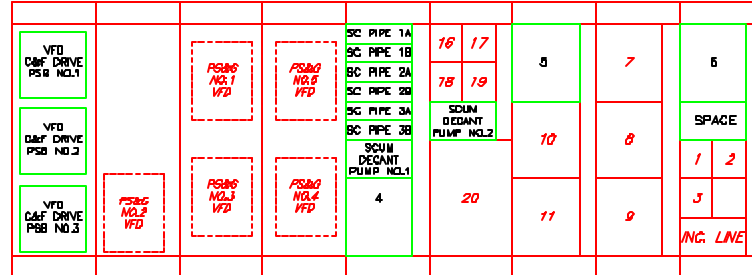


PARTIAL SINGLE LINE DIAGRAM  
NTS

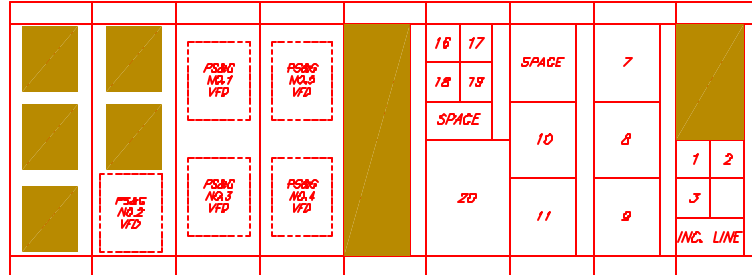

- NOTES:**
- FOR LEGEND AND GENERAL NOTES, SEE DRAWING E-1.
  - EQUIPMENT INDICATED WITH SHADING SHALL BE DISCONNECTED AND REMOVED, ALONG WITH ALL ASSOCIATED DEVICES, WIRING, AND EXPOSED CONDUIT.
  - NEW MOTOR CONTROL CENTER UNITS SHALL BE COMPATIBLE WITH EXISTING GENERAL ELECTRIC 7700-LINE MCC.
  - EXISTING 800A FEEDER FOR "WET-OX" MCC SHALL BE RELIED TO FEED NEW MCC-PB-7. EXISTING FEEDER CIRCUIT BREAKER IN PLANT SWITCH GEAR SHALL BE RELOCATED BACK TO NEURAL POWER BUS SECTION IN SWITCH GEAR. PRIOR TO CONNECTING TO NEW MCC-PB-7, THE WORK SHALL BE COORDINATED WITH THE OWNER.

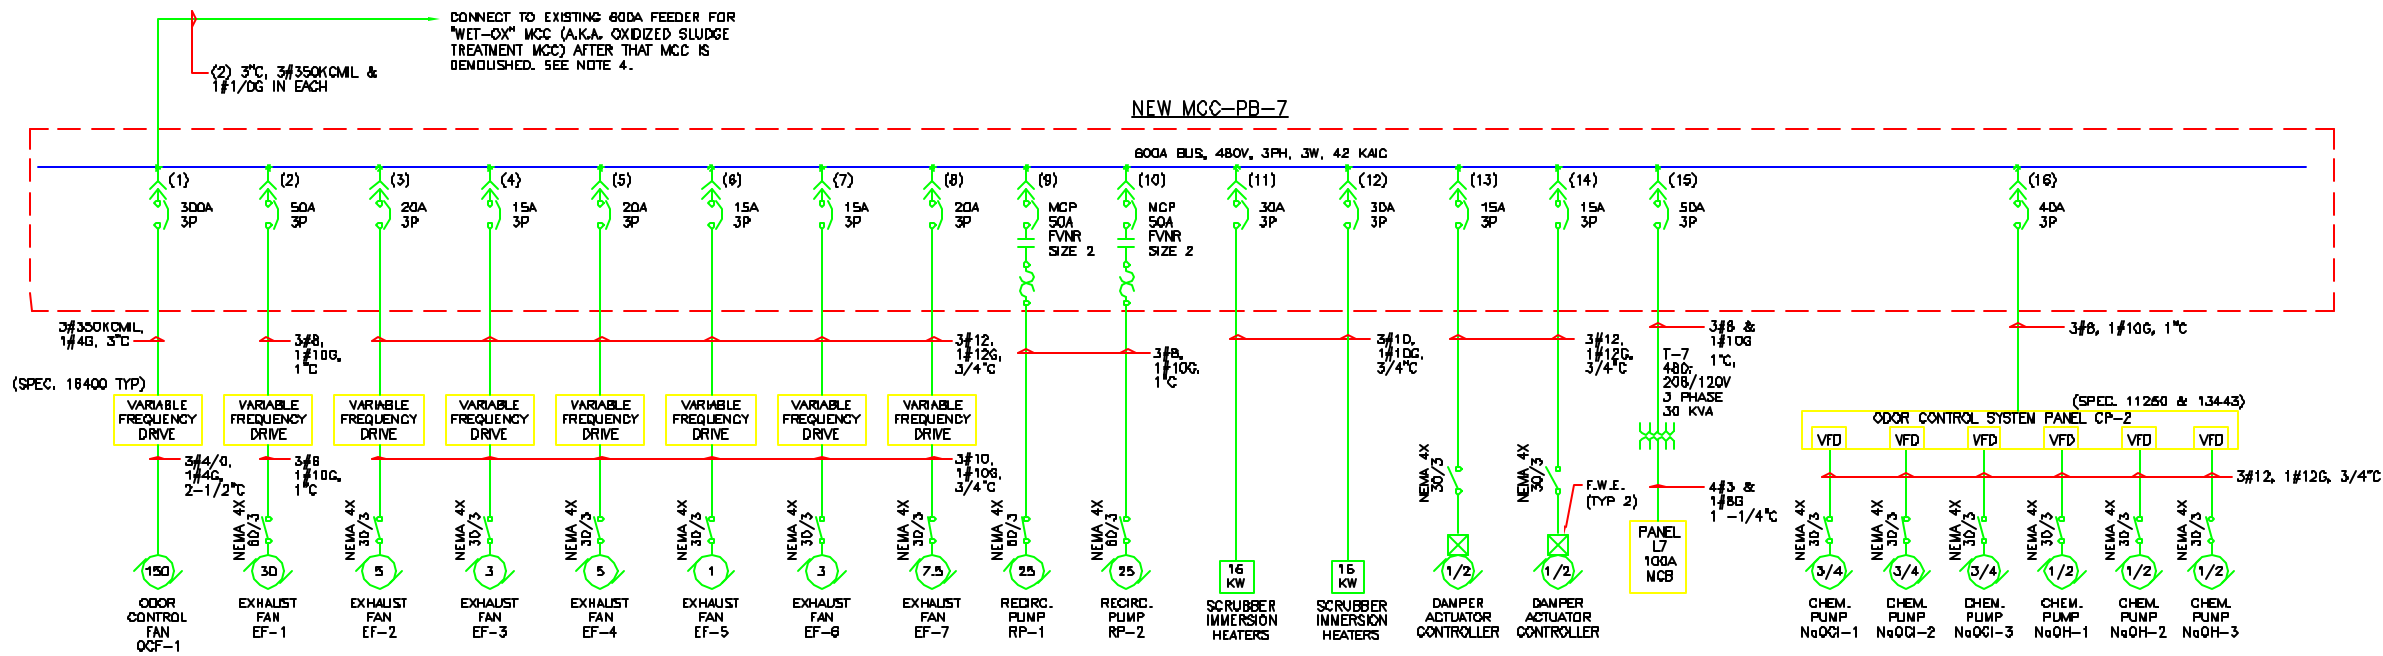

SINGLE LINE DIAGRAM  
NTS

DATE	APPROVED	CHECKED	DESIGNED	PROJECT NO.	DRAWING NO.	SCALE	DATE

DATE	APPROVED	CHECKED	DESIGNED	PROJECT NO.	DRAWING NO.	SCALE	DATE

**Wright-Pierce**  
99 Main Street, Topsham, Maine USA 04086  
TEL (207) 725-8721 FAX (207) 725-8444

**PORTLAND WATER DISTRICT  
PORTLAND, MAINE  
PRIMARY SEDIMENTATION BASINS  
UPGRADE WITH ODOR CONTROL FACILITIES**

ELECTRICAL SINGLE LINE DIAGRAMS  
AND DETAILS 1

DWG E-3  
66 OF 79