
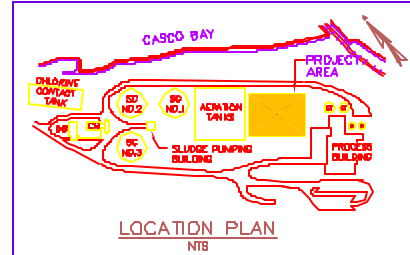


- NOTES:**
1. FOR LEGEND AND GENERAL NOTES, SEE DRAWING E-1.
 2. SEE DRAWING E-5 FOR LOCATION AND MODIFICATIONS TO EXISTING PANELBOARD LE1.
 3. 120V CIRCUITS EXCEEDING 100 FEET IN LENGTH SHALL BE NO. 10 AWG WIRING.
 4. PORTIONS OF PRIMARY SEDIMENTATION BASINS ARE CLASSIFIED AS CLASS 1, DIVISION 2, GROUP D. WHEREVER POSSIBLE, ELECTRICAL EQUIPMENT SUCH AS DISCONNECTS AND LOCAL CONTROL STATIONS SHOULD BE LOCATED ABOVE OR OUTSIDE OF HAZARDOUS AREA ENVELOPE. REFER TO NEMA CLASSIFICATIONS ON DRAWING E-1 FOR DESCRIPTION OF HAZARDOUS AREA ENVELOPE.

FOR CONTINUATION REFER TO DRAWING PR-7 AND PR-8

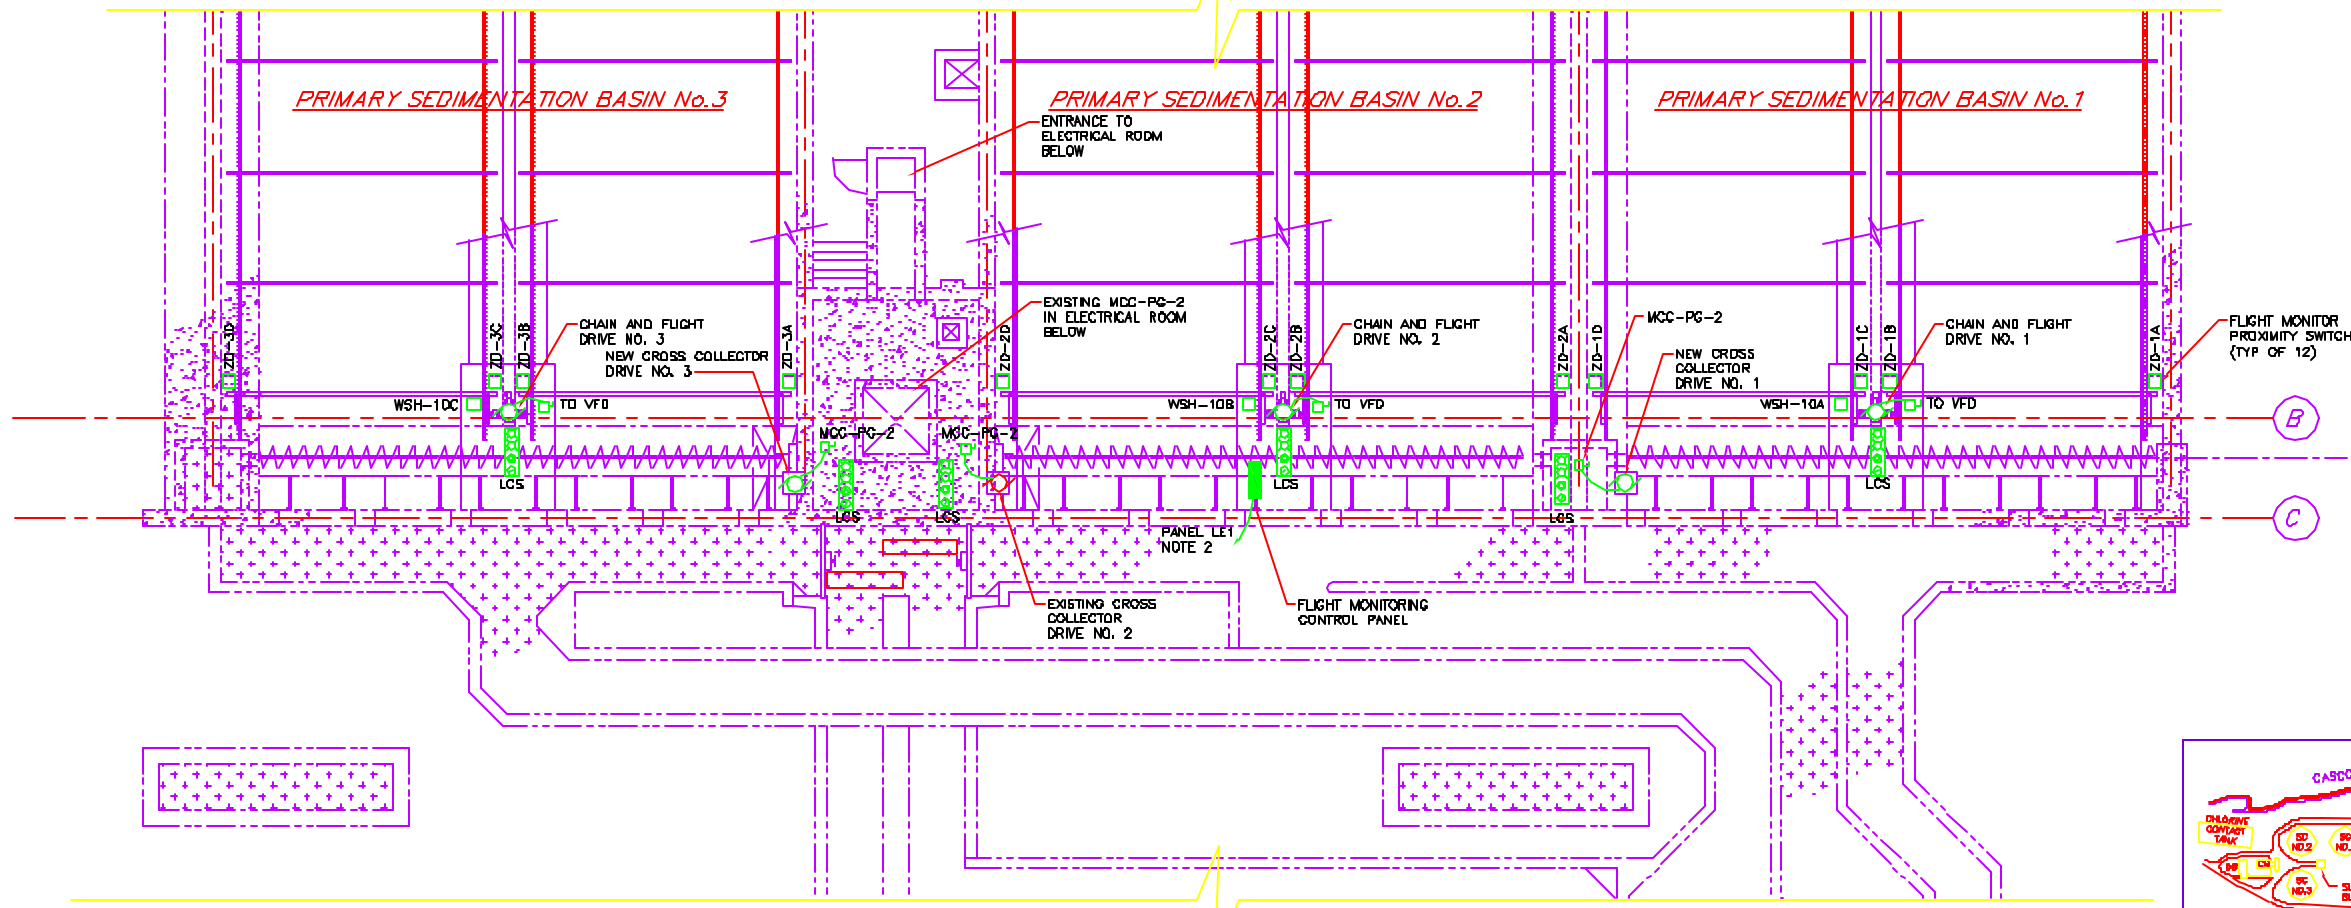

DATE	APP'D	REVISIONS	DESCRIPTION
4-4-01 <td></td> <td>1</td> <td>ISSUED FOR PERMIT</td>		1	ISSUED FOR PERMIT
3-4-01 <td></td> <td>2</td> <td>ISSUED FOR BIDDING</td>		2	ISSUED FOR BIDDING
		3	TAKE LOCATION
		4	DATE REVISION
			FILENAME

DRAWN BY: S.M.	CHECKED BY: P.E.R.	DATE: 3-24-01
APPROVED BY: J.H.L.	DATE: 3-24-01	
PROJECT NO.: 200503	BOOK NO.: 70503A	SCALE: 1/8" = 1'-0"

 Wright-Pierce 99 Main Street Topsham, Maine USA 04086 TEL (207) 725-8721 FAX (207) 725-8414	PORTLAND WATER DISTRICT PORTLAND, MAINE PRIMARY SEDIMENTATION BASINS UPGRADE WITH ODOR CONTROL FACILITIES PRIMARY SEDIMENTATION BASINS PARTIAL MODIFICATION PLANS
--	--

DWG E-6	69 OF 79
---------	----------