


REFER TO DRAWING I-4
FOR CONTINUATION OF
PLC-3 I/O

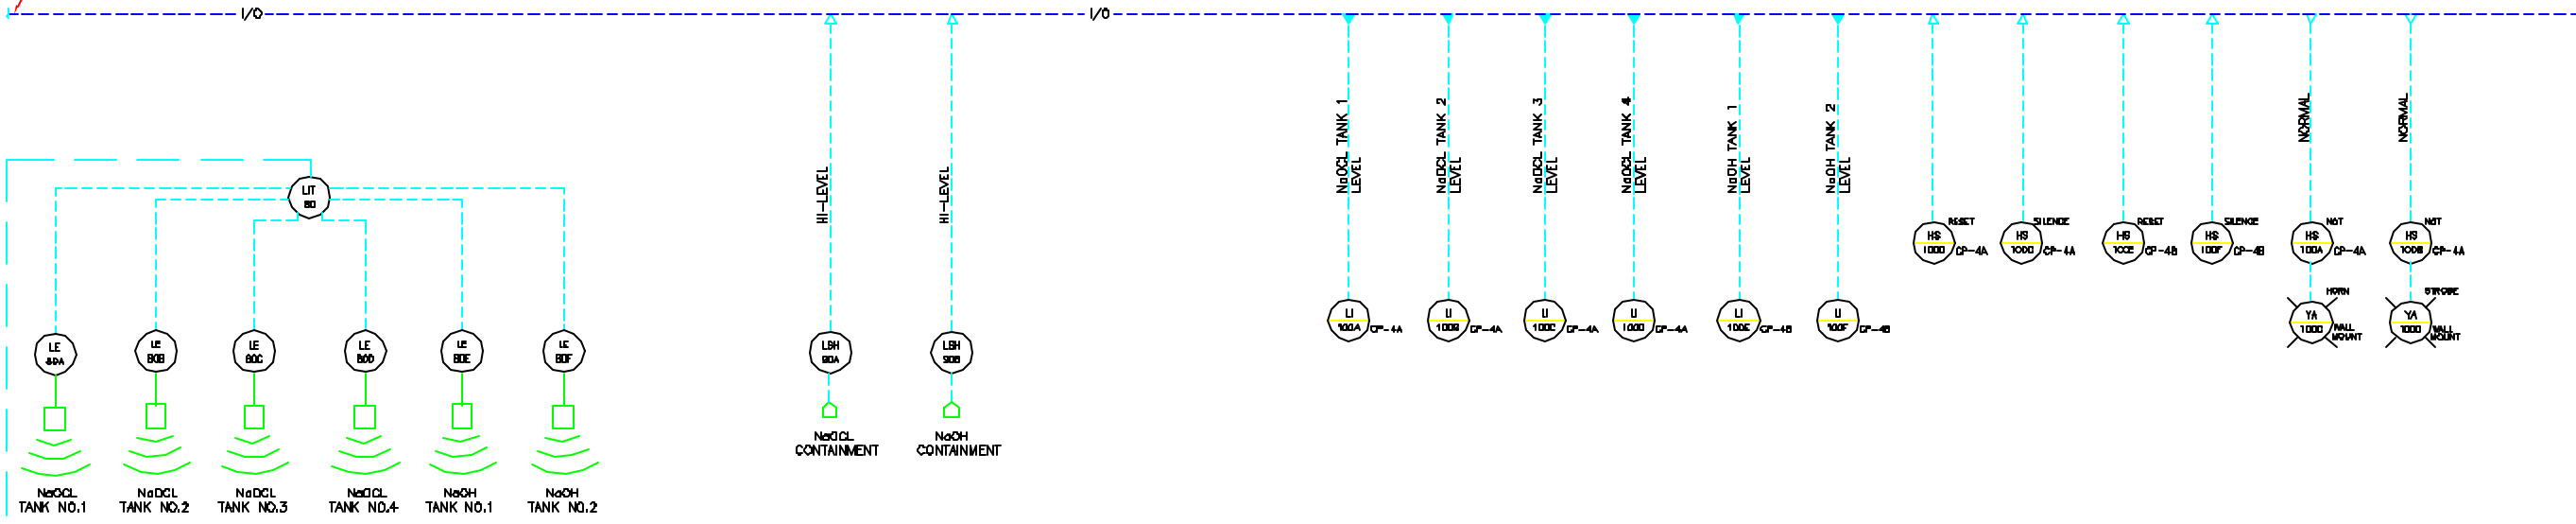


LOOP 80
CHEMICAL STORAGE TANK LEVEL MONITORING

LOOP 90
CHEMICAL STORAGE CONTAINMENT

LOOP 100
CHEMICAL STORAGE & FILL STATION
ALARM SYSTEM

BELDEN 9463 BLUE HOSE TO
ALLEN-BRADLEY REMOTE I/O

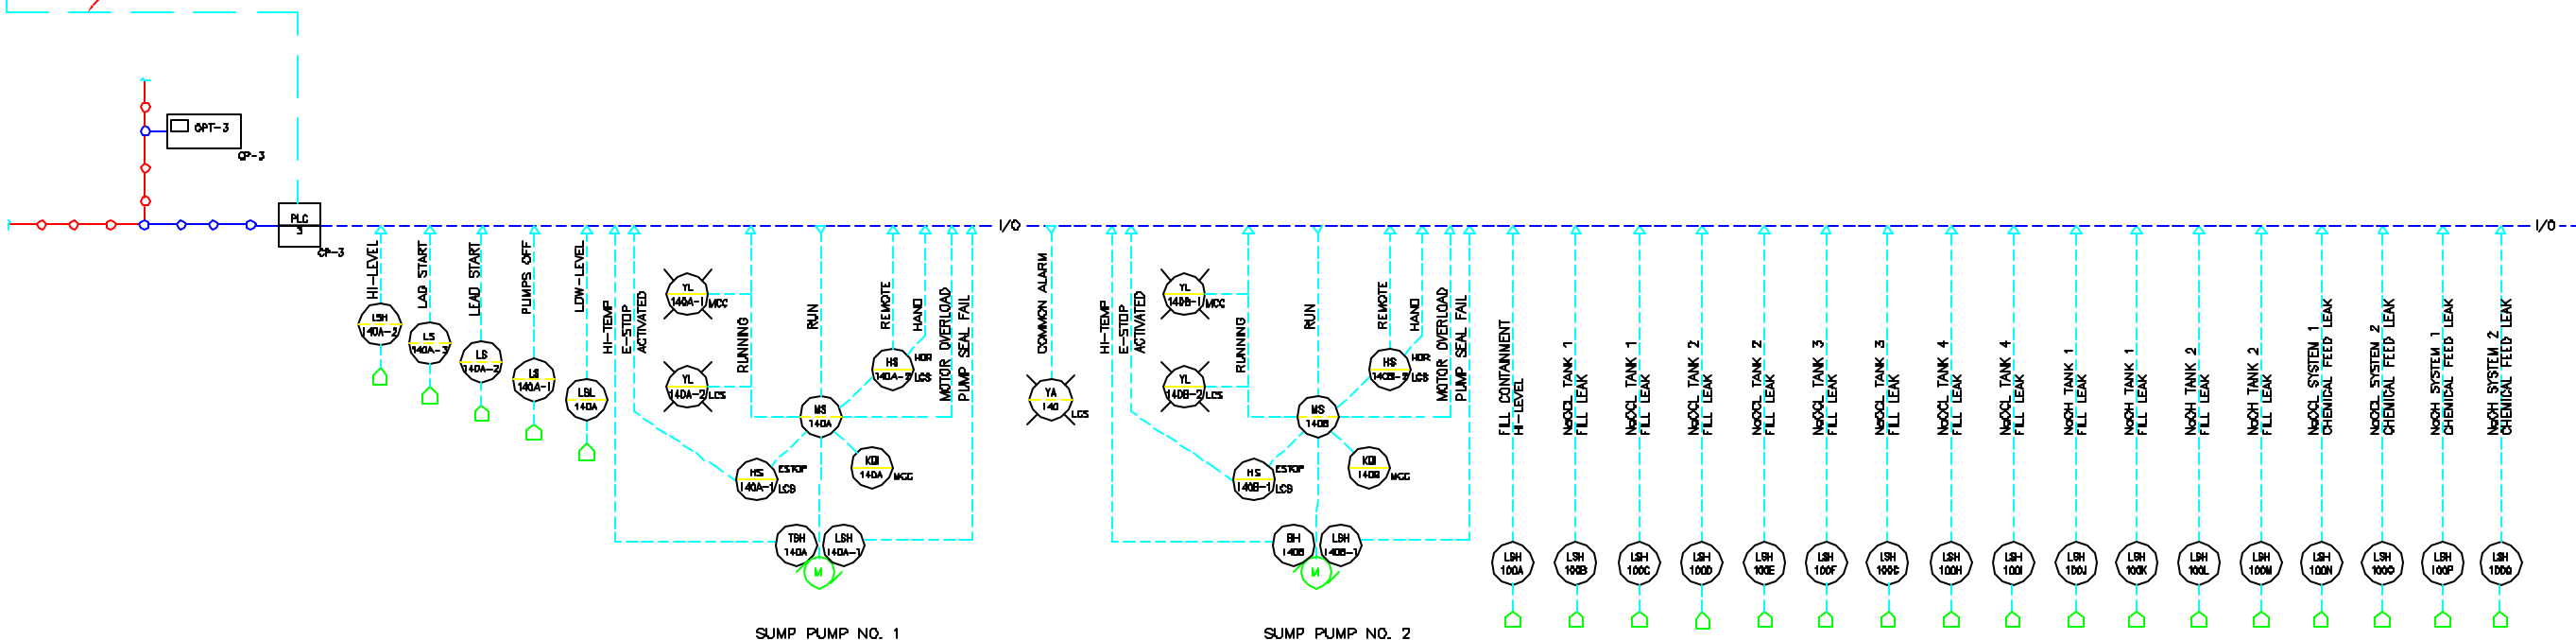

SUMP PUMP NO. 1

SUMP PUMP NO. 2

LOOP 140
ODOR CONTROL ROOM
SUMP PUMP STATION

LOOP 100
CHEMICAL STORAGE & FILL STATION
ALARM SYSTEM- CONT'D

NOTE:
INSTRUMENTATION
SUPPLIER TO PROVIDE
ALL CONNECTIONS TO
EXISTING A/B DATA
HIGHWAY PLUS PLC
NETWORK.

PROJECT PRINTS	DATE	APPROVED	REVISIONS
ISSUED FOR REVIEW 4-4-01			
ISSUED FOR BIDDING 3-4-01			
TAKE LAYOUT			
DATE BIDDING			
FILENAME			
DRAWN BY: JEN			
CHECKED BY: JEN			
DATE: 3-1-01			
APPROVED BY: JEN			
DATE: 3-1-01			
BOOK NO. 2035A			
PROJECT NO. 2035A			
SCALE 1:1			
<p>Wright-Pierce 99 Main Street, Topsham, Maine USA 04086 TEL (207) 725-8721 FAX (207) 725-8414</p>			
<p>PORTLAND WATER DISTRICT PORTLAND, MAINE PRIMARY SEDIMENTATION BASINS UPGRADE WITH ODOR CONTROL FACILITIES</p>			
<p>INSTRUMENTATION LOOPS 80, 90, 100, AND 140</p>			
<p>DWG I-3 60 OF 79</p>			