


- CONSTRUCTION NOTES:**
- PARTITION OFF A MINIMUM OF 4 SQUARE FEET FREE AREA OF THE EXISTING EXHAUST LOUVER BY REPLACING THE EXISTING EXHAUST FAN FOR THE COMBINED USE OF THE LOUVER FOR THE EXISTING EXHAUST FAN AND THE NEW CHEMICAL ROOM EXHAUST FAN.
  - RELOCATE THE EXISTING ACCESS PLATFORM TO THE LOCATION SHOWN ABOVE.
  - SEE DRAWING SHEET M-8 FOR THE MECHANICAL LEGEND AND ABBREVIATIONS.
  - AHU-1 & AHU-2 SHALL BE BALANCED AT 10% LESS AIR FLOW THEN SCHEDULED CAPACITY.
  - SEE PROCESS DRAWINGS FOR PACKED SCRUBBER EQUIPMENT LAYOUT.
  - RUN NEW RAINLEADER PIPING INTERFERENCE FREE AT 1/4" PER FOOT SLOPE. CONNECT TO EXISTING 4" RAIN LEADER.

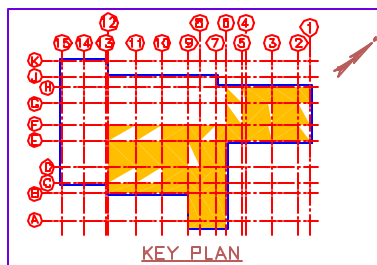

NO.	REVISIONS	DATE	BY	CHKD.	APP'D.
1	ISSUED FOR PERMITS	4-4-20			
2	ISSUED FOR BIDDING	3-4-21			
3	TAKE LOCATION				
4	DATE REVISION				
5	FILENAME				

DRAWN BY: JML	CHECKED BY: JML	DATE: 3-24-20
APPROVED BY: JML	DATE: 3-24-20	
BOOK NO.: 27053A	PROJECT NO.: 27053A	SCALE: 1/8"=1'-0"
99 Main Street, Topsham, Maine USA 04086 TEL: (207) 725-8721 FAX: (207) 725-8414		

PORTLAND WATER DISTRICT
PORTLAND, MAINE
PRIMARY SEDIMENTATION BASINS
UPGRADE WITH ODOR CONTROL FACILITIES
EXISTING PROCESS BUILDING
FIRST FLOOR PLANS AND SECTION

DWG M-6
55 OF 79