
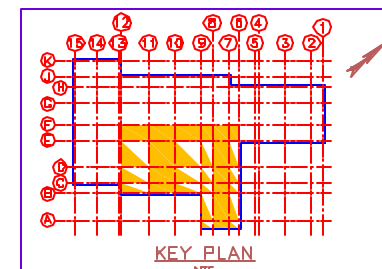


CONSTRUCTION NOTES:

1. CONNECT NEW 1 1/4" STEAM LINE TO EXISTING 4" LINE.
2. CONNECT NEW, 1 1/2", SCH 80, CONDENSATE LINE TO EXISTING 2" LINE AT CONDENSATE PUMP SET.
3. REPLACE EXISTING FLOAT CONTROL AND THE OLDER OF THE TWO PUMPS ON EXISTING CONDENSATE PUMP SET AND ADJUST FOR PROPER OPERATION.
4. SEE SHEET M-8 FOR MECHANICAL LEGEND AND ABBREVIATIONS.
5. SEE PROCESS DRAWINGS FOR ODOR CONTROL SCRUBBER EQUIPMENT LAYOUT.
6. REPLACE THE TWO PUMPS ON THE CONDENSATE PUMP SET LOCATED AT THE BOTTOM OF THE RAMP SERVING THE SCREENINGS ROOM AIR HANDLING UNITS.

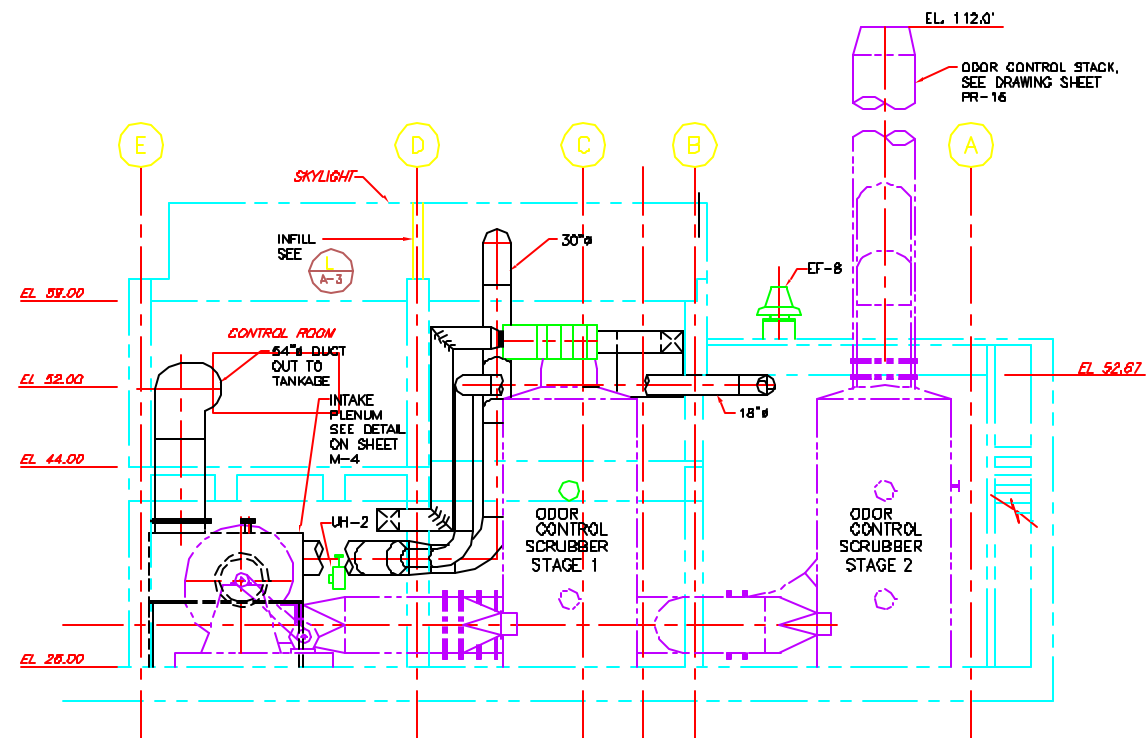

NO.	REVISIONS	DATE	APP'D.

Wright-Pierce
99 Main Street
Topsham, Maine USA 04086
TEL (207) 725-8721 FAX (207) 259-8414

PORTLAND WATER DISTRICT
PORTLAND, MAINE
PRIMARY SEDIMENTATION BASINS
UPGRADE WITH ODOR CONTROL FACILITIES
EXISTING PROCESS BUILDING
BASEMENT PLAN AND SECTION