

AIR HANDLING UNIT SCHEDULE

TAG	AREA SERVED	SUPPLY FAN				ELECTRICAL			HEATING				DIRECT EXPANSION COOLING COIL						MIN. O.A.	WEIGHT (LBS) *	REMARKS			
		CFM	ESP	RPM	HP	MCA	MOP	KW	VOLTAGE	FUEL	MBH IN	MBH OUT	STAGES	EAT	LAT	EDB	EWB	SENS.				TOTAL	LDB	LWB
AHU-1	SHOWROOM AREA	4,000	0.750"	1,482	3.80	49.60	60.00	10.73	208V-60-3P	N.G.	150.0	120.0	2	65	93.1	80.0	67.0	86.43	112.77	60.32	58.10	10.0%	1,369	ROOFTOP UNIT, DOWNFLOW
AHU-2	FUTURE STORAGE	2,000	0.375"	1,050	1.00	27.40	40.00	5.42	208V-60-3P	N.G.	130.0	104.0	1	50	98.4	80.0	67.0	45.10	59.26	59.48	57.60	5.0%	824	ROOFTOP UNIT, DOWNFLOW
AHU-3	FUTURE STORAGE	2,000	0.375"	1,050	1.00	27.40	40.00	5.42	208V-60-3P	N.G.	130.0	104.0	1	50	98.4	80.0	67.0	45.10	59.26	59.48	57.60	5.0%	824	ROOFTOP UNIT, DOWNFLOW

* WEIGHT DOES NOT INCLUDE CURBS

FAN SCHEDULE

TAG	AREA SERVED	TYPE	CFM	SP	SONES	dBA	RPM	HP	ELECTRIC	WEIGHT	REMARKS
EF-1	TOILETS	ROOF CENT.	225	1/4"	3.0	42.0	936	1/25	120V-60-1P	65	OPERATE FROM OCCUPANCY SENSORS BY E.C.
EF-2	D&R BAYS	ROOF CENT.	2,000	1/4"	10.2	60.0	1,500	1/3	120V-60-1P	120	OPERATE FROM MANUAL SWITCH

SONE RATINGS ARE MINIMUMS NOT TO BE EXCEED. SONE RATINGS WILL NOT BE ACCEPTED









AIR TERMINAL SCHEDULE

TAG	SIZE	MAX CFM	MAX NC	MAX SP	REMARKS
D1	6"Ø	155	20	0.05"	SQUARE DIFFUSER / LAY-IN FRAME
D2	10"Ø	385	20	0.03"	SQUARE DIFFUSER / LAY-IN FRAME
D2	10"Ø	385	20	0.03"	SQUARE DIFFUSER / GYPSUM FRAME
ER1	6" x 6"	90	20	0.070"	EX-HAUST REGISTER
RR1	6" x 6"	130	20	0.100"	RETURN REGISTER
RR2	24"x24"	1,875	20	0.051"	RETURN REGISTER WITH LAY-IN FRAME

UNIT HEATER SCHEDULE

TAG	TYPE	AREA SERVED	INPUT MBH	OUTPUT MBH	FUEL	CFM	MOTOR HP	ELECTRIC			WEIGHT	REMARKS
								FLA	WATTS	VOLTAGE		
UH-1	HORIZONTAL	109 D&R BAYS	60.0	49.2	N.G.	1,012	1/3	7.1	447	115V-60-1P	89	CENTRIFUGAL BLOWER
UH-2	HORIZONTAL	110 UTILITY	25.0	20.0	N.G.	380	1/50	0.8	60	115V-60-1P	72	AXIAL BLOWER

SYMBOLS AND ABBREVIATIONS

AC	AIR CONDITIONING	LAT	LEAVING AIR TEMPERATURE		THERMOSTAT
AD	ACCESS DOOR	LDB	LEAVING DRY BULB		THERMOSTAT WITH GUARD
AFF	ABOVE FINISH FLOOR	LWB	LEAVING WET BULB		MANUAL DAMPER
AHU	AIR HANDLING UNIT	MBH	THOUSAND BTU PER HOUR		FLEXIBLE DUCT
AP	ACCES PANEL	MC	MECHANICAL CONTRACTOR		LAY-IN DIFFUSER
APD	AIR PRESSURE DROP	MD	MANUAL DAMPER		SURFACE MOUNT DIFFUSER
ATC	AUTOMATIC TEMP. CONTROL	MOD	MOTOR OPERATED DAMPER		SUPPLY AIR DUCT
BD	BACKDRAFT DAMPER	NG	NATURAL GAS		RETURN / RELIEF AIR DUCT
BJ	BAR JOIST	NTS	NOT TO SCALE		
CFH	CUBIC FEET PER HOUR	OA	OUTDOOR AIR		
CFM	CUBIC FEET PER MINUTE	PC	PLUMBING CONTRACTOR		
DIFF	DIFFUSER	R	RETURN		
DIW	DOWN IN WALL	RA	RETURN AIR		
EAT	ENTERING AIR TEMPERATURE	RR	RETURN REGISTER		
EC	ELECTRICAL CONTRACTOR	S	SUPPLY		
EDB	ENTERING DRY BULB	SA	SUPPLY AIR		
EF	EXHAUST FAN	SC	SITE CONTRACTOR		
EG	EXHAUST GRILLE	SG	SUPPLY GRILLE		
ER	EXHAUST REGISTER	SP	STATIC PRESSURE		
ESP	EXTERNAL STATIC PRESSURE	SR	SUPPLY REGISTER		
GC	GENERAL CONTRACTOR	TC	TEMPERATURE CONTROL		
H&V	HEATING & VENTILATING	T'STAT	THERMOSTAT		
HVAC	HEATING, VENTILATING AND AIR CONDITIONING	UC	UNDERCUT		
		UH	UNIT HEATER		

GENERAL NOTES

1. Mechanical Contractor shall coordinate work with all other trades.
2. All piping and ductwork shall be run concealed and on the warm side of building insulation unless shown otherwise.
3. Piping and ductwork is shown diagrammatically. Exact locations to be adjusted as required to conform to field conditions.
4. All duct sizes indicated are outside (sheet metal) dimensions.
5. All cutting and patching by the General Contractor.
6. All square duct elbows over 12 inches in width to have turning vanes.
7. Refer to Architectural Reflected Ceiling Plans for exact locations of all ceiling registers, diffusers and grilles.
8. All dimensions associated with existing conditions are approximate and are to be field verified.

ROBERT J. FOSTER ARCHITECT

36 Groveside Road, Portland, Maine 04102

(207) 761-3822

Project Title


U-HAUL MOVING & STORAGE

425 MARGINAL WAY
Portland, Maine


Aug. 15, 2014 Contract Document

Mark Date Description

Issue Dates

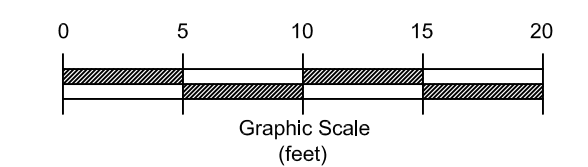

MECHANICAL SYSTEMS ENGINEERS
ROYAL RIVER CENTER, UNIT #10
10 FOREST FALLS DRIVE
YARMOUTH, MAINE 04096
FACEBOOK: MECHANICAL SYSTEMS ENGINEERS
207-840-1441
M.S.E. Proj. 1422
© COPYRIGHT 2014

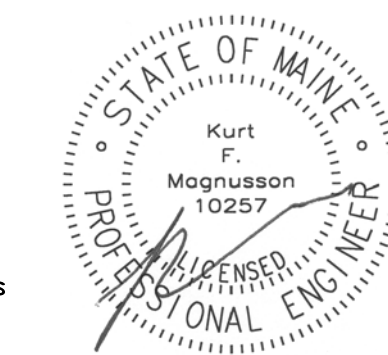

EQUIPMENT SCHEDULES

NO SCALE

M1

Drawing Title

**MECHANICAL
EQUIPMENT
SCHEDULES**

Drawing Number

M2