

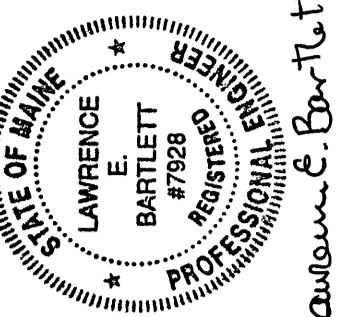


East End Elementary School Portland Public Schools Portland, Maine		Job No.: 009 Date: 10/1/09 Scale: 1/8" = 1'-0" Drawn by: JK Checked by: JL Drawing Title: Ground Floor North Power Plan	<h1 style="font-size: 2em; margin: 0;">E2.1</h1>
Consultants: Civil Engineer: Duluca-Hoffman Associates Landscape Architect: Carrol Associates Structural Engineer: Pinham & Greer Mechanical Engineer: Bennett Engineering Electrical Engineer: Barlett Design Interior Designer: Kamen Design T.M. Consulting Fire Stations: Fire Stations		Revisions:  Lawrence C. Bartlett ARCHITECTS 100 Park Street Portland, ME 04103 Phone: 603.761.1111 Fax: 603.761.1105 Email: eab@bartlett.com	

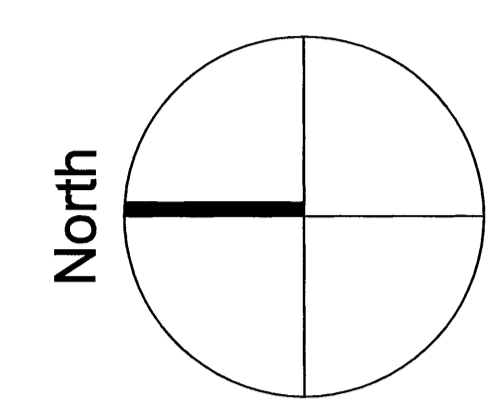

GROUND FLOOR NORTH POWER PLAN
1/8" = 1'-0"

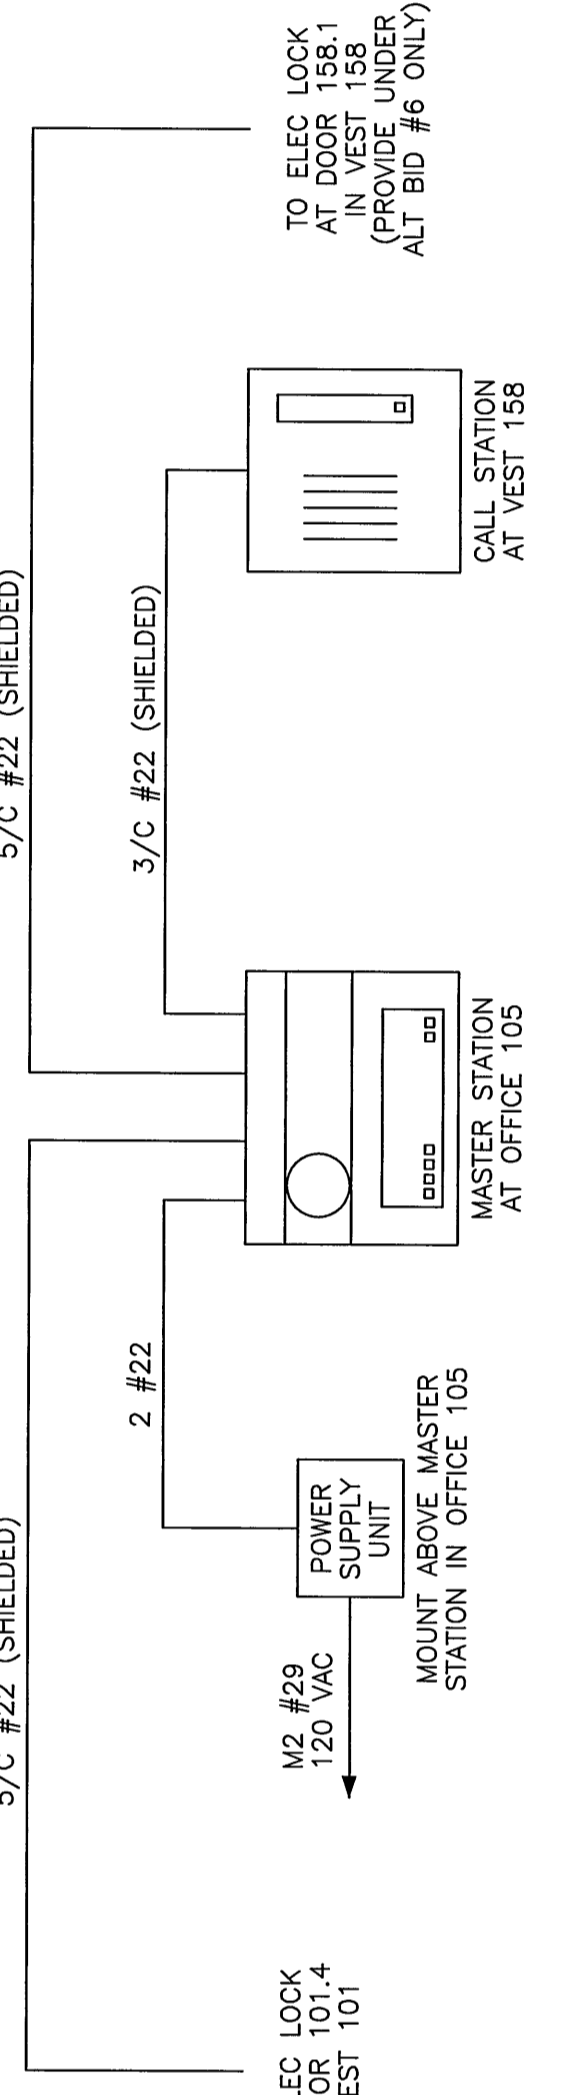

DOOR INTERCOM SYSTEM DIAGRAM
NOT TO SCALE

- NOTES
1. VERIFY EXACT LOCATION OF ALL MECHANICAL EQUIPMENT PRIOR TO ROUGH-IN.
 2. INTERLOCK SHUT TRIP CIRCUIT BREAKERS SERVING WITH HOOD FIRE SUPPRESSION SYSTEM TO DEACTIVATE CIRCUITS UPON DISCHARGE OF SUPPRESSION SYSTEM.
 3. WEATHER-PROTECTED DOORS SHALL BE EQUIPPED WITH AN INTERCOM SYSTEM. AN ACCESS CARD READER, A DOOR LOCK (NOTE 3), AND A CALL STATION SHALL BE INSTALLED AT BID #6. SEE SHEET E4.4 FOR WIRING OF SECURITY/DOOR ACCESS DEVICES.
 4. PROVIDE WIRING AND CONNECTIONS BETWEEN EXHAUST FAN SWITCH TO BE SUPPLIED UNDER DIV 15, AND INSTALLED UNDER DIV 16. PROVIDE DOOR ACCESS CONTROLS UNDER BID #6. SEE SHEET E4.4 FOR WIRING DIAGRAM.