

GENERAL NOTES:

- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATIONS AND ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR LOCATIONS AND DIMENSIONS OF OPENINGS, CHASES, INSERTS, REGLET'S, SLEEVES, DEPRESSIONS, AND OTHER DETAILS NOT SHOWN ON THE STRUCTURAL DRAWINGS.
- ALL DIMENSIONS AND CONDITIONS MUST BE VERIFIED IN THE FIELD. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCE TO ENSURE SAFETY OF THE STRUCTURE AND PERSONNEL DURING ERECTION. THIS INCLUDES THE ADDITION OF THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS OR TIEDOWNS, SUCH MATERIAL SHALL BE REMOVED AT THE REQUEST OF THE CONTRACTOR AFTER COMPLETION OF THE PROJECT.
- ALL APPLICABLE FEDERAL, STATE, AND MUNICIPAL REGULATIONS SHALL BE FOLLOWED, INCLUDING THE FEDERAL DEPARTMENT OF LABOR OCCUPATIONAL SAFETY AND HEALTH ACT.
- IT IS THE OWNER'S SOLE RESPONSIBILITY TO EMPLOY ONE OR MORE SPECIAL INSPECTORS (IF REQUIRED) TO PROVIDE INSPECTIONS IN COMPLIANCE WITH ALL APPLICABLE REQUIREMENTS OF IBC 2003.

STRUCTURAL DESIGN CRITERIA:

- BUILDING CODE: IUBEC AND INTERNATIONAL BUILDING CODE
- DESIGN WIND LOADS - MAIN WIND FORCE RESISTING SYSTEM: = 100 MPH
BUILDING WIND SPEED = 1.0
BUILDING EXPOSURE FACTOR (WIND) = B
BUILDING EXPOSURE CATEGORY = B
- SNOW: GROUND SNOW LOAD = 60 PSF
IMPORTANCE FACTOR, I = 0.7
EXPOSURE FACTOR, C_e = 0.7
FLAT ROOF SNOW LOAD = 42 PSF
- ROOF DEAD LOAD: = 10.0 PSF
TOP CHORD = 10.0 PSF
BOTTOM CHORD
- LIVE LOADS: FLOOR LIVE LOAD = 40.0 PSF

DESIGN SEISMIC CRITERIA:

- EQUIVALENT LATERAL FORCE PROCEDURE USE GROUP (CATEGORY) = I
- S_Ds = 0.328
S₁s = 0.124
SEISMIC DESIGN CATEGORY = D
SITE CLASS = D
R = 7.0
C_d = 4.5
- SEISMIC RESISTING SYSTEM = LIGHT FRAMED WALLS WITH SHEAR PANELS
- SEISMIC BASE SHEAR, V = 0.047 x M

CONCRETE NOTES:

- ALL CONCRETE WORK SHALL CONFORM TO ACI-318.
- ALL CONCRETE EXCEPT INTERIOR AND EXTERIOR SLABS ON GROUND SHALL BE 3000 PSI AT 28 DAYS AND A MAXIMUM SLUMP OF 4". ALL INTERIOR AND EXTERIOR SLABS ON GROUND SHALL BE 4000 PSI AT 28 DAYS AND A MAXIMUM SLUMP OF 4". MAXIMUM SIZE AGGREGATE SHALL BE 3/4" (WALL/FOOTINGS) AND 1 1/2" (SLABS ON GROUND).
- CONCRETE TO REMAIN EXPOSED TO WEATHER SHALL BE AIR ENTRAINED. NO AIR ENTRAINMENT IN INTERIOR CONCRETE SLABS.
- CONCRETE SHALL NOT BE PLACED IN WATER OR ON FROZEN GROUND.
- REINFORCING BARS SHALL CONFORM TO ASTM A615 GRADE 60. DEFORMED BARS SHALL BE DETAILED AND FABRICATED IN ACCORDANCE TO ACI-318 LATEST EDITION, AND PLACED IN ACCORDANCE WITH ACI-318.
- SPLICES OF REINFORCING BARS SHALL BE IN ACCORDANCE WITH ACI-318.
- ANCHOR RODS SHALL CONFORM TO ASTM F1554-36.
- HOOKS NOT DIMENSIONED SHALL BE ACI STANDARD HOOKS.
- CONCRETE COVER OVER REINFORCEMENT SHALL BE AS FOLLOWS:
CONCRETE EXPOSED TO WEATHER = 1 1/2"
CONCRETE NOT EXPOSED TO WEATHER OR WEATHER = 3/4"

FOUNDATION NOTES:

- FOUNDATION DESIGNED BASED ON AN ASSUMED MAXIMUM ALLOWABLE BEARING PRESSURE OF 2500 PSF. IT IS THE RESPONSIBILITY OF THE OWNER/CONTRACTOR TO VERIFY THE SOIL BEARING CAPACITY. NOTIFY THE ENGINEER AND STOP WORK IF CLAY, MET. SOILS, FILL, OR OTHER DELETERIOUS MATERIALS ARE ENCOUNTERED.
- DESIGN OF EXTERIOR FOUNDATIONS IS BASED ON A FROST DEPTH OF 4'-6" BELOW FINISHED GRADE.
- NO HORIZONTAL JOINT WILL BE PERMITTED IN THE WALLS UNLESS NOTED OTHERWISE.
- FOUNDATION CONTRACTOR SHALL SET COLUMN ANCHOR RODS AND LEVELING PLATES, INCLUDING GROUTING, AS PER THE STRUCTURAL STEEL CONTRACTOR'S DRAWINGS.
- EXCAVATING AND BACK FILLING AT NEK FOUNDATION WALLS SHALL BE DONE SUCH THAT STRUCTURAL LOADING SHALL BE MAINTAINED. BACK FILL SHALL BE COMPACTED TO THE REQUIRE DIFFERENT BACK FILL HEIGHTS. WALLS SHALL BE FIRMLY SHORED IN POSITION, AND SHORES SHALL REMAIN UNTIL FLOORS ARE PLACED AND PROPERLY SET, TO PROVIDE FULL SUPPORT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR DESIGN, INSTALLATION, AND FINAL CLEARANCE OF ANY NEEDLING, SHORING, OR BRACING OF EXISTING STRUCTURES.
- VAPOR BARRIER BENEATH SLAB SHALL BE "STEGO MRAP" OR POLYETHYLENE "IS NOT" AN ALTERNATE PRODUCT.


WOOD FRAMING NOTES:

- STRUCTURAL LUMBER: SPRUCE PINE FIR NO.1/NO.2 OR BETTER
F_c = 155 PSI F_v = 1000 PSI E = 1400000 PSI
F_c = 150 PSI F_v = 1000 PSI E = 1400000 PSI
- DESIGN CODE: IBC 2003 / NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION BY THE NATIONAL FOREST PRODUCTS ASSOCIATION.
- NAILING REQUIREMENTS FOR PLYWOOD SHEATHING:
PROVIDE 8d NAILS AS FOLLOWS UNLESS SHOWN OTHERWISE:
8d NAILS @ 6" o.c. ALONG INTERMEDIATE MEMBERS
8d NAILS @ 12" o.c. ALONG SHEAR WALL PANEL EDGES
PROVIDE BLOCKING AT ALL PANEL EDGES
- SPIKE TOGETHER ALL FRAMING MEMBERS WHICH ARE BUILT-UP USING MULTIPLE 2x LUMBER.
- PROVIDE GALVANIZED METAL TIES EQUAL TO SIMPSON H2 5 HURRICANE TIES BETWEEN ROOF RAFTERS OR TRUSSES AND SUPPORTING WALL MEMBERS, UNLESS SHOWN OTHERWISE.
PROVIDE GALVANIZED METAL CONNECTORS EQUAL TO SIMPSON TC26 TRUSS CONNECTOR BETWEEN ALL ROOF SCISSOR TRUSSES AND SUPPORTING WALL MEMBERS, UNLESS SHOWN OTHERWISE.
- PROVIDE PRESSURE TREATED LUMBER FOR ALL LUMBER IN CONTACT WITH MASONRY OR CONCRETE.
- ROOF SHEATHING: 5/8" APA RATED SHEATHING, EXTERIOR OR STRUCTURAL I OR II RATED SHEATHING, SPAN RATING 32/16 (TRUSSES), 24/12 (JOISTS). INSTALL SHEETS WITH FACE GRAIN DIRECTION PERPENDICULAR TO SUPPORTING MEMBERS.
- PROVIDE 1/2" THRU BOLTS STAGGERED @ 24" O.C. FOR ATTACHMENT OF 2x NAILER AT TOP OR BOTTOM OF WF BEAM (COORDINATE w/ PLANS)
- WALL CONSTRUCTION - FIRST FLOOR:
STUD HEIGHT UP TO 10'-6"
1) 2x TOP PLATES
2) 2x TOP PLATES
3) 2x CDX SHEATHING
- ROOF CONSTRUCTION
FRAMING AS SHOWN ON PLANS
5% APA RATED PLYWOOD SHEATHING (REFER TO NOTE #7)
PROVIDE 8d NAILS @ 12" o.c. ALONG FRAMING MEMBERS.
- ALL NAILS, SPIKES, BOLTS ETC. FASTENING MEMBERS TO PRESSURE TREATED LUMBER SHALL BE EITHER STAINLESS STEEL OR HEAVY GALVANIZED.

WOOD TRUSS NOTES:


- DESIGN CRITERIA FOR ROOF SYSTEM:
A. LIVE LOAD (SNOW) PER STRUCTURAL DESIGN CRITERIA
B. DEAD LOAD PER STRUCTURAL DESIGN CRITERIA
C. WIND LOAD PER STRUCTURAL DESIGN CRITERIA
D. L. LIVE LOAD PER INTERNATIONAL BUILDING CODE
E. ALLOWABLE DEFLECTION = L/360
F. PROVIDE BOTTOM CHORD CAMBER EQUAL TO THE TRUSS DEAD LOAD DEFLECTION.
- MATERIALS:
A. STRESS GRADED LUMBER, METAL PLATE CONNECTORS
- APPLICABLE SPECIFICATIONS:
A. NATIONAL DESIGN SPECIFICATIONS FOR STRESS GRADE LUMBER AND ITS FASTENING (NDS).
B. MOST RECENT AISC STANDARDS.
C. DESIGN SPECIFICATIONS FOR LIGHT METAL PLATE CONNECTED WOOD TRUSSES. 1TH LATEST EDITION.
- BRACING:
A. TRUSS MANUFACTURER SHALL SPECIFY ALL BRACING FOR BOTH TEMPORARY CONSTRUCTION LOADING AND FOR PERMANENT LATERAL SUPPORT OF GABLE END TRUSS AND COMPRESSION MEMBERS, AS WELL AS ERECTION PROCEDURES.
B. MINIMUM BRACING REQUIREMENTS AND INSTRUCTIONS FURNISHED BY TRUSS MANUFACTURER SHALL INCLUDE AND CONFORM TO HB-91.
C. ALL TEMPORARY AND PERMANENT BRACING SHALL BE MINIMUM 2x4 SPT No. 2 MATERIAL CONNECTED WITH MINIMUM 2-lbd NAILS AT ALL CONNECTIONS, UNLESS OTHERWISE SPECIFIED BY TRUSS MANUFACTURER OR THE COMMENTARY TO THE DESIGN SPECIFICATIONS FOR LIGHT METAL PLATE CONNECTED WOOD TRUSSES, HB-91.
D. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE BRACING METAL PLATE CONNECTED WOOD TRUSSES, HB-91.
E. IT IS THE RESPONSIBILITY OF THE INSTALLER/CONTRACTOR TO PROPERLY RECEIVE, UNLOAD, STORE, HANDLE, INSTALL, AND BRACE TRUSSES TO PROTECT LIFE AND PROPERTY.
- ALL FABRICATED TRUSSES SHALL RECEIVE THE TPI MARK OF APPROVAL IN ACCORDANCE WITH THE TRUSS PLATE INSTITUTE PROCEDURES.
- SUBMIT TRUSS SHOP DRAWINGS FOR REVIEW PRIOR TO TRUSS MANUFACTURE.
- ANY VARIATIONS BY THE TRUSS MANUFACTURER FROM THESE DRAWINGS INCLUDING BUT NOT LIMITED TO THE NEED FOR BIRD MOUTHS SHALL BE CLEARLY NOTED ON THE TRUSS DRAWINGS. APPROPRIATE DETAILS SHALL BE PROVIDED, WHICH SHOW SUCH VARIATIONS. ALL VARIATIONS SHALL BE APPROVED BY THE ENGINEER.

ISSUED 4.7.14

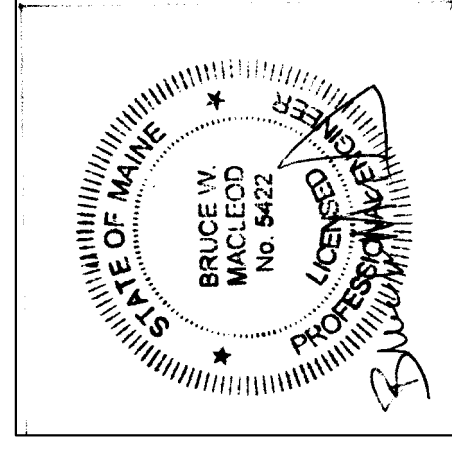


MACLEOD
STRUCTURAL ENGINEERS PA
90 Bridge Street, Suite 252, Westbrook, Maine 04098 207.835.0880
Renovation and Addition to
218 Washington Ave.
Portland, Maine

TITLE: _____
DATE: 04/15/14 DRAWN BY: BMM
SCALE: as noted PROJECT NO.: 2014-145
NOTES: _____
DRAWING NUMBER: S-3

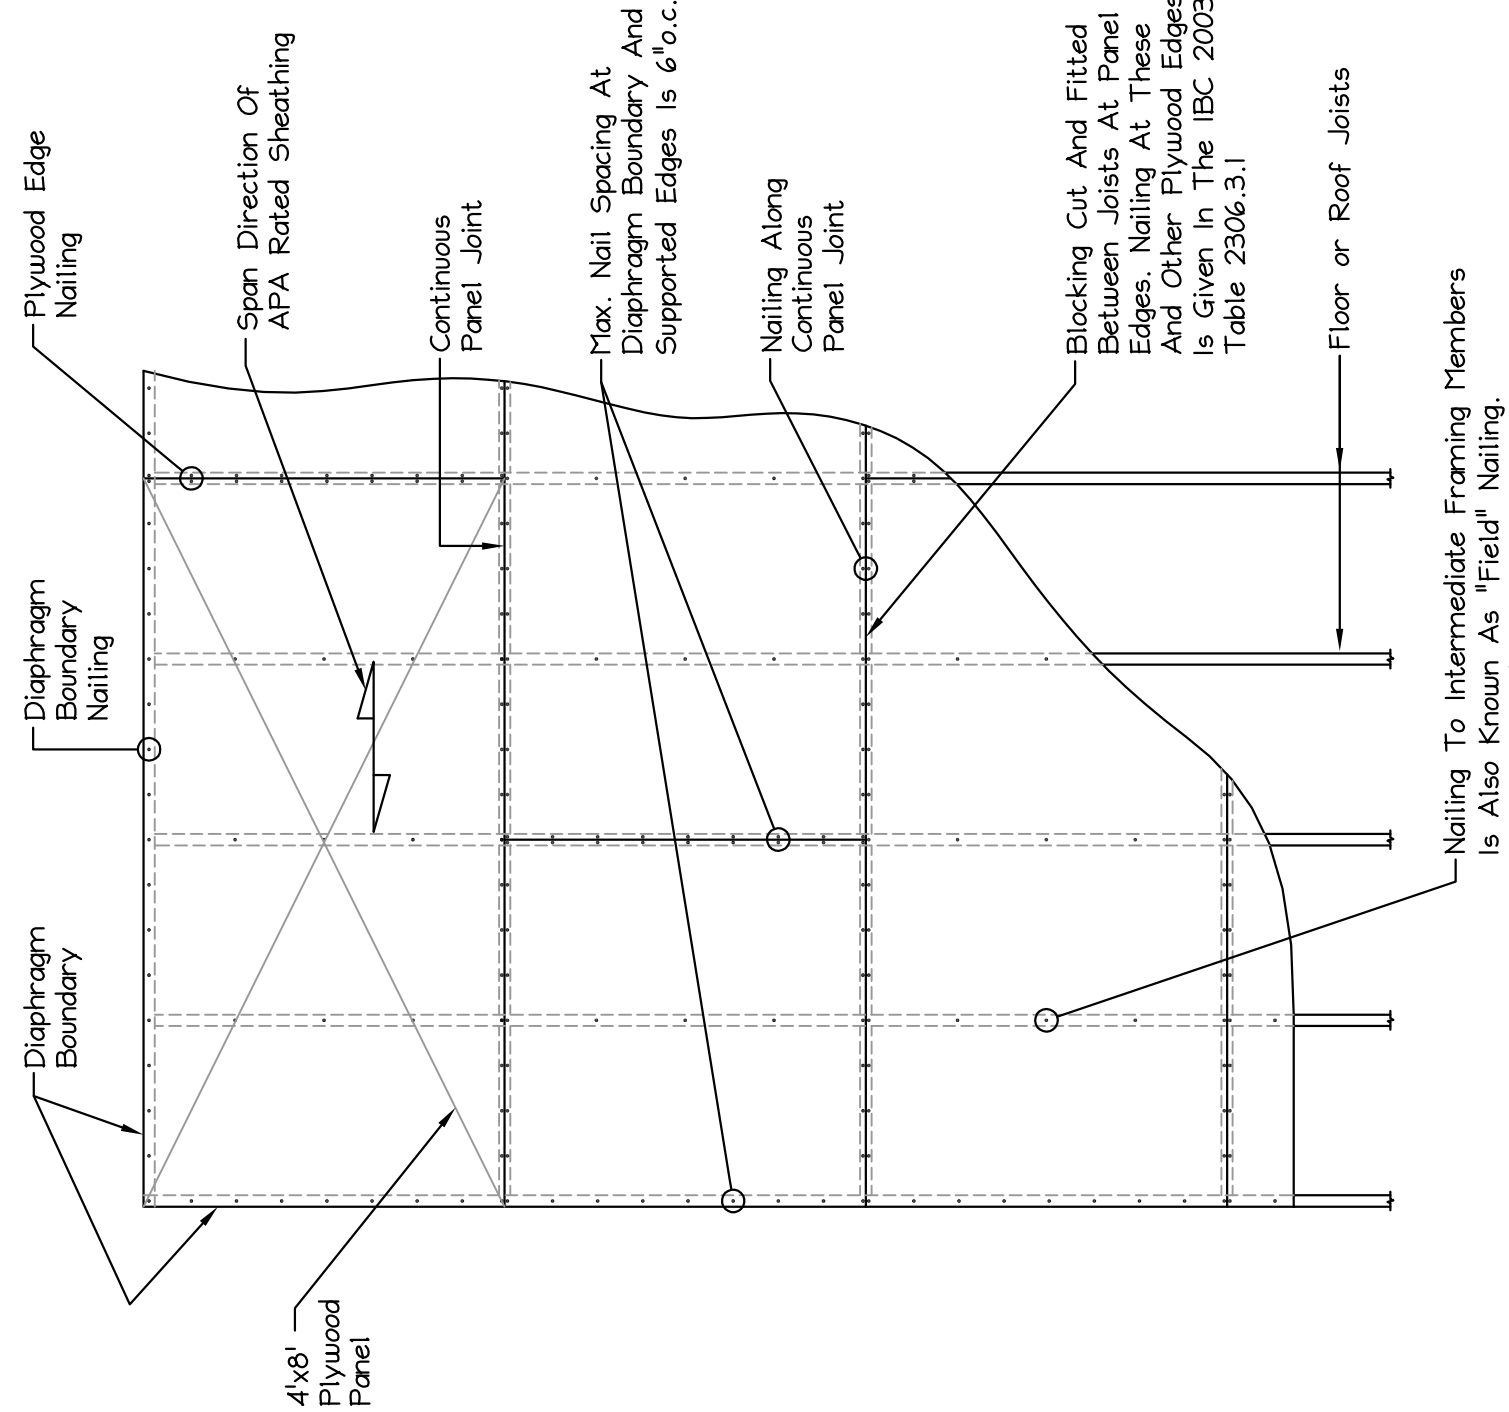

NAILING SCHEDULE:
Diaphragm Boundary: (Blocked & Un-Blocked)
8d Nails @ 6" o.c.
Blocked Panel Edges:
8d Nails @ 6" o.c.
Intermediate Support (Field):
8d Nails @ 12" o.c.

DETAIL - Sheathing Nailing Plan (Roof or Floor)
Scale: 1/2" = 1'-0"

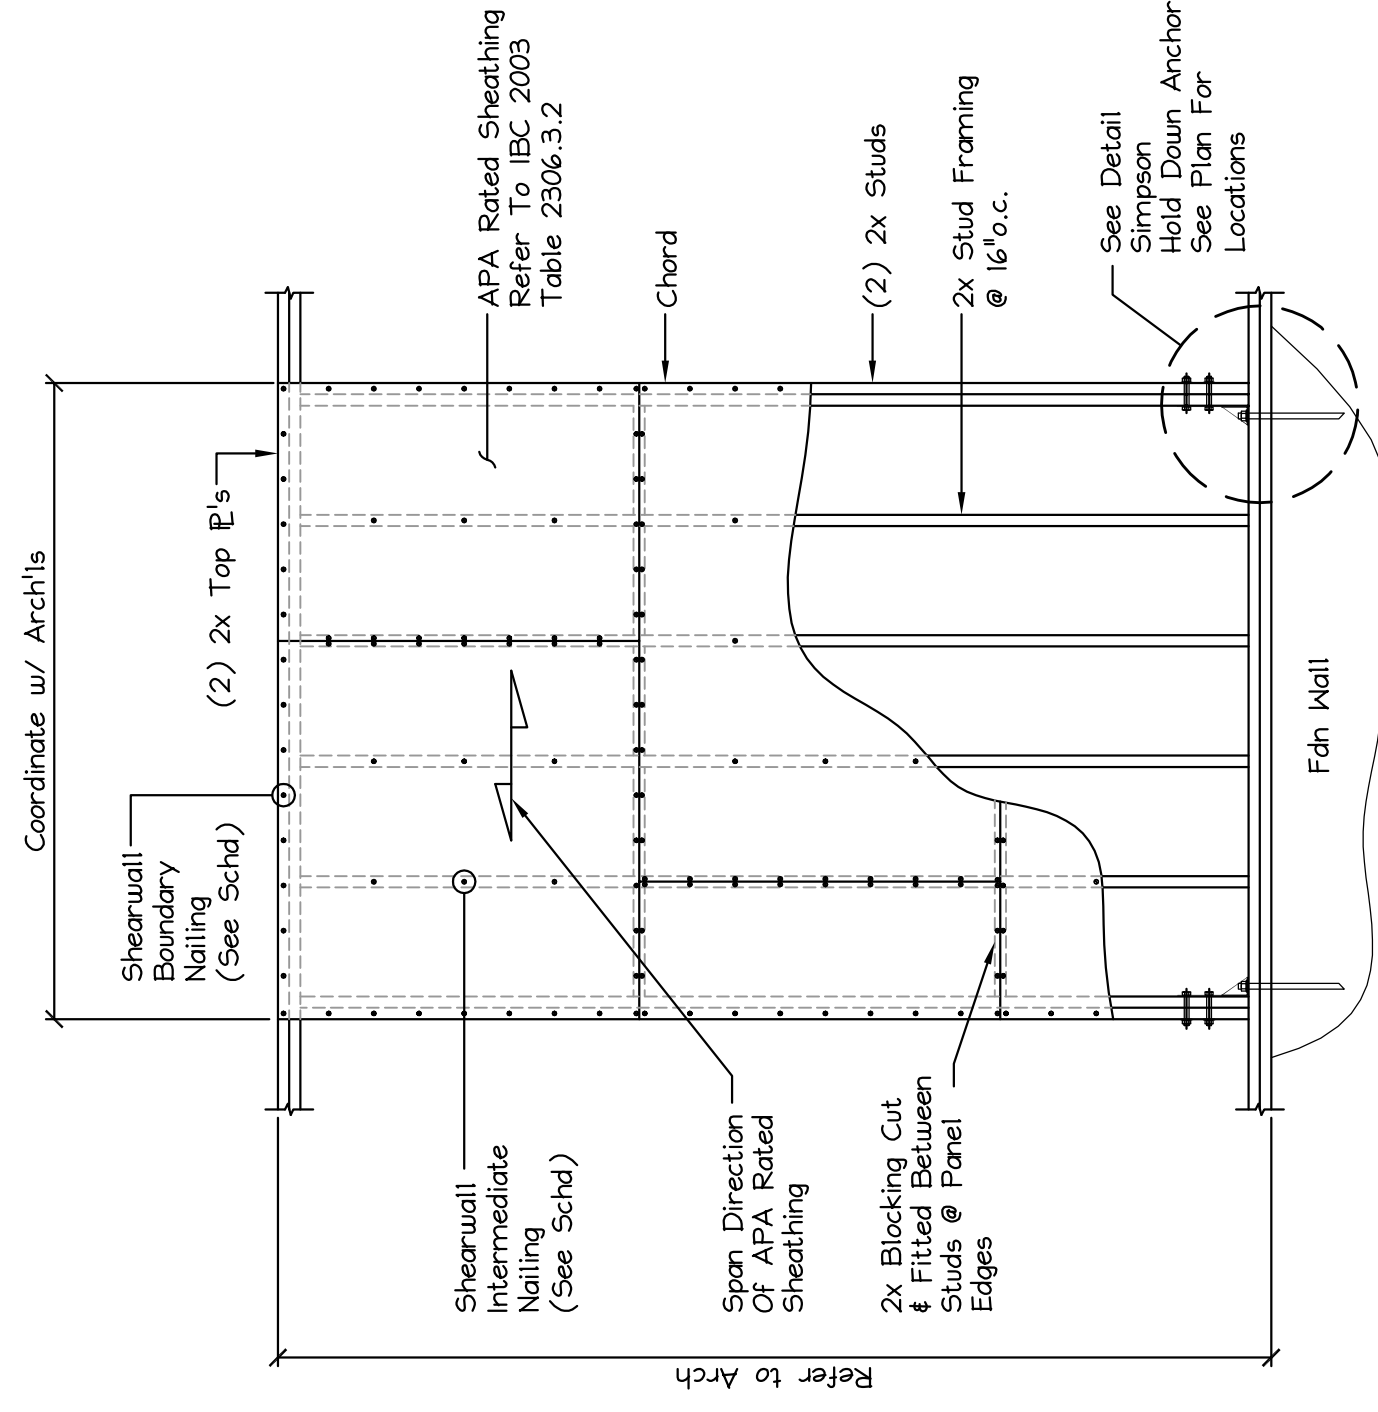

NAILING SCHEDULE:
Shearwall Boundary:
8d Nails @ 6" o.c.
Blocked Panel Edges:
8d Nails @ 6" o.c.
Intermediate Support (Field):
8d Nails @ 12" o.c.

DETAIL - Shear Wall
Scale: 1/2" = 1'-0"