


2" TOTAL THICKNESS INSULATED WALL SHEATHING PER ARCH. FASTEN TO FRAMING W/ MIN. .131 DIA. x 3 1/2" LONG 16d NAILS @ 3" O.C. ALONG PANEL EDGES AND 12" IN FIELD. BLOCK ALL PANEL EDGES - TYP.




ROOF FRAMING PLAN

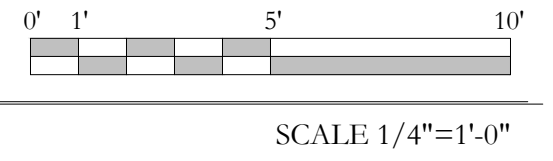

- NOTES:
- SEE GENERAL NOTES FOR ADDITIONAL INFORMATION.
 - ALL WOOD COLUMNS IN 2x6 WALLS SHALL BE 3-2x6 AND IN 2x4 WALLS SHALL BE 3-2x4 UNLESS NOTED OTHERWISE ON PLANS.
 - ALL HEADERS IN 2x6 BEARING WALLS ARE (3) 2x6, UNO.
 - ALL HEADERS IN 2x4 BEARING WALLS ARE (2) 2x8, UNO.
 - ALL ROOF SHEATHING TO BE 5/8", SEE GENERAL NOTES FOR MORE INFO -TYP.
 - TRUSS MANUFACTURER TO CARRY ADDITIONAL TOP CHORD DEAD LOAD OF 7.5 PSF FOR FUTURE SOLAR -TYP

FRAMING PLAN SYMBOLS KEY	
□	WOOD POST
○	STEEL COLUMN
(X)	NUMBER OF WOOD STUDS IN POST BELOW
A	COLUMN ABOVE THIS LEVEL
B	COLUMN BELOW THIS LEVEL
C	COLUMN CONTINUOUS THROUGH THIS LEVEL
←	JOIST BEARING
→	CONTINUOUS JOIST WITH INTERMEDIATE BEARING
⊥	FLUSH FRAMED JOIST BEARING WITH HANGER
⊥	WOOD STUD BEARING WALL BELOW
▬	SHEAR WALL
"X" T	NUMBER OF TRIM STUDS UNDER HEADER
"X" K	NUMBER OF KING STUDS ADJACENT TO HEADER

BEAM LEGEND	
---	DROPPED BEAM
---	FLUSH BEAM

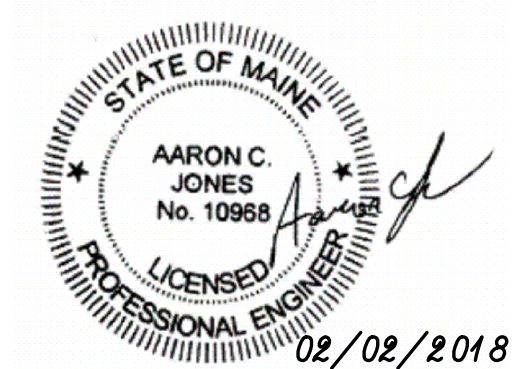

Structural Integrity
 Consulting Engineers, Inc.
 46 Forest Ave
 Portland, ME, 04101
 p. 207-774-6644
 f. 866-793-7835
 www.structuralintegrity.com
 BUILD WITH CONFIDENCE
 © 2013 Structural Integrity Consulting Engineers, Inc.
 SI # 17-0127