COVE STREET

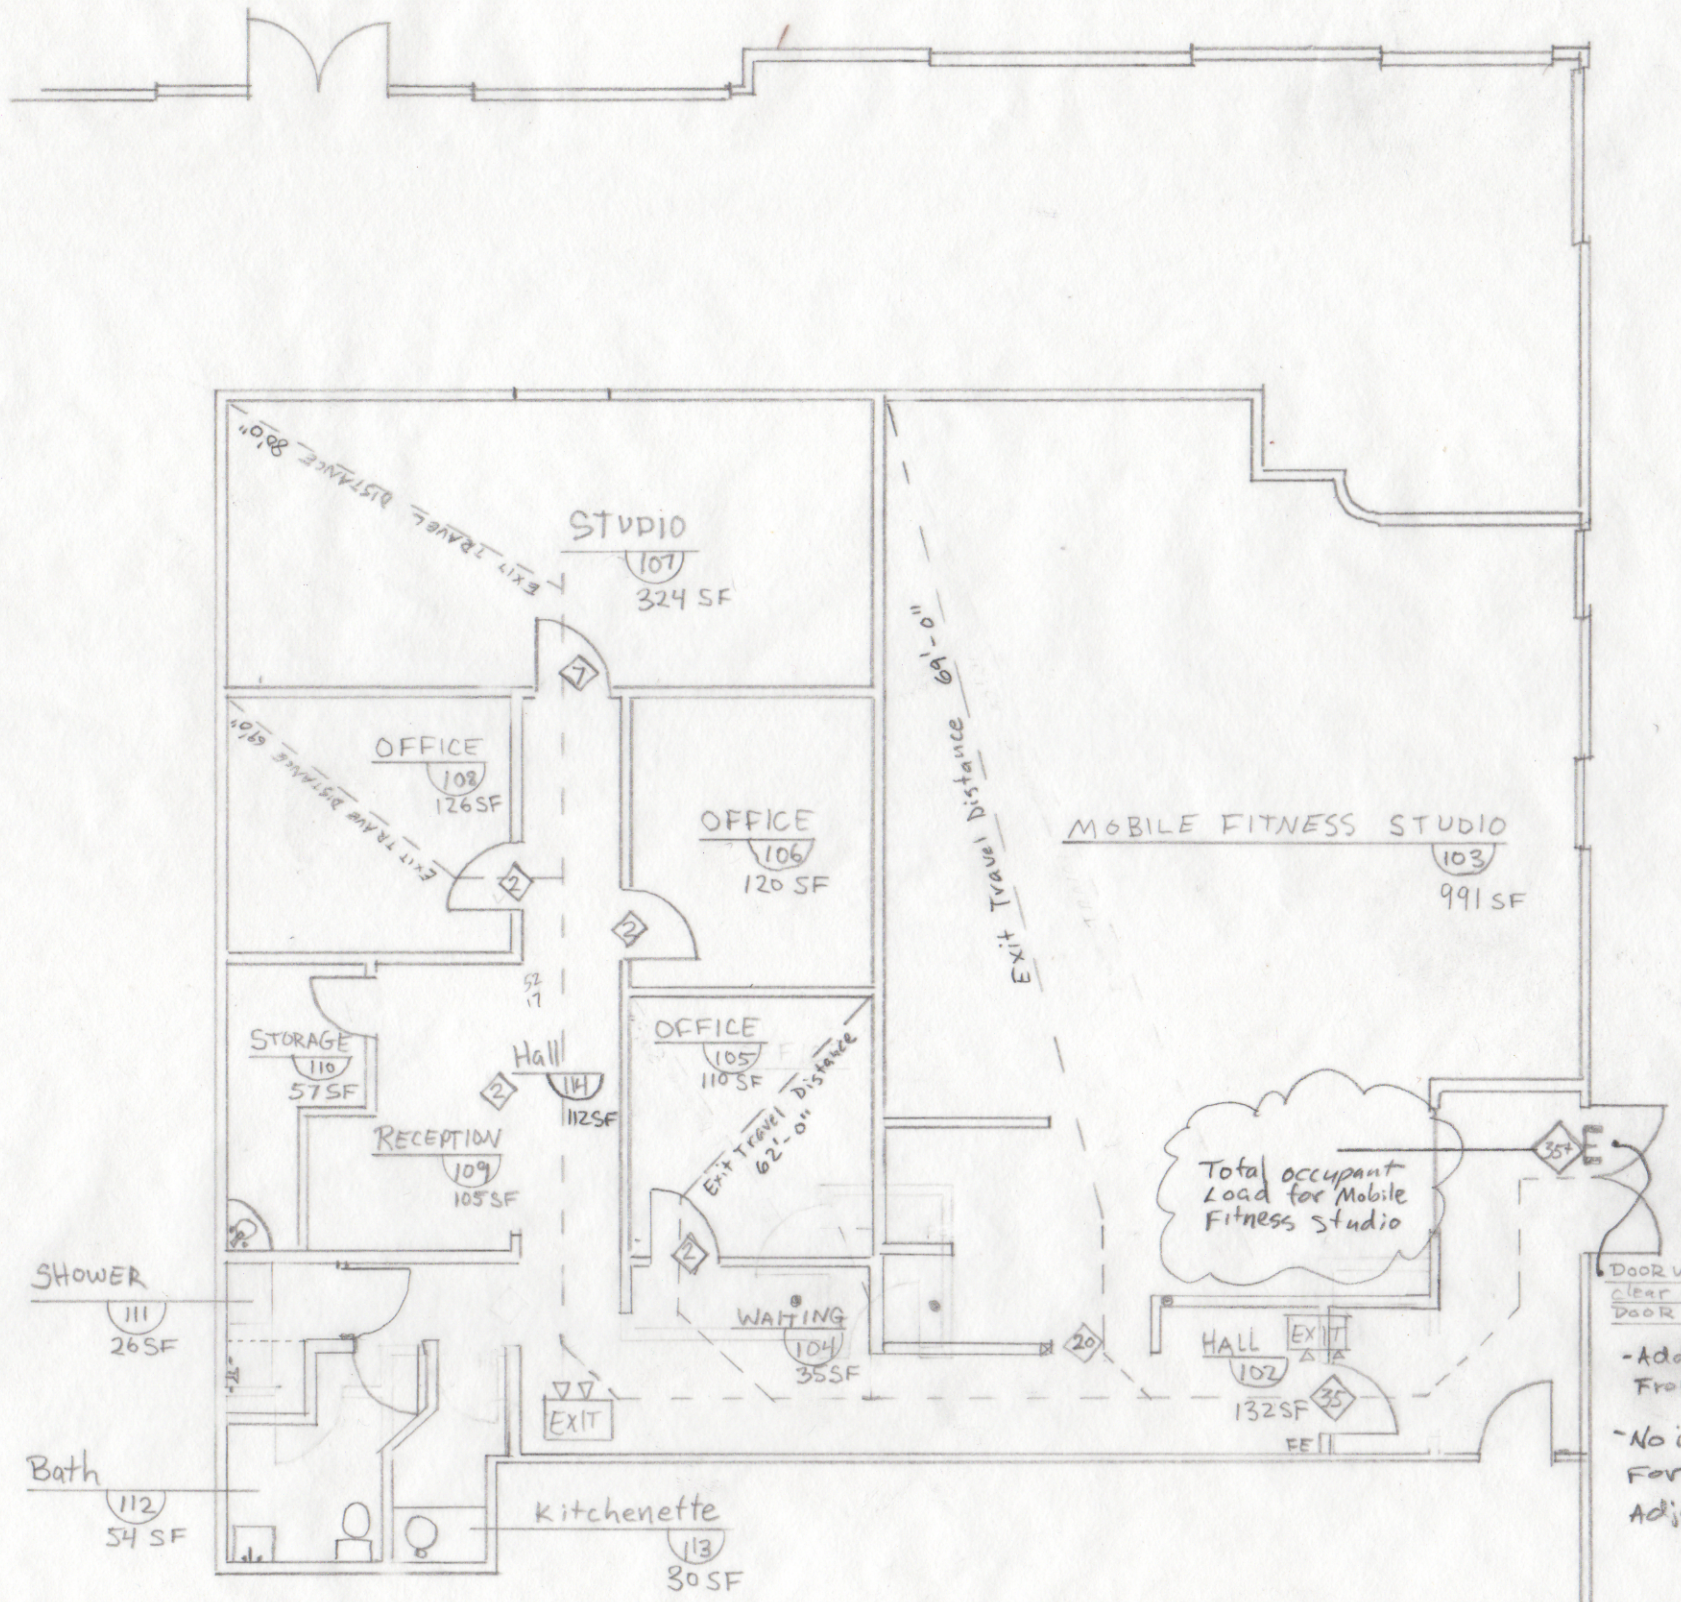

LIFE SAFETY KEY

- 4 — AREA OCCUPANT LOAD (# People)
- 38 — Primary Exit Area Total Load
- Sprinkler (existing)
- FE — FIRE extinguisher
- S — Smoke detector
- EXIT — Exit Sign/ Emergency Light

NOTES:

1 - Fire Protection Provided By
Protection 1
10 Manuel Drive
Portland, ME 04103
ph. (207) 772-1171
Liscence # MC60018702

2 - Exit/Emergency Lights to Be Connected to General Hall Lighting

3 - Fire Extinguisher to be 2A 10BC or greater Inspected Annually.

4 - Total Square Footage
Mobile Fitness - 2222 SF

5 - Occupant Loading 1 S.F
Studio - 1person/ 50S.F
office - 1person/ 100 S.F

6 Total occupant load for Mobile Fitness Training Center: 35 occupants

7 Annual Inspection of Fire Systems by Protection 1.

& Meets NFPA 101 2009

- Add Cumulative From Adjacent Unit
- No information Available For Area Load in Adjacent Area.

Project OWNER
JTE
INVESTMENTS
16 SLED RUN RD.
N. YARMOUTH, ME

General Contractor
GREEN LEAF
CONSTRUCTION
320 Penney Road
New Gloucester ME

MOBILE FITNESS
PERSONAL TRAINING CENTER
50 COVE STREET

Drawings
BENJAMIN WENTLING
207 632 8827

13 MAY 2013

LIFE SAFETY PLAN

A4.0

1 LIFE SAFETY PLAN