


TYPICAL SERVICE CONNECTION N.T.S.

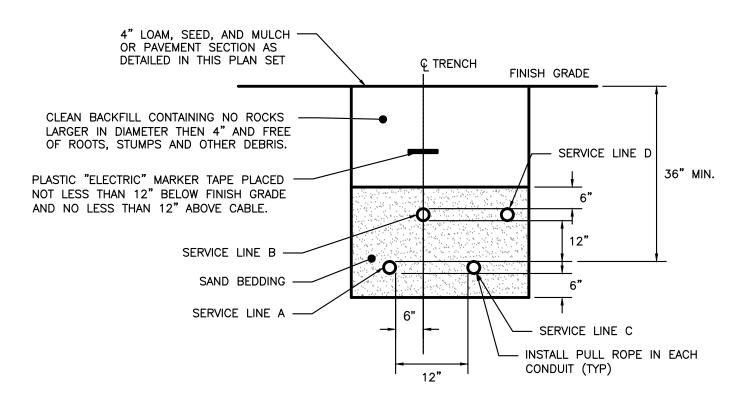

CONDUIT TYPE					
SERVICE	CONDUIT SIZE	GRASS AND PAVED AREAS	UTILITY	<u>REMARKS</u>	
Α	2-5"	SCHEDULE 40 PVC ELECTRICAL GRADE	PRIMARY POWER	SEE NOTE 1	
В	2-4"	SCHEDULE 40 PVC	COMMUNICATION	-	
С	2-4"	SCHEDULE 40 PVC ELECTRICAL GRADE	SPARE	IF REQUIRED	
D	2-4"	SCHEDULE 40 PVC	CABLE	_	

## NOT


1. ONE CONDUIT CAPPED FOR SPARE, PROVIDE GALVANIZED STEEL LONG SWEEP AT RISER POLE AND EXTEND GALVANIZED CONDUIT TO 10" ABOVE GRADE AT POLE WITH STAND—OFF BRACKETS.


2. MINIMUM SEPARATION OF 24 INCHES BETWEEN PRIMARY CABLE/CONDUIT AND GAS LINES SHALL BE MAINTAINED.


UTILITY TRENCH — PRIMARY AND SECONDARY

POWER, TELEPHONE, AND CABLE

NOT TO SCALE

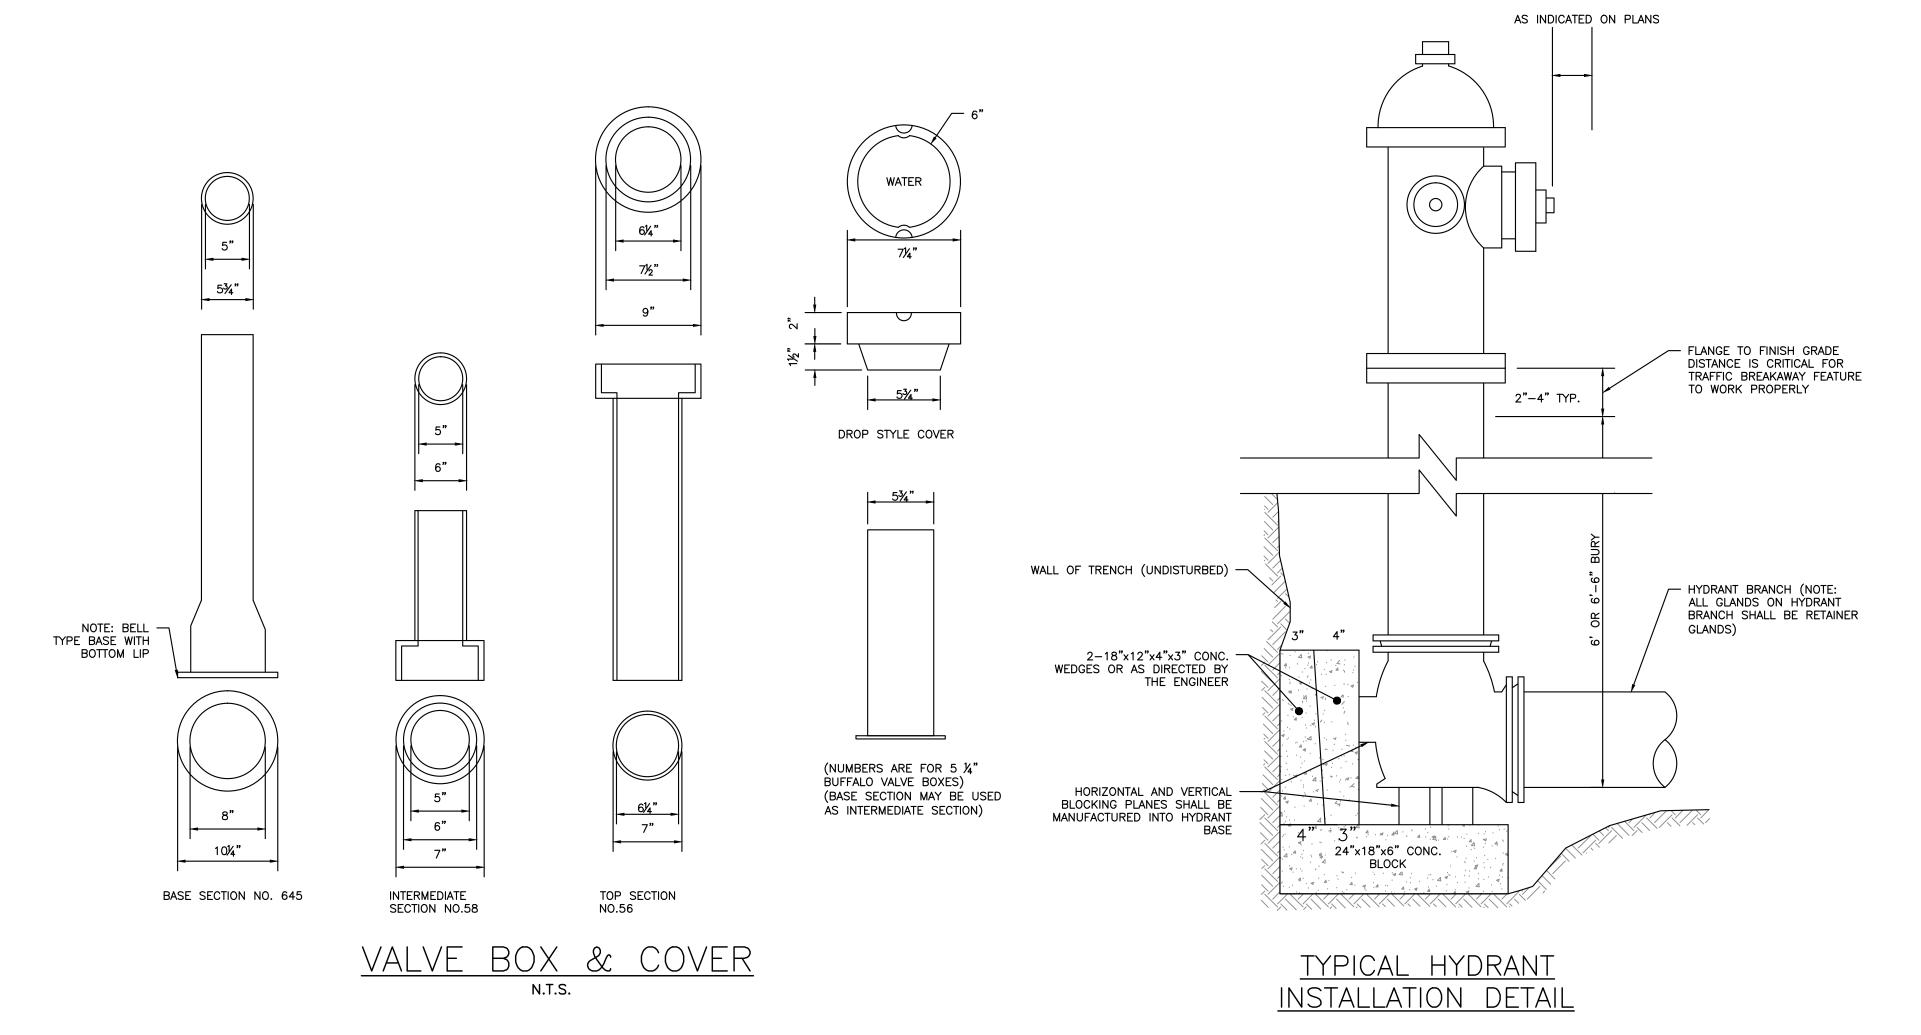

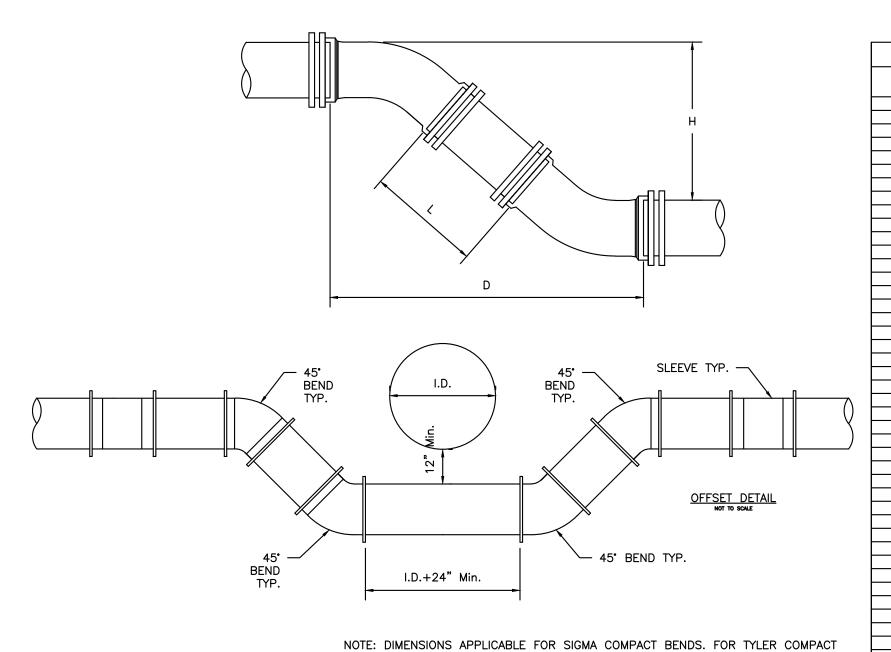

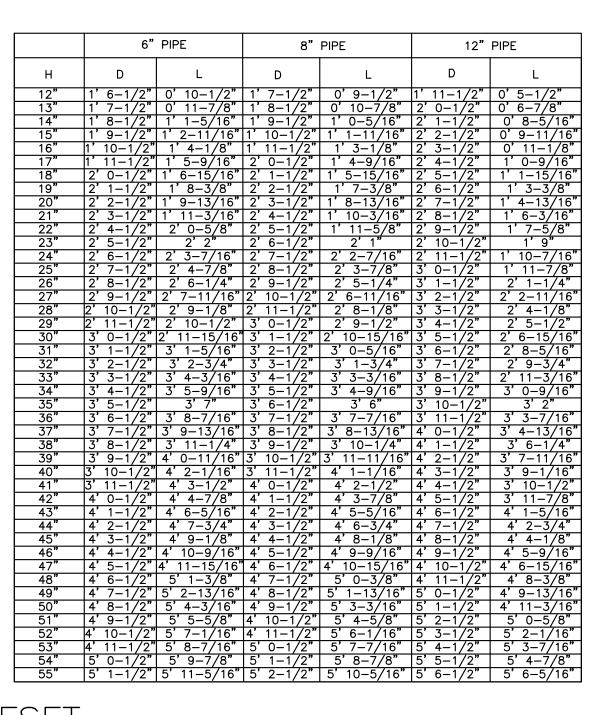

TYPICAL MAIN OFFSET

BENDS, ADD 1/2" TO "D" DIMENSION AND SUBTRACT 1/2" FROM "L" DIMENSION.

FOR OTHER FITTINGS REFER TO MANUFACTURER'S RECOMMENDATIONS.

NOT TO SCALE

PERMIT DRAWINGS NOT FOR CONSTRUCTION

MAINE D	12/1	
REV. STAND	SION DARD DETAIL	RE DA WI 12/4 WI 12/6
DRAWING NAME:  PORTLAND WATER DISTRICT DETAILS - 1	ROJECT NAME:  MUNJOY HEIGHTS	CLIENT: REDFERN MUNJOY, LLC.
FILE: 12		ACORN ENGINEERING, INC.  THIS PLAN SHALL NOT BE MODIFIED WITHOUT WRITTEN PERMISSION FROM
DATE: JN: SCALE: DESIGN DRAWN CHECKE	7/11/ 302-0 NTS BY: \( \text{BY:} \) \( \text{Z} \) \( \text{D} \) \( \text{BY:} \)	VHS RJ WHS

DRAWING NO.

ISSUED FOR CITY SUBMISSION FINAL SUBMISSION