

© 2015 RYAN SENATORE ARCHITECTURE

APARTMENTS
89 ANDERSON STREET
PORTLAND, MAINE



RYAN SENATORE ARCHITECTURE
565 CONGRESS STREET
PORTLAND, MAINE 04101
207-450-6414
senatorearchitecture.com

CONSULTANTS:

STRUCTURAL:
Structural Integrity
77 Oak Street
Portland, ME 04101
207-774-4614

REVISIONS:

DATE: JULY 3, 2015

PROJECT No. 1415

DRAWN BY: RRT / RJS


CHECKED BY: RJS

SCALE: AS NOTED


SHEET TITLE:

WINDOW SCHEDULE


A7-1

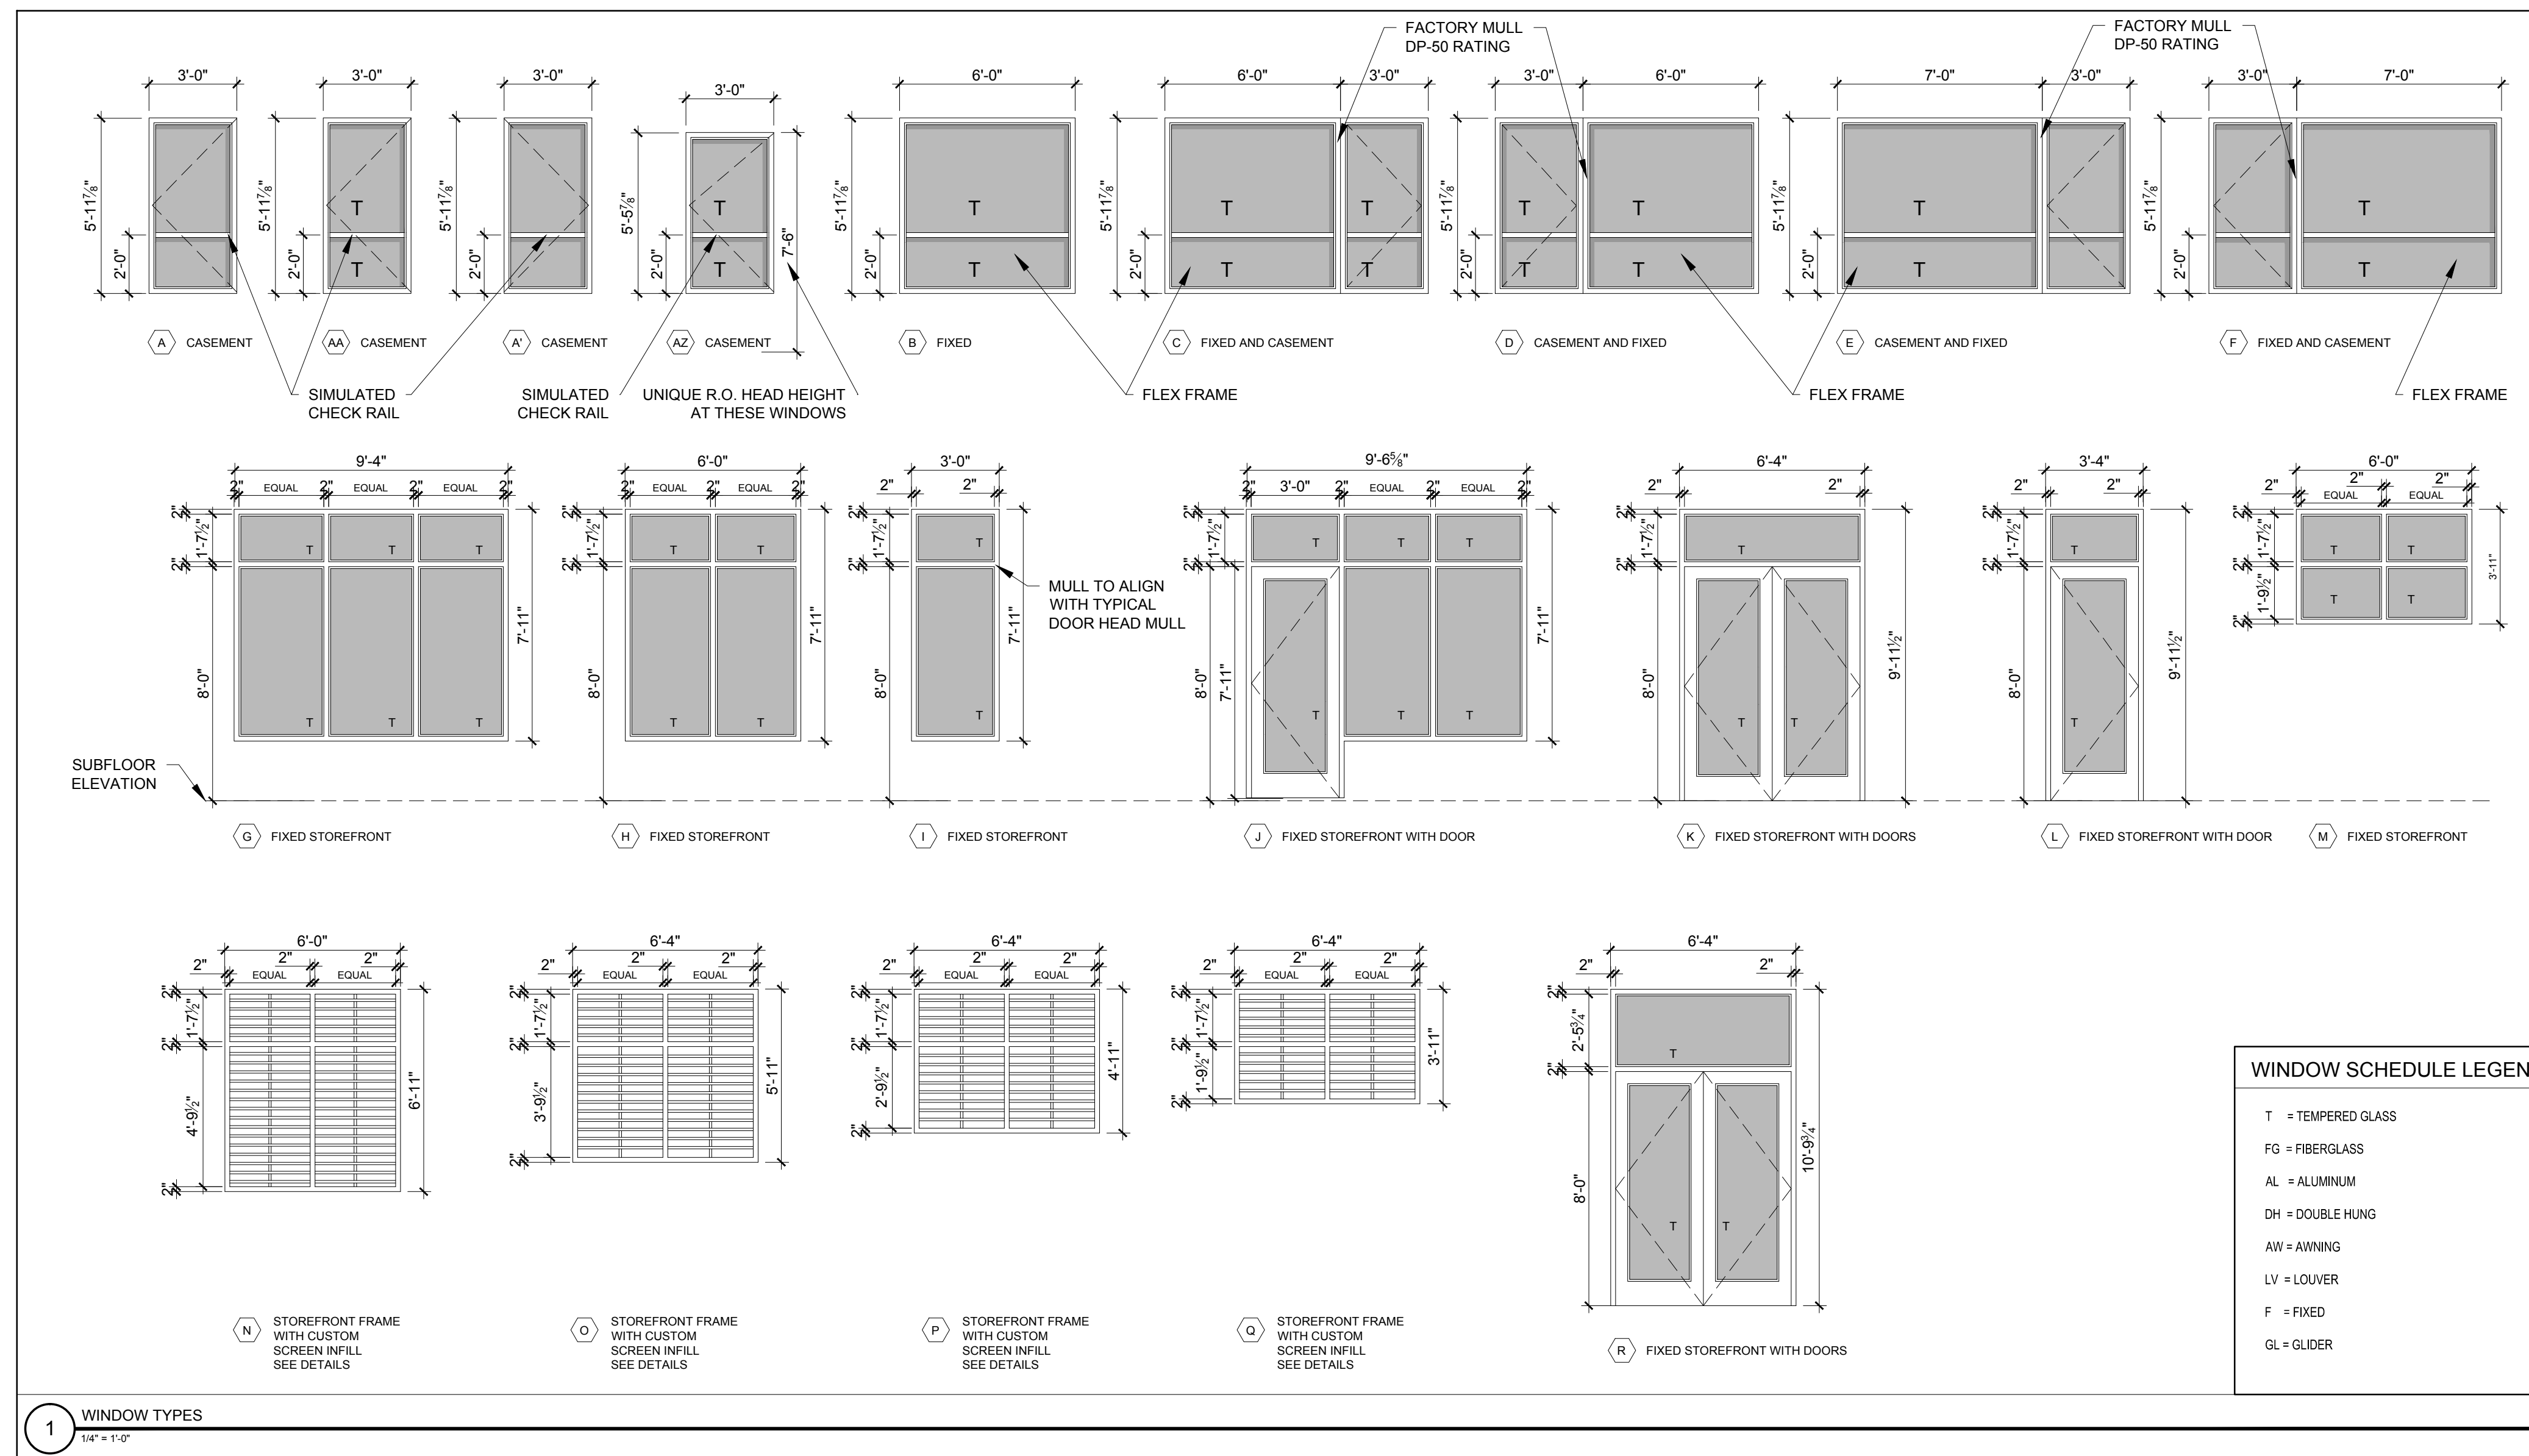

| KEY | ACTION | ROUGH OPENING (WxH) VIF | R.O. HEAD HEIGHT FROM SUB FLOOR | DETAILS | | | MATERIAL | FINISH | REMARKS |
|-----|--------|-------------------------|---------------------------------|---------|------|------|----------|--|---------|
| | | | | HEAD | JAMB | SILL | | | |
| A | C | 3'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER | |
| AA | C | 3'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, TEMPERED GLASS | |
| A' | C | 3'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER | |
| AZ | C | 3'-0" X 5'-6" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, TEMPERED GLASS, UNIQUE R.O. HEAD HEIGHT | |
| B | CF | 6'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, TEMPERED | |
| C | CF | 9'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, FACTORY REINFORCED MULL WITH INSTALLATION BRACKETS, TEMPERED GLASS | |
| D | CF | 9'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, FACTORY REINFORCED MULL WITH INSTALLATION BRACKETS, TEMPERED GLASS | |
| E | CF | 10'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, FACTORY REINFORCED MULL WITH INSTALLATION BRACKETS, TEMPERED | |
| F | CF | 10'-0" X 6'-0" | - | - | - | VLWD | - | NAILING FLANGE, 2-1/4" SIMULATED CHECK RAIL, 4" SASH LIMITER, FACTORY REINFORCED MULL WITH INSTALLATION BRACKETS, TEMPERED | |
| G | F | 9'-4-1/2" X 7'-11-1/2" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| H | F | 6'-0-1/2" X 7'-11-1/2" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| I | F | 3'-0-1/2" X 7'-11-1/2" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| J | F | 9'-6-7/8" X 10'-0" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| K | F | 6'-4-1/2" X 10'-0" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| L | F | 3'-4-1/2" X 10'-0" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |
| M | F | 6'-0-1/2" X 3'-11-1/2" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS, TRANSLUCENT FILM ON INSIDE OF WINDOW | |
| N | F | 6'-0-1/2" X 7'-11-1/2" | - | - | - | AL | - | STOREFRONT UNIT, GLAZING TO INSIDE, CUSTOM FABRICATED SCREEN INSERTED INTO STOREFRONT FRAME, SEE DETAILS | |
| O | F | 6'-4-1/2" X 5'-11-1/2" | - | - | - | AL | - | STOREFRONT UNIT, GLAZING TO INSIDE, CUSTOM FABRICATED SCREEN INSERTED INTO STOREFRONT FRAME, SEE DETAILS | |
| P | F | 6'-4-1/2" X 4'-11-1/2" | - | - | - | AL | - | STOREFRONT UNIT, GLAZING TO INSIDE, CUSTOM FABRICATED SCREEN INSERTED INTO STOREFRONT FRAME, SEE DETAILS | |
| Q | F | 6'-4-1/2" X 3'-11-1/2" | - | - | - | AL | - | STOREFRONT UNIT, GLAZING TO INSIDE, CUSTOM FABRICATED SCREEN INSERTED INTO STOREFRONT FRAME, SEE DETAILS | |
| R | F | 6'-4-1/2" X 10'-10-1/4" | - | - | - | AL | - | THERMALLY BROKEN STOREFRONT, INSULATED, TEMPERED GLAZING UNITS | |

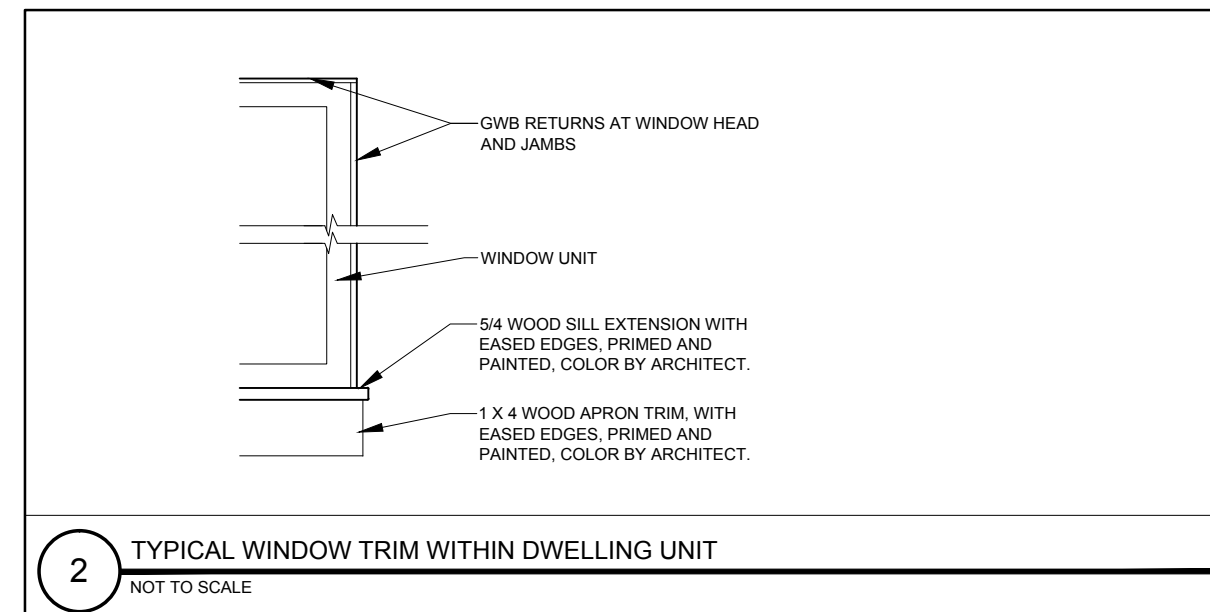

- WINDOW NOTES:**
- COORDINATE AND ADJUST ROUGH OPENING DIMENSIONS TO ACCOMMODATE SILL PAN FLASHING SYSTEM
 - ALL WINDOW UNITS AND MULTI-WINDOW UNIT COMBINATIONS TO MEET OR EXCEED DP-50 RATINGS FOR BOTH STRUCTURAL AND WATER
 - PROVIDE MULL REINFORCING AT ALL MULTI-UNIT WINDOWS AS REQUIRED TO ACHIEVE DP-50 RATING, WITH INSTALLATION BRACKETS
 - FULL SCREENS ALL OPENINGS
 - CONTRACTOR TO VERIFY THAT ALL EGRESS OPENINGS MEET EGRESS REQUIREMENTS
 - ALL GLAZING LOCATED WITHIN 18" OF FINISHED FLOOR TO BE TEMPERED GLASS
 - ALL EXTERIOR GLAZING TO BE INSULATED
 - FRAME ALL OPENINGS WITH ELEVATIONS
 - SEAL WINDOW TO ROUGH OPENING WITH LOW EXPANDING FOAMINSULATION - SEE DETAILS

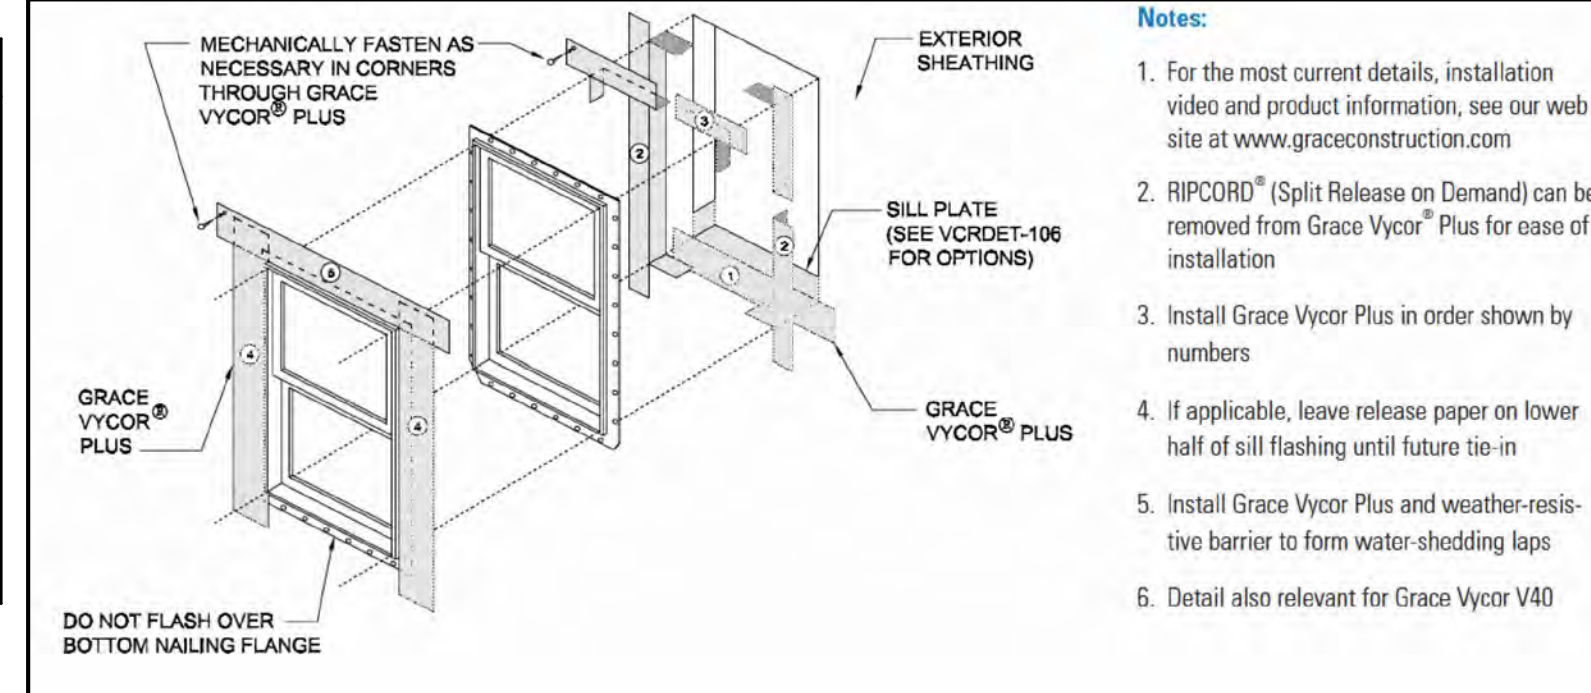

GENERAL CONTRACTOR TO CONFIRM WITH WINDOW MANUFACTURERS STANDARD INSTALLATION INSTRUCTIONS