
















































LEGEND

                                     	<p>BODINE EMG. BALLASTED NIGHT LIGHT FIXTURE</p> <p>2X4 LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE)</p> <p>1X4 LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE, DIAGONAL LINE DENOTES NIGHT LIGHT)</p> <p>DOWN LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE)</p> <p>SINGLE POLE SWITCH – MOUNTED 48” AFF TO TOP</p> <p>THREE WAY SWITCH – MOUNTED 48” AFF TO TOP</p> <p>FOUR WAY SWITCH – MOUNTED 48” AFF TO TOP</p> <p>MOTION SENSING SWITCH</p> <p>UNIT EXHAUST FAN SWITCH</p> <p>SPECIALTY OUTLET</p> <p>GFI RECEPTACLE SUBSCRIPT IS FOR COUNTER HEIGHT OR WP FOR WEATHER PROOF</p> <p>DUPLEX CONVENIENCE OUTLET 18” AFF TO CENTER EXCEPT AS NOTED</p> <p>DOUBLE DUPLEX CONVENIENCE OUTLET 18” AFF TO CENTER EXCEPT AS NOTED</p> <p>JUNCTION BOX - SIZED AS REQUIRED</p> <p>DISCONNECT SWITCH - FUSED AS REQUIRED (DIAGONAL LINE INDICATES FUSED)</p> <p>ELECTRIC MOTOR CONTROLLER</p> <p>EXIT LIGHT ATLITE #PNLRU W/LED LAMPS BATTERY BACKUP</p> <p>EBU - EMERGENCY LIGHT BATTERY UNIT. 120V VOLT AC. BATTERIES TO BE RATED FOR 90 MINUTES FOR CONNECTED LOAD.</p> <p>TEL/DATA RECEPTACLES (HALF SHADED DENOTES TELEPHONE AND DATA, CLEAR TELEPHONE ONLY, SOLID DENOTES DATA ONLY)</p> <p>POWER FLOOR BOX</p> <p>CEILING MOTION SENSOR</p> <p>RELAY</p> <p>ADA DOORBELL STROBE</p> <p>ADA DOORBELL</p> <p>AREA OF RESCUE</p> <p>GROUND FAULT INTERRUPTER /W SURGE SUPPRESSOR</p> <p>ELECTRIC WATER COOLER</p> <p>EXHAUST FAN</p> <p>WEATHERPROOF</p> <p>PARTIAL CIRCUIT</p> <p>FURNISHED BY OTHERS</p> <p>COUNTER HEIGHT (SEE MILLWORK DRAWINGS FOR HEIGHT)</p> <p>HOSPITAL GRADE W/RED FACE AND PLATE. IF GFI, DEVICE TO HAVE SURGE SUPPRESSOR</p> <p>ISOLATED GROUND OUTLET /W SURGE SUPPRESSOR. ORANGE FACE AND PLATE</p> <p>MANUAL THERMAL OVERLOAD SWITCH</p> <p>BUSS DUCT</p> <p>DRY TYPE TRANSFORMER</p>
--	---

FIRE ALARM SYSTEM

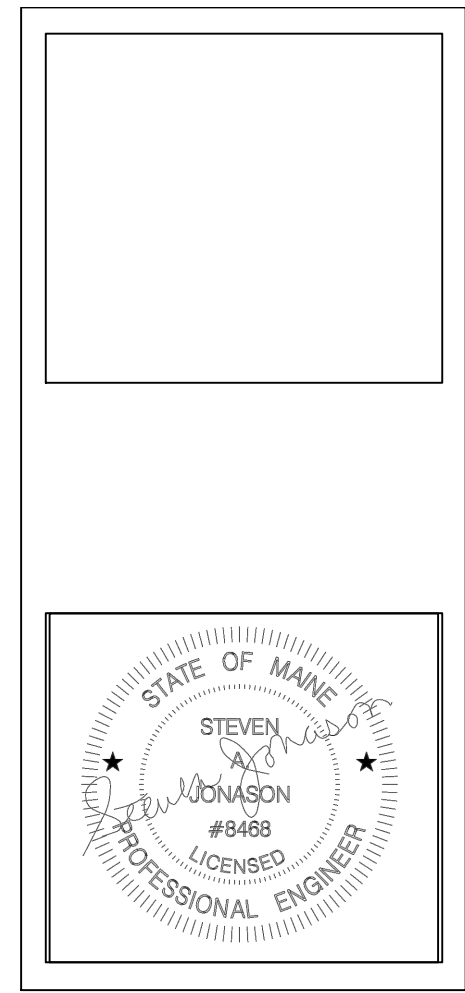
        	<p>FIRE ALARM MANUAL STATION 48” AFF</p> <p>FIRE ALARM HORN AND LIGHT UNIT - MOUNT 80” AFF EXCEPT NO CLOSER THAN 6” TO CEILING. NUMBER DENOTES CANDELA RATING</p> <p>SPRINKLER TAMPER SWITCH</p> <p>SPRINKLER WATERFLOW SWITCH</p> <p>FIRE ALARM VISUAL UNIT (NUMBER DENOTES CANDELA RATING) 6’8” AFF</p> <p>FIRE ALARM SMOKE DETECTOR “E” SUBSCRIPT DENOTES ELEVATOR RECALL.</p> <p>FIRE ALARM SMOKE/CO COMBINATION DETECTOR</p> <p>FIRE ALARM ANNUNCIATOR</p> <p>FIRE ALARM CONTROL PANEL</p>
---	---

GENERAL NOTES:

- 1) ALL BRANCH CIRCUITS TO BE TYPE MC CABLE.
- 2) ALL ELECTRICAL MUST MEET NEC AND LOCAL CODES.
- 3) TELEPHONE AND DATA WIRING BY OTHERS
- 4) TEMPERATURE CONTROL WIRING BY OTHERS

DRAWINGS

E100-1ST FLOOR/ SITE
E200-SAMPLE UNIT
E201- UNIT LAYOUT - SECTION A
E202 - UNIT LAYOUT - SECTION B
E203 - UNIT LAYOUT - SECTION C
E204 - UNIT LAYOUT - UNIQUE UNITS
E205 - ROOFTOP POWER
E300 - ONE LINE/SCHEDULES



B.H. Milliken
ELECTRICAL CONTRACTORS

175 ANDERSON STREET
PORTLAND, MAINE 04101
207.879.1877

89 ANDERSON STREET

89 ANDERSON STREET
PORTLAND, MAINE

TITLE:

LEGEND

SCALE: -

DATE: 07.03.15

SHEET:

E100