


FAN#1 - EXHAUST PERFORMANCE CURVES.

800 CFM, 0.35 SP @ 1270 RPM and 0.139 BHP at 108 feet and 70 deg F
 * Please note that these curves were adjusted for Job specific temperature and altitude.

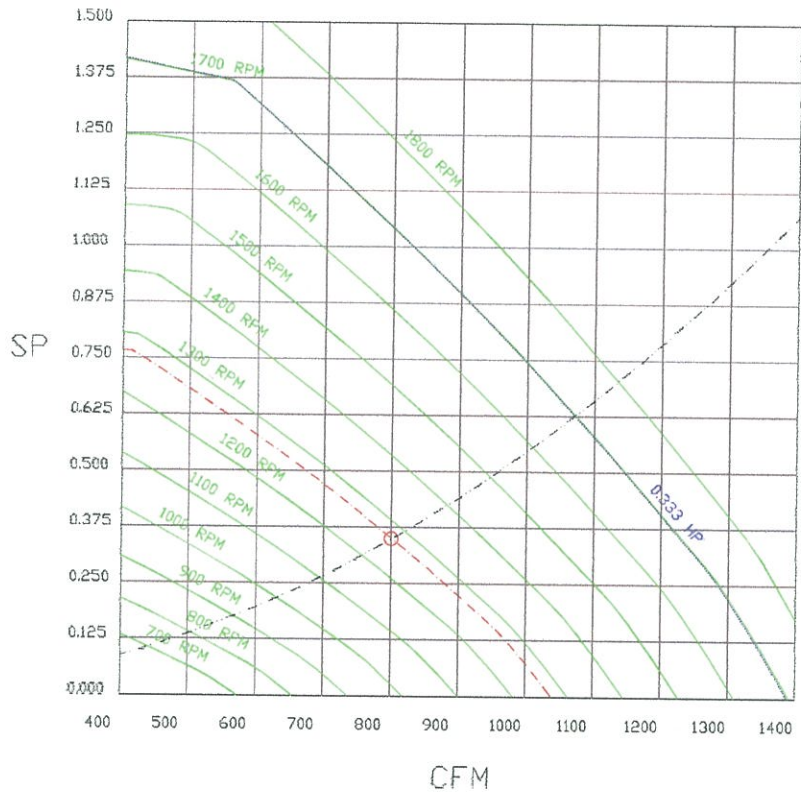

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted
 Approved with NO Exception Taken
 Revise and Resubmit
 SIGNATURE _____
 Your Title _____ Date _____



CAPTIVEAIRE

JOB A&C Grocer	
LOCATION Biddeford, ME,	
DATE 3/9/2017	JOB # 2905587
DWG # A	DRAWN BY BFC-21
REV.	SCALE 3/8" = 1'-0"