

**GENERAL NOTES:**

- EXISTING DIMENSIONS AND CONDITIONS ARE FOR REFERENCE ONLY. CONTRACTOR SHALL VERIFY ALL EXISTING CONSTRUCTION AND DIMENSIONS IN THE FIELD PRIOR TO CONSTRUCTION OR FABRICATION. ALL DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER PRIOR TO COMMENCING WORK.
- THE CONTRACTOR SHALL NOTIFY THE ENGINEER IF DEVIATIONS OR CHANGES ARE REQUIRED TO THE CONTRACT DOCUMENTS OR APPROVED SHOP DRAWINGS DUE TO INTERFERENCES, FABRICATION ERRORS, OR OTHER CAUSES.
- THE STRUCTURE IS SELF-SUPPORTING AND STABLE AFTER THE ENTIRE BUILDING IS COMPLETELY CONSTRUCTED. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR ERECTION PROCEDURES AND SEQUENCING DURING CONSTRUCTION AND ERECTION TO PROVIDE AND ENSURE LOCAL AND OVERALL STABILITY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION AND ERECTION. THE CONTRACTOR SHALL RETAIN A LICENSED STRUCTURAL ENGINEER TO DESIGN TEMPORARY BRACING/SHORING AND DETERMINE WHERE THE TEMPORARY BRACING/SHORING IS NEEDED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ERECTION PROCEDURES, SEQUENCING AND FOR COMPLYING WITH ALL APPLICABLE SAFETY REGULATIONS DURING THE WORK.

**DESIGN CRITERIA:**

- BUILDING CODES:  
INTERNATIONAL BUILDING CODE (IBC), 2009 EDITION  
ASCE 7-05 MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES  
MAINE UNIFORM BUILDING AND ENERGY CODE
- LIVE LOADS:  
SECOND FLOOR DECK = 40 PSF

**FOUNDATION NOTES:**

- FOUNDATIONS HAVE BEEN DESIGNED USING A PRESUMED ALLOWABLE BEARING PRESSURE PER TABLE 1806.2 OF THE INTERNATIONAL BUILDING CODE BASED ON TYPICAL SOILS FOUND IN THIS AREA. IF CLAY, MUD, ORGANIC SILT, PEAT OR UNPREPARED FILL IS FOUND DURING CONSTRUCTION, NOTIFY ENGINEER IMMEDIATELY, AS THE ALLOWABLE LOADS USED IN DESIGN WILL NEED TO BE VERIFIED BY A GEOTECHNICAL ENGINEER. CASCO BAY ENGINEERING RECOMMENDS PROCURING A GEOTECHNICAL ENGINEER TO VERIFY EXISTING SOIL CONDITIONS.
- ALLOWABLE SOIL BEARING CAPACITY USED IN DESIGN = 2,000 PSF
- MINIMUM FROST DEPTH COVER = 4'-0" FOR EXTERIOR FOOTINGS BELOW FINAL EXTERIOR GRADE.
- EXCAVATION, BACKFILL, COMPACTION, GRADATION REQUIREMENTS, FOUNDATION DRAINAGE AND PERMANENT DEWATERING REQUIREMENTS SHALL BE PROVIDED BY A GEOTECHNICAL ENGINEER.
- FOUNDATIONS SHALL BEAR ON UNDISTURBED NATIVE SOIL, UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL NOTIFY THE GEOTECHNICAL AND STRUCTURAL ENGINEER IF ANY UNSUITABLE SOILS ARE ENCOUNTERED PRIOR TO PLACING FOUNDATIONS.
- PROTECT FOUNDATIONS FROM FROST AND KEEP BOTTOM OF TRENCH DRY DURING CONSTRUCTION. IF GROUNDWATER IS ENCOUNTERED NEAR OR ABOVE THE BASE OF THE FOOTINGS, EXCAVATIONS SHALL BE DEWATERED DURING CONSTRUCTION. SURFACE WATER SHALL BE DIVERTED AWAY FROM EXCAVATIONS.
- DO NOT UNDERMINE EXISTING FOUNDATIONS OF ADJACENT STRUCTURES. CONTRACTOR SHALL BE RESPONSIBLE FOR THE SHORING, BRACING AND UNDERPINNING OF EXISTING STRUCTURES DURING EXCAVATION, BACKFILLING, AND CONSTRUCTION. CONTRACTOR SHALL SLOPE EXCAVATIONS TO ACHIEVE SOIL STABILITY.

**CONCRETE NOTES:**

- ALL WORK SHALL CONFORM TO IBC 2009 REFERENCED EDITIONS OF "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" (ACI 318) AND "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" (ACI 301).
- REQUIRED CONCRETE PARAMETERS ARE AS FOLLOWS:

LOCATION	MAX W/C RATIO	f <sub>c</sub>	AIR-ENTRAINMENT
FOUNDATIONS, FOOTINGS, & FOUNDATION WALLS	.45	4,500 PSI	6% ± 1%

WHERE: W/C = WATER TO CEMENT RATIO AND  
f<sub>c</sub> = COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS

USE PORTLAND CEMENT TYPE II, IN CONFORMANCE WITH ASTM 150  
AIR ENTRAINING ADMIXTURES SHALL CONFORM TO ASTM C 260  
ADMIXTURES SHALL CONFORM TO ASTM C 494  
FLY ASH USED AS ADMIXTURES SHALL CONFORM TO ASTM C 618

- MAXIMUM AGGREGATE SIZE SHALL BE 3/4", IN CONFORMANCE WITH ASTM C33.
- CALCIUM CHLORIDE OR ADMIXTURES CONTAINING CALCIUM CHLORIDE IS NOT PERMITTED.
- MAXIMUM SLUMP AFTER THE ADDITION OF A WATER-REDUCING ADMIXTURE IS 6 INCHES.
- CONTRACTOR SHALL NOT PLACE CONCRETE ON FROZEN GROUND OR IN WATER. ADEQUATE EQUIPMENT SHALL BE PROVIDED FOR HEATING CONCRETE MATERIALS AND PROTECTING CONCRETE DURING NEAR-FREEZING OR FREEZING WEATHER. REFERENCE ACI 306, AS NOTED ABOVE, FOR RECOMMENDATIONS FOR COLD WEATHER CONCRETING.
- ANCHOR BOLTS SHALL BE HEADED RODS AND CONFORM TO ASTM F1554, GRADE 36 KSI WELDABLE STEEL, U.N.O. ON DRAWINGS. PROVIDE GALVANIZED ANCHOR BOLTS WHERE IN CONTACT WITH PRESSURE TREATED LUMBER.

**WOOD NOTES:**


- ALL TIMBER FRAMING SHALL BE IN ACCORDANCE WITH IBC 2009 REFERENCED EDITIONS OF THE AITC TIMBER CONSTRUCTION MANUAL AND AF&PA NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION (NDS).
- ALL FRAMING SHALL BE SPRUCE-PINE-FIR, No.2 OR BETTER U.N.O. AND HAVE A MAXIMUM MOISTURE CONTENT OF 19%.
- ALL WOOD IN CONTACT WITH MASONRY OR CONCRETE OR EXPOSED TO WEATHER SHALL BE PRESSURE TREATED (PT) SOUTHERN YELLOW PINE.
- WHERE "LVL" IS NOTED ON DRAWINGS, PROVIDE LAMINATED VENEER LUMBER, WHICH HAS THE FOLLOWING MINIMUM ALLOWABLE STRESSES:  
  

F <sub>b</sub> = 2600 PSI	F <sub>c</sub> = 2510 PSI (PARALLEL TO GRAIN)
F <sub>v</sub> = 285 PSI	F <sub>c</sub> = 750 PSI (PERPENDICULAR TO GRAIN)
E <sub>t</sub> = 1555 PSI	E = 2,000,000 PSI
- ALL ENGINEERED LUMBER THAT IS EXPOSED TO WEATHER SHALL BE WOLMANIZED.
- WHERE BEAMS ARE LABELED ON PLAN, DO NOT SPLICE BEAM NOR ANY PLY OF BEAM BETWEEN SUPPORTS.
- ALL CONNECTION HARDWARE SHALL BE BY SIMPSON STONG-TIE (OR APPROVED EQUIVALENT) AND SHALL BE HOT-DIPPED GALVANIZED. HARDWARE IN CONTACT WITH PRESSURE TREATED (PT) LUMBER SHALL BE GALVANIZED G185 (ZMAX). REFER TO MANUFACTURERS LITERATURE FOR PROPER INSTALLATION GUIDELINES.
- FASTENERS USED IN CONTACT WITH PRESSURE TREATED (PT) LUMBER SHALL BE HOT-DIPPED GALVANIZED, STAINLESS STEEL, OR OTHER FINISH APPROVED BY ENGINEER.
- ALIGN COLUMNS SUCH THAT COLUMNS BEAR CONTINUOUSLY TO FOUNDATION SUPPORT. INSTALL ADDITIONAL SOLID BLOCKING WITHIN FLOOR PACKAGE TO PROVIDE CONTINUITY OF LOAD PATH.

**ABBREVIATION:**

AB	ANCHOR BOLT	L	ANGLE
ABV	ABOVE	LL	DOUBLE ANGLE
ADDL	ADDITIONAL	LB	POUND
ARCH	ARCHITECT	LF	LINEAR FOOT
&	AND	LLH	LONG LEG HORIZONTAL
		LLV	LONG LEG VERTICAL
B/FTG, BOF	BOTTOM OF FOOTING	MAX	MAXIMUM
BLDG	BUILDING	MECH	MECHANICAL
BM	BEAM	MFR	MANUFACTURER
BOT	BOTTOM	MIN	MINIMUM
BRG	BEARING	MISC	MISCELLANEOUS
BTWN	BETWEEN		
C	STRUCTURAL STEEL CHANNEL	NF	NEAR FACE
CANT	CANTILEVER	NO	NUMBER
CIP	CAST-IN-PLACE CONCRETE	NS	NEAR SIDE
CJ	CONTROL JOINT	NTS	NOT TO SCALE
CL	CENTERLINE		
CLR	CLEAR	OC	ON CENTER
CMU	CONCRETE MASONRY UNIT	OF	OUTSIDE FACE
CONJ	CONSTRUCTION JOINT	OPNG	OPENING
COL	COLUMN	OPP	OPPOSITE
CONC	CONCRETE		
CONN	CONNECTION	P	PIER DESIGNATION
CONT	CONTINUOUS	PL	PLATE
CONTR	CONTRACTOR	PP	PARTIAL PENETRATION WELD
CP	COMPLETE PENETRATION WELD	PREFAB	PREFABRICATED
CY	CUBIC YARD	PSF	POUNDS PER SQUARE FOOT
		PSI	POUNDS PER SQUARE INCH
DIA	DIAMETER		
DIM	DIMENSION	REINF	REINFORCING STEEL
DISCONT	DISCONTINUOUS	REQ, REQD	REQUIRED
DWG	DRAWING	RD	ROOF DRAIN
(E), EX, EXIST	EXISTING	SC	SLIP CRITICAL
EA	EACH	SECT	SECTION
EF	EACH FACE	SHEATH	SHEATHING
EL, ELEV	ELEVATION	SIM	SIMILAR
EQ	EQUAL	SO6	SLAB-ON-GRADE
EQUIP	EQUIPMENT	SPAC	SPACING
ES	EACH SIDE	SPECS	SPECIFICATIONS
EW	EACH WAY	SS	STAINLESS STEEL
EXP	EXPANSION	STD	STANDARD
EXT	EXTERIOR	STIFF	STIFFENER
		STL	STEEL
F	FOOTING DESIGNATION	STR	STRAIGHT
FDN	FOUNDATION	STRUCT	STRUCTURAL
FF	FINISH FLOOR		
FLG	FLANGE	T	TOP
FLR	FLOOR	T&B	TOP AND BOTTOM
FT	FOOT	TOC, T/CONC	TOP OF CONCRETE
FTG	FOOTING	T/FTG, TOF	TOP OF FOOTING
FV	FIELD VERIFY	TEMP	TEMPERATURE
		T/SHELF	TOP OF SHELF
G	GAGE	T/SLAB	TOP OF SLAB
GALV	GALVANIZED	T/STL	TOP OF STEEL
		T/WALL	TOP OF WALL
HOR, HORIZ	HORIZONTAL	TS	STRUCTURAL TUBING
HSS	HOLLOW STRUCTURAL SHAPE	TYP	TYPICAL
HT	HEIGHT		
IF	INSIDE FACE	UNO	UNLESS NOTED OTHERWISE
IN	INCH	VER, VERT	VERTICAL
INFO	INFORMATION	VF	VERIFY IN FIELD
JT	JOINT		
		W	STRUCTURAL STEEL WIDE FLANGE
K	KIP (1 KIP = 1,000 LBS)	W/O	WITHOUT
KSI	KIPS PER SQUARE INCH	WP	WORK POINT
		WT	WEIGHT
		WWF	WELDED WIRE FABRIC

PRINTED: Mar 23, 2016

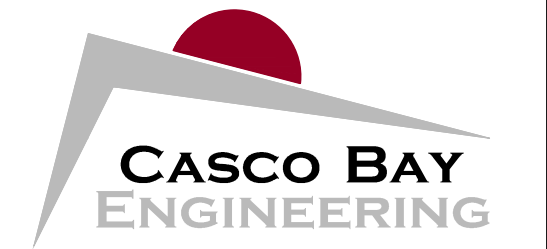


424 Fore Street  
Portland, ME 04101  
Phone 207.842.2800  
Fax 207.842.2828  
www.cascobayengineering.com

CLIENT:

DEIDRE FOGG

17 MARION STREET  
PORTLAND, MAINE 04101

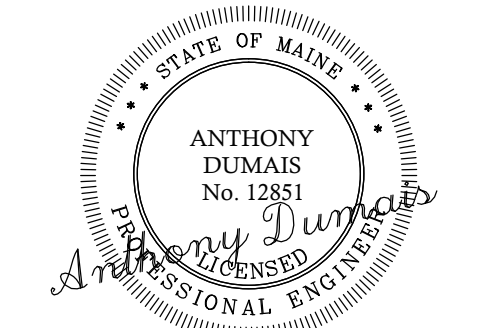

FOGG RESIDENCE  
17 MARION STREET  
PORTLAND, MAINE

DECK RENOVATION

No.	DESCRIPTION	DR.	CHK.	BY	DATE	ISSUED FOR CONSTRUCTION	
						TD	ED
0					2-23-16		

SHEET TITLE:

STRUCTURAL  
NOTES

DESIGNED: TD  
DRAWN: TD  
DATE: 3-22-16  
PROJECT NUMBER: 16-040

S0.0