


Side View Hood

Bourgoin + Sons
Dan
749 1878
danbourgoin@gmail.com

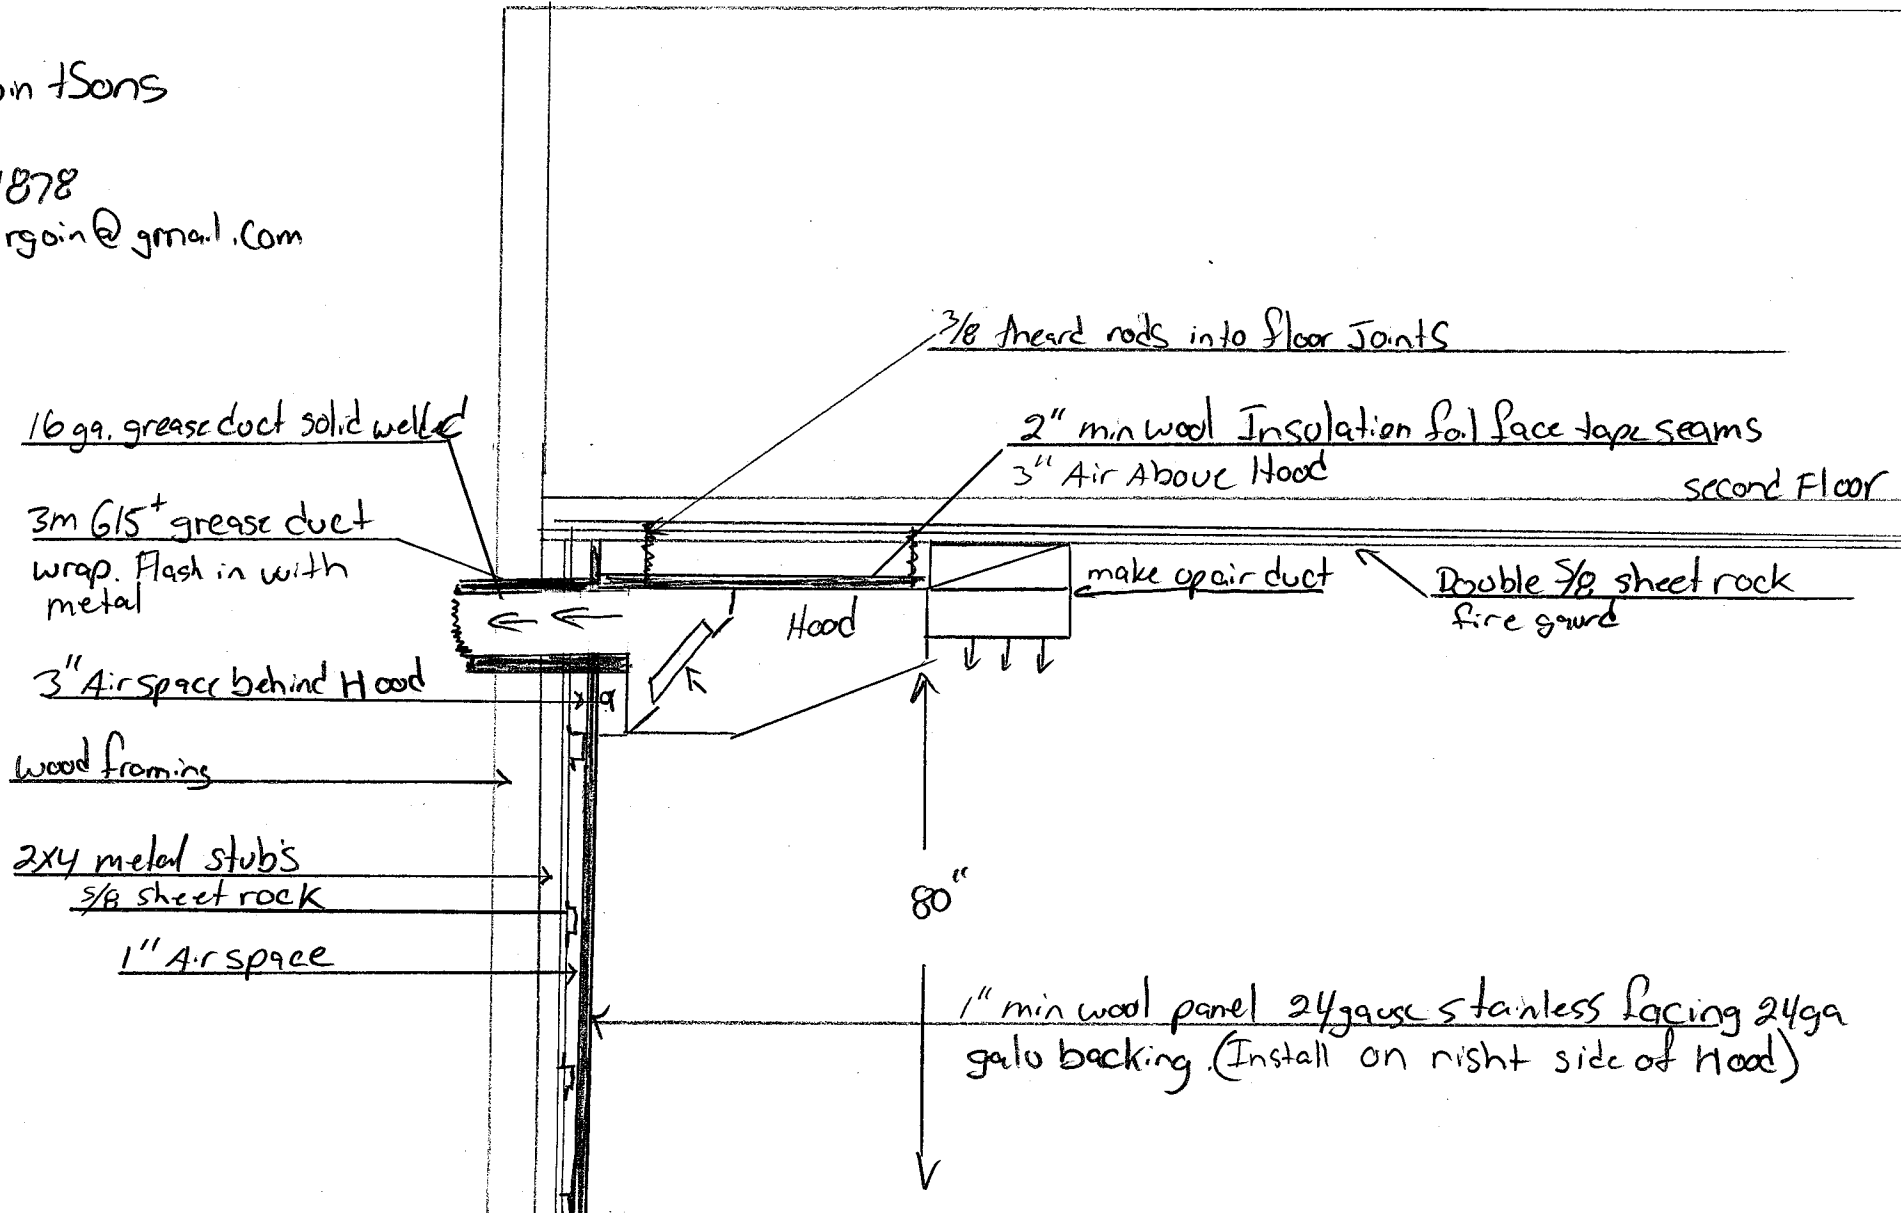

Duct air fans view
[Back of Building]

Front Washington Ave
↑

Hinge kit

Exhaust fan


40"

18"

roof
solid Box

Wall braces welded to duct lag into
Building

Duct wrap in 3m 615⁺ then cover for weather
with 24ga galu steel outer wrap sealed
2" off building to outer wrap



second floor deck


Hood

High temp clean out doors

makeup air fan

14x14 grease duct solid weld
from Hood to fan base.

Wall support brace

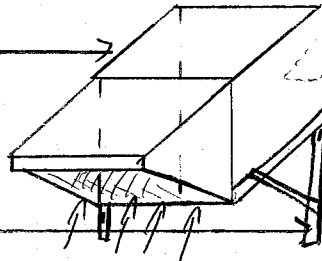

Approx 4'
Alley

grade