

DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK



# CITY OF PORTLAND BUILDING PERMIT

This is to certify that MICHELLE A KELLEY - J & M ENTERPRISES

Located At 38 WASHINGTON AVE

Job ID: 2011-09-2271-CH OF USE

CBL: 013- E-016-001

has permission to Install a Kitchen Hood System Type II provided that the person or persons, firm or corporation accepting this permit shall comply with all of the provisions of the Statues of Maine and of the Ordinances of the City of Portland regulating the construction, maintenance and use of the buildings and structures, and of the application on file in the department.

Notification of inspection and written permission procured before this building or part thereof is lathed or otherwise closed-in. 48 HOUR NOTICE IS REQUIRED.

A final inspection must be completed by owner before this building or part thereof is occupied. If a certificate of occupancy is required, it must be

\_\_\_\_\_  
**Fire Prevention Officer**

*[Signature]* 11/30/11  
\_\_\_\_\_  
**Code Enforcement Officer / Plan Reviewer**

**THIS CARD MUST BE POSTED ON THE STREET SIDE OF THE PROPERTY  
PENALTY FOR REMOVING THIS CARD**

**City of Portland, Maine - Building or Use Permit Application**

389 Congress Street, 04101 Tel: (207) 874-8703, FAX: (207) 8716

Job No: 2011-09-2271-CH OF USE 2011-13379-Hood	Date Applied: 11/16/2011	CBL: 013- E-016-001	
Location of Construction: 38 WASHINGTON AVE	Owner Name: MICHELLE A KELLEY	Owner Address: 38 WASHINGTON AVE PORTLAND, ME 04101	Phone:
Business Name:	Contractor Name: J & M Enterprises	Contractor Address: 330 Neck Rd., China ME 04358	Phone: (207) 968-2729
Lessee/Buyer's Name:	Phone:	Permit Type: BLDG - Building- Hood	Zone: B-2b
Past Use: First floor restaurant - second floor dwelling unit - third floor storage	Proposed Use: Same - 1 <sup>st</sup> floor restaurant - 2 <sup>nd</sup> floor dwelling unit, 3 <sup>rd</sup> floor storage - install kitchen hood	Cost of Work: 4250.00	CEO District:
		Fire Dept: <input checked="" type="checkbox"/> Approved w/condition <input type="checkbox"/> Denied <input type="checkbox"/> N/A Signature: <i>Capt. Prine 11/29/11</i>	Inspection: Use Group: <i>A-2/R</i> Type: <i>Type 2 Hood</i> Signature: <i>JMB</i> <i>11/30/11</i>
Proposed Project Description: Install kitchen hood	Pedestrian Activities District (P.A.D.)		
Permit Taken By:	<b>Zoning Approval</b>		

<p>1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules.</p> <p>2. Building Permits do not include plumbing, septic or electrical work.</p> <p>3. Building permits are void if work is not started within six (6) months of the date of issuance. False informatin may invalidate a building permit and stop all work.</p>	<p><b>Special Zone or Reviews</b></p> <p><input type="checkbox"/> Shoreland</p> <p><input type="checkbox"/> Wetlands</p> <p><input type="checkbox"/> Flood Zone</p> <p><input type="checkbox"/> Subdivision</p> <p><input type="checkbox"/> Site Plan</p> <p><input type="checkbox"/> Maj <input type="checkbox"/> Min <input type="checkbox"/> MM</p> <p>Date: <i>OK</i> <i>11/28/11</i> <i>ABU</i></p>	<p><b>Zoning Appeal</b></p> <p><input type="checkbox"/> Variance</p> <p><input type="checkbox"/> Miscellaneous</p> <p><input type="checkbox"/> Conditional Use</p> <p><input type="checkbox"/> Interpretation</p> <p><input type="checkbox"/> Approved</p> <p><input type="checkbox"/> Denied</p> <p>Date:</p>	<p><b>Historic Preservation</b></p> <p><input checked="" type="checkbox"/> Not in Dist or Landmark</p> <p><input type="checkbox"/> Does not Require Review</p> <p><input type="checkbox"/> Requires Review</p> <p><input type="checkbox"/> Approved</p> <p><input type="checkbox"/> Approved w/Conditions</p> <p><input type="checkbox"/> Denied</p> <p>Date: <i>ABU</i></p>
	<b>CERTIFICATION</b>		

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the appication is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT ADDRESS DATE PHONE

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE DATE PHONE

## BUILDING PERMIT INSPECTION PROCEDURES

Please call 874-8703 or 874-8693 (ONLY)

or email: [buildinginspections@portlandmaine.gov](mailto:buildinginspections@portlandmaine.gov)

With the issuance of this permit, the owner, builder or their designee is required to provide adequate notice to the city of Portland Inspections Services for the following inspections.

Appointments must be requested 48 to 72 hours in advance of the required inspection. The inspection date will need to be confirmed by this office.

- **Please read the conditions of approval that is attached to this permit!! Contact this office if you have any questions.**
- **Permits expire in 6 months. If the project is not started or ceases for 6 months.**
- **If the inspection requirements are not followed as stated below additional fees may be incurred due to the issuance of a "Stop Work Order" and subsequent release to continue.**

### Final Inspection

The project cannot move to the next phase prior to the required inspection and approval to continue, REGARDLESS OF THE NOTICE OF CIRCUMSTANCES.

IF THE PERMIT REQUIRES A CERTIFICATE OF OCCUPANCY, IT MUST BE PAID FOR AND ISSUED TO THE OWNER OR DESIGNEE BEFORE THE SPACE MAY BE OCCUPIED.



# PORTLAND MAINE

*Strengthening a Remarkable City, Building a Community for Life* • [www.portlandmaine.gov](http://www.portlandmaine.gov)

Director of Planning and Urban Development  
Penny St. Louis

Job ID: 2011-09-2271-CH OF USE

Located At: 38 WASHINGTON  
AVE

CBL: 013- E-016-001

## **Conditions of Approval:**

### **Building**

1. The exhaust termination of this type 2 hood shall be located so as not to create a nuisance, as defined by the BOCA National Mechanical Code, 1993. This installation may be evaluated at a future time, as necessary.
2. The equipment, appliance and venting shall be installed in compliance with the manufacturer's specifications and the UL listing.

### **Fire**

1. Type 2 Hood would be required according to manufacturer's instructions.
2. Installation shall comply with City Code Chapter 10.
3. All construction shall comply with City Code Chapter 10.
4. All outstanding code violations shall be corrected prior to final inspection.
5. Any cutting and welding done will require a Hot Work Permit from Fire Department.


826

2011-09-2271 (main permit)  
2011-15379



# General Building Permit Application

If you or the property owner owes real estate or personal property taxes or user charges on any property within the City, payment arrangements must be made before permits of any kind are accepted.

Location/Address of Construction: <u>38 40 WASHINGTON AVE.</u>			
Total Square Footage of Proposed Structure		Square Footage of Lot	
Tax Assessor's Chart, Block & Lot Chart#      Block#      Lot# <u>013      E      016</u>	Owner <u>Michelle A. Kelley 38 Washington Ave Portland 04101</u>		Telephone:
Lessee/Buyer's Name (If Applicable)	Applicant name, address & telephone: <u>Silly's / VINO Bodega 40 WASHINGTON AVE Portland, Me</u>		Cost Of Work: \$ <u>4250-</u> Fee: \$ <u>70.-</u> C of O Fee: \$ _____
Current legal use (i.e. single family) <u>Restaurant / 1 dwelling unit</u>			
If vacant, what was the previous use? _____			
Proposed Specific use: <u>RESTAURANT</u>			
Is property part of a subdivision? _____ If yes, please name _____			
Project description: <u>Install a 4' x 2' Hood (8')</u>			
Contractor's name, address & telephone:		 <b>J &amp; M Enterprises</b> 330 Neck Rd China, Me 04358 jmdawes320@roadrunner.com <i>email when ready</i>	
Who should we contact when the permit is ready: _____			
Mailing address: _____ Phone: _____			

11-28-11

Please submit all of the information outlined in the Commercial Application Checklist. Failure to do so will result in the automatic denial of your permit.

In order to be sure the City fully understands the full scope of the project, the Planning and Development Department may request additional information prior to the issuance of a permit. For further information or to download copies of this form and other applications visit the Inspections Division on-line at [www.portlandmaine.gov](http://www.portlandmaine.gov), or stop by the Inspections Division office, room 315 City Hall or call 874-8703.

I hereby certify that I am the Owner of record of the named property, or that the owner of record authorizes the proposed work and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in this application is issued, I certify that the Code Official's authorized representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

Signature of applicant: Michael Dawes Date: 11/10/11

This is not a permit; you may not commence ANY work until the permit is issued.

RECEIVED  
NOV 6 2011  
Dept of Building Inspections  
City of Portland Maine



# PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life • [www.portlandmaine.gov](http://www.portlandmaine.gov)

Lee Urban - Director of Planning and Development  
Jeanie Bourke - Inspection Division Services Director

## Kitchen Exhaust System Checklist and code Provisions

Dear Applicant,

The following is a checklist to assist you in filing for a permit for a Kitchen Exhaust system. The applicable Mechanical Code provisions have also been attached. Please complete this and submit job specific construction documents that demonstrate compliance with the attached information.

### Type of System:

Type I \_\_\_\_\_ Type II ✓

Type I systems are systems that vent fryers, grills, broilers, ovens or woks.

Type II systems are systems that vent steamers and other non grease producing appliances.

RECEIVED

NOV 16 2011

Dept. of Building Inspections  
City of Portland Maine

### Type of Materials:

Is the hood Stainless steel or other type of steel? yes If Other, what Type? \_\_\_\_\_

Is the duct work Stainless steel or other type of steel? other If Other, what type? galv. steel


Thickness of the steel for the hood sides 20ga top 18ga. stainless

Thickness of the duct for the hood 18 ga.

Type of Hood and Duct Supports

to be determined usually 1 1/2 in angle steel.

Type of seams and Joints welded & mechanical

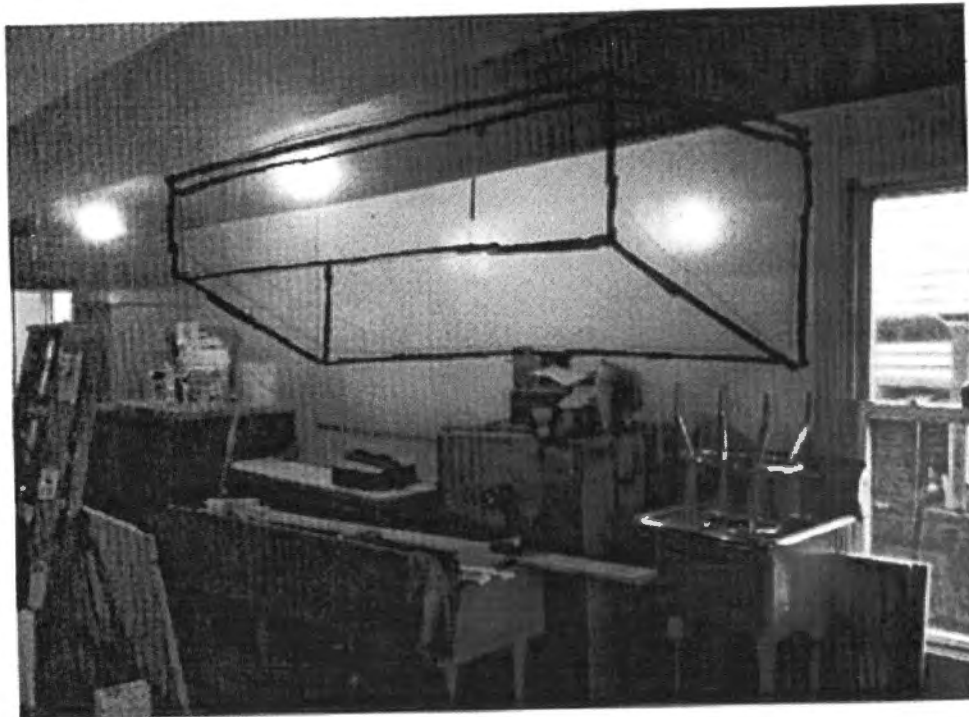

Silly's Washington St  
Condense Hood for Pizza Ovens.

J+M Enterprises

**Exhaust Fan Wiring**

JOB NAME *Silly's (type II)*


DATE 11/14/2011

DRAWING NUMBER EXH1444170-1

JOB NUMBER 1444170

MODEL DU50HFA

Installed Options  
Speed Control

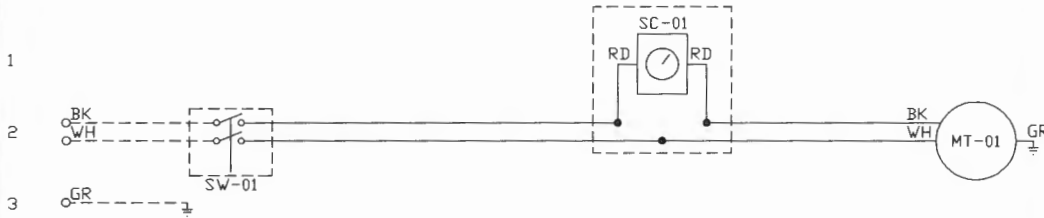

<u>Component Identification</u>		
Label	Description	Location
MT-01	Fan Motor	[2]
QD-01	Quick Disconnect	[2]
SC-01	Speed Control	[1]
SW-01	Main disconnect switch	[2]

MOTOR INFO  
EXHAUST 0.5HP-115V-1P-8.1FLA

ELECTRICAL INFORMATION  
MOTOR/CONTROL MCA: 10.2A  
MOTOR/CONTROL MOP: 15A

NOTES  
----- DENOTES FIELD WIRING  
————— DENOTES INTERNAL WIRING

WIRE COLOR  
BK - BLACK    YW - YELLOW  
BL - BLUE    GR - GREEN  
BR - BROWN   GY - GRAY  
OR - ORANGE   PR - PURPLE  
RD - RED      PK - PINK  
WH - WHITE

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23





**HOOD INFORMATION**


HOOD NO.	MODEL	LENGTH	MAX. COOKING TEMP.	EXHAUST PLENUM					SUPPLY PLENUM					HOOD CONSTRUCTION	HOOD CONFIG.	
				TOTAL EXH. CFM	WIDTH	LENG.	DIA.	CFM	S.P.	TOTAL SUP. CFM	WIDTH	LENG.	DIA.		CFM	S.P.
1	4818 VHB	8' 0.00"	700 Deg.	1600			18"	1600	-0.125"	0				430 SS 100%	ALONE	ALONE

**HOOD INFORMATION**

HOOD NO.	FILTER(S)				LIGHT(S)				UTILITY CABINET(S)				FIRE SYSTEM PIPING	HOOD HANGING WGT
	TYPE	QTY.	HEIGHT	LENGTH	QTY.	TYPE	WIRE GUARD	LOCATION	TYPE	SIZE	MODEL #	QUANTITY		
1					0								NO	204 LBS

**HOOD OPTIONS**

HOOD NO.	OPTION
1	FIELD WRAPPER 3.00' High Front, Left, Right
	RIGHT QUARTER END PANEL 23' Top Width, 0' Bottom Width, 23' High 430 SS
	LEFT QUARTER END PANEL 23' Top Width, 0' Bottom Width, 23' High 430 SS

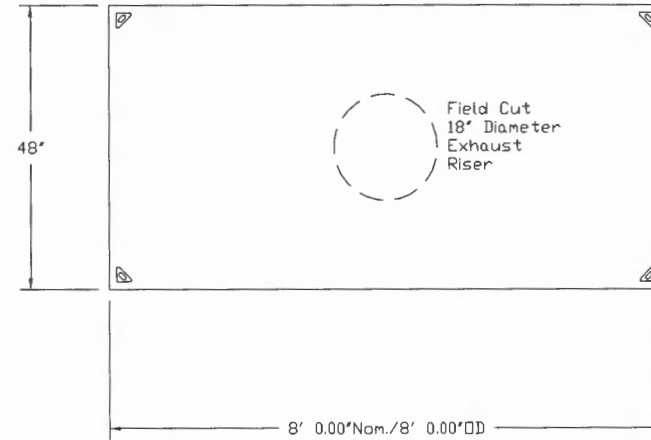

PLAN VIEW - Hood #1  
8' 0.00" LONG 4818VHB



JOB	Silly's (type II)		
LOCATION	SOUTH CHINA, ME		
DATE	11/14/2011	JOB #	1444170
DWG #	1	DRAWN BY	MD-21
REV.		SCALE	1/32

**EXHAUST FAN INFORMATION**

FAN UNIT NO.	FAN UNIT MODEL #	MODEL	TAG	CFM	ESP.	RPM	H.P.	Ø	VOLT	FLA	WEIGHT (LBS.)
1	DU50HFA	DU50HFA		1600	0.600	1481	0.500	1	115	8.1	71.11


**FAN OPTIONS**

FAN UNIT NO.	OPTION (Qty. - Descr.)
1	1 - I 15-BDD Damper
	1 - Wallmount 20.5' Sq. x 5'
	1 - Wall Mount Construction for Fan

**FAN ACCESSORIES**

FAN UNIT NO.	FAN UNIT TAG	EXHAUST			SUPPLY			
		GREASE CUP	GRAVITY DAMPER	WALL MOUNT	SIDE DISCHARGE	GRAVITY DAMPER	MOTORIZED DAMPER	WALL MOUNT
1				YES				

FAN #1 DU50HFA - EXHAUST FAN

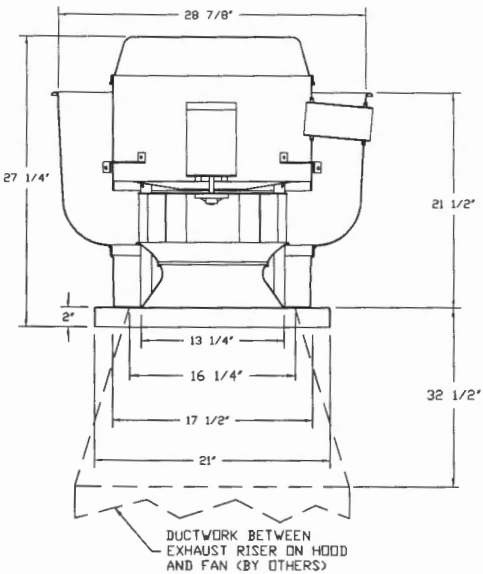

**FEATURES:**

- ROOF MOUNTED FANS
- RESTAURANT MODEL
- UL705 AND UL762
- VARIABLE SPEED CONTROL
- INTERNAL WIRING
- WEATHERPROOF DISCONNECT
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE)
- HIGH HEAT OPERATION 300°F (149°C)
- GREASE CLASSIFICATION TESTING

**NORMAL TEMPERATURE TEST**

EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.


**ABNORMAL FLARE-UP TEST**

EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.

**OPTIONS**

- I 15-BDD DAMPER
- WALLMOUNT 20.5' SQ. X 5'
- WALL MOUNT CONSTRUCTION FOR FAN

**WALL MOUNT BRACKET**

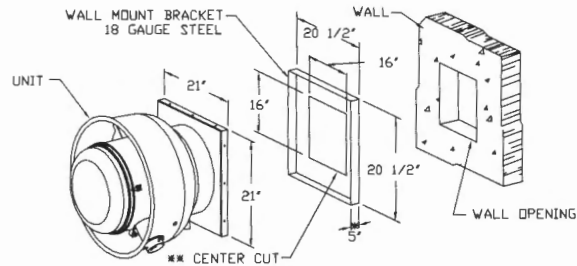

- WALL BRACKET FITS INTO BASE OF FAN
- SELF DRILLING SCREWS SHOULD BE USED FOR UNIT ATTACHMENT TO WALL MOUNT BRACKET
- \* DIMENSION = 5" WHEN USED WITH DAMPER
- \*\* CENTERED IN WALL MOUNT



JOB	Silly's (type II)		
LOCATION	SOUTH CHINA, ME		
DATE	11/14/2011	JOB #	1444170
DWG #	2	DRAWN BY	MD-21
REV.		SCALE	1/32