

GENERAL STRUCTURAL NOTES

DESIGN LIVE LOADS:

2009 IBC, MUEBC
 * Snow 60 psf (Pg)
 * Floor 40 psf

WOOD FRAMING:


- * Dimension Lumber is designed and shall be supplied using BASE VALUES Design Criteria.
- * SPF #2 and better (Maximum Moisture Content 19%) U.O.N.
 Plates: Sill plates: Pressure Treated SPF or Southern Pine;
- * Laminated Veneer Lumber (LVL): Manufactured 1 3/4" wide Microlams (ML) by Ilevel/Trus Joist or equivalent.
 Fb=2,600 psi, E=1,900,000 psi, Fv=285 psi, depth noted on plans.
- * All plywood and oriented strand board (OSB) sheathing shall be engineered grades with APA grade stamp indicating appropriate maximum spacing of supports.
 Floor sheathing: nominal 3/4", APA Sturd-F-Floor "24" tongue & groove glued and nailed.
 Wall sheathing: 7/16" OSB nail base insulated panel (Zip "R" or equal) (exterior walls)
 Roof sheathing: 19/32" OSB base insulated panel, fastened w/ #10x4" wood screw @ 12" **OR** 16ds at 4" max.
- * Nail wall sheathing with 10d commons at 6" o.c. at panel edges, and 12" o.c. intermediate framing U.N.O. BLOCK AND NAIL ALL EDGES BETWEEN STUDS. Sheathing shall be continuous from bottom plate to top plate. Cut in "L" and "T" shapes around openings. Lap sheathing over rim joists min. 4" at all floors to tie upper and lower stud walls together. Minimum height of sheathing panels shall be 16" to assure that plates are tied to studs. Use minimum 3-8d per stud and nail plates with edge nail spacing.
- * Sole plate at all perimeter walls and at designated shear walls shall be nailed as for braced panels with 3-16d x 3 1/2" long box nails (coated or deformed shank) per 16". 12d nails are not acceptable. **SHEATH ALL EXTERIOR WALLS.**
- * Minimum nailing shall comply with IBC Table 2304.9.1 except where more or larger nailing shown on drawings.
- * All roof rafters, joists, beams shall be anchored to supports with metal framing anchors.
- * Double joists under partitions where joists are parallel to partitions.
- * Provide continuous wall studs each side of wall openings equal to one half or greater of number of studs interrupted by openings.
- * All wall studs shall be continuous from floor to floor or from floor to roof.
- * Cross brace all dimension lumber roof and floor joists at midspan and provide solid blocking or rim joists at all joist supports and joist ends.
- * Metal connectors: Simpson Strong Tie unless otherwise noted, installed with number and type of nails to achieve maximum rated capacity. Note that heavy duty and skewed hangers may require special order.
- * All beams shall be braced against rotation at points of bearing.
- * Drypack grout all beam pockets full after beams are set.
- * Unless otherwise indicated, install two lengths of solid blocking x joist depth x 12 inches long in floor framing under column loads. Columns must have a continuous load path to foundation.
- * Lead holes for lag bolts shall be 60% to 70% of lag shank diameter in compliance with AITC criteria.

STRUCTURAL ERECTION AND BRACING REQUIREMENTS

- * The structural drawings illustrate the completed structure with all elements in their final positions, properly supported and braced. The contractor, in the proper sequence, shall provide proper shoring and bracing as may be required to achieve the final completed structure.

Structural Drawing Index

S1-1	Fourth Level Framing Plan
S1-2	Roof Framing Plan

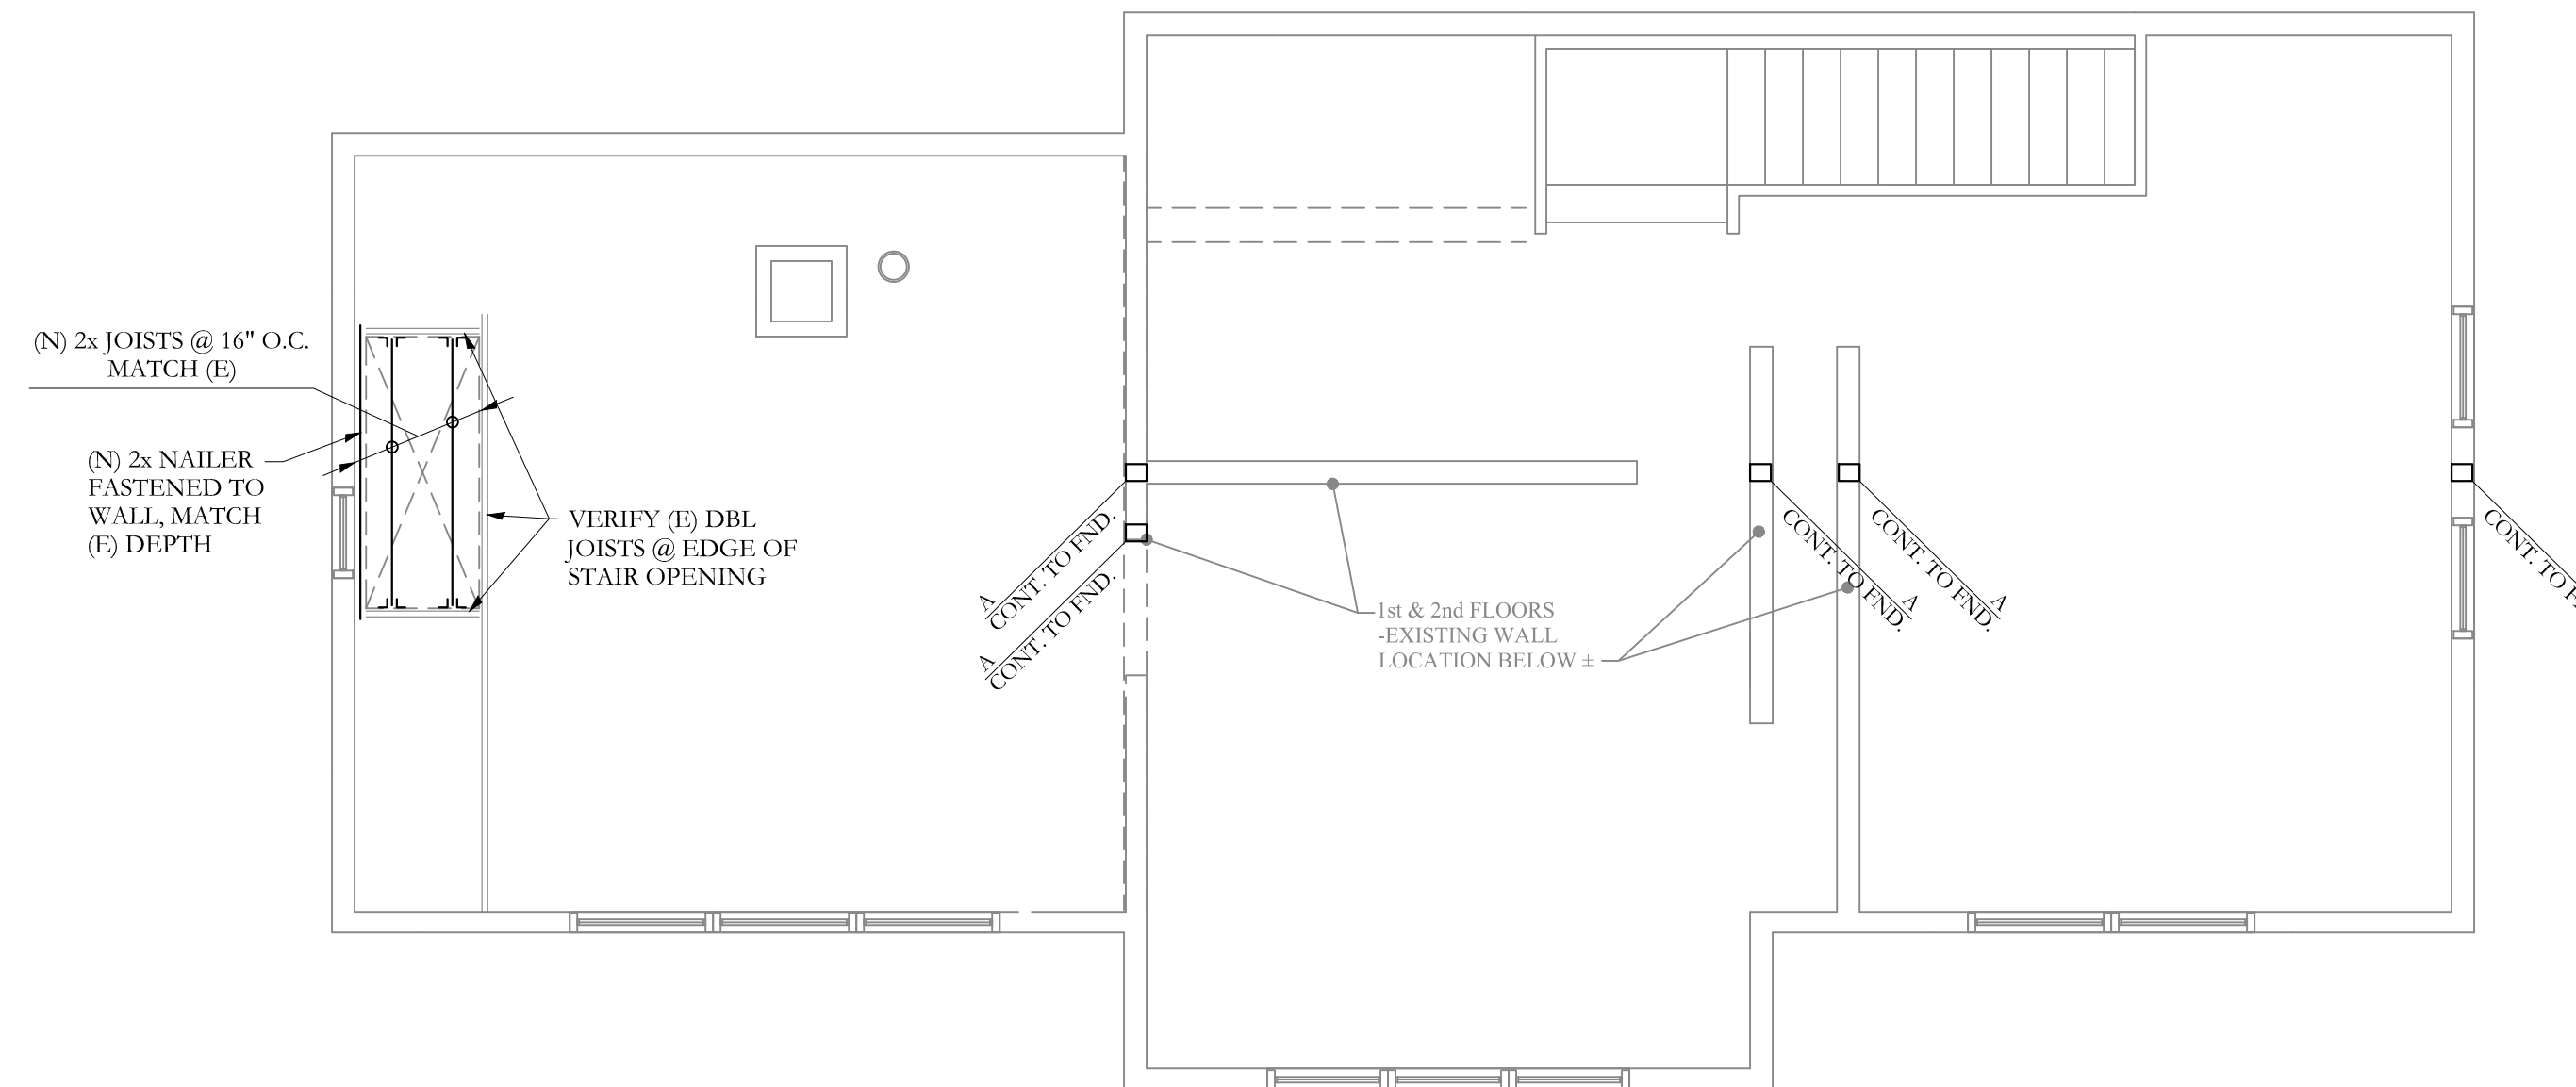

FOURTH LEVEL FRAMING PLAN
 SCALE 1/4"=1'-0"
 NOTES:
 1. ALL WOOD COLUMNS IN 2x6 WALLS SHALL BE 3-2x6 AND IN 2x4 WALLS SHALL BE 3-2x4 UNLESS NOTED OTHERWISE ON PLANS
 2. ALL HEADERS IN 2x6 BEARING WALLS ARE (3) 2x6, UNO
 3. ALL HEADERS IN 2x4 BEARING WALLS ARE (2) 2x8, UNO
 4. SHORING BY G.C. -TYP.
 5. ALL WALL SHEATHING IS 1/2" MIN. -TYP.

