



6 1/2" x 11'-0" SLAB REINFORCING DETAILS

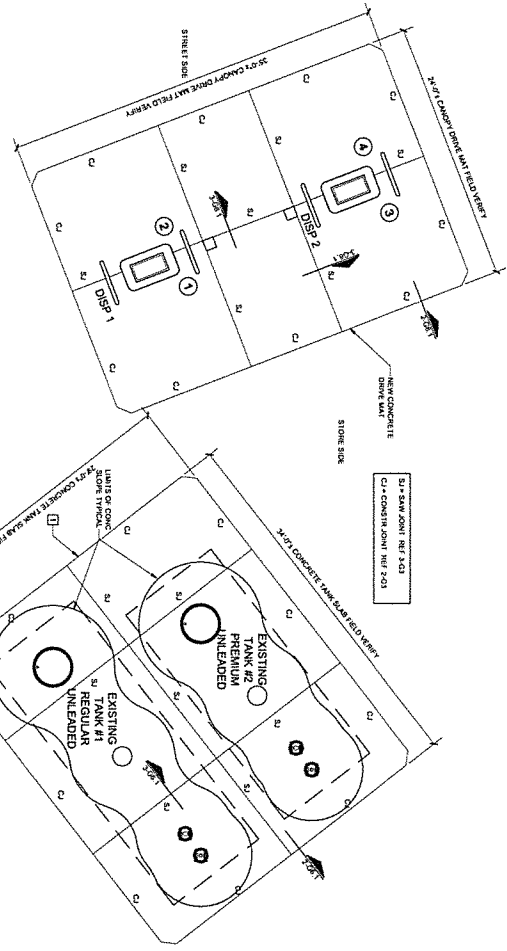


4 FUEL AREA SLAB LAYOUT AND DIMENSIONAL PLAN

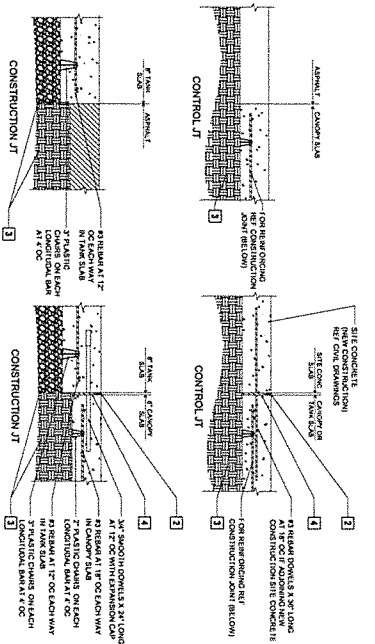


5 1/2" x 11'-0" CONCRETE TAG AND MARKER DETAILS

1 EXISTING TANK SECTION

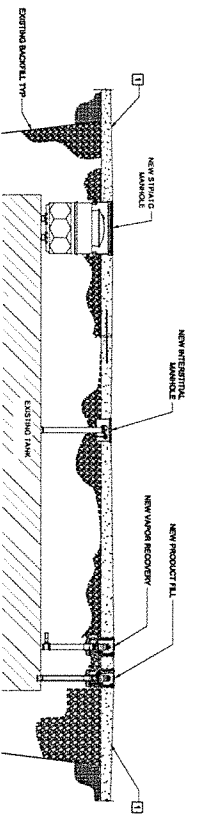

3 SAW CUT DETAILS

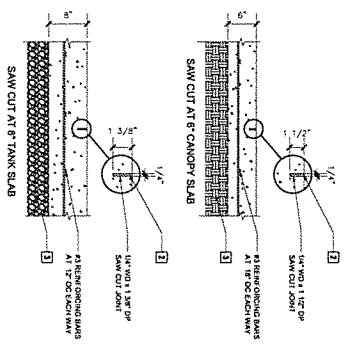

KEY NOTES

1. CONCRETE TANK SLAB REF. 4.03 SHALL BE REINFORCED WITH THE NORMAL GRADE OF REINFORCING BARS. THE NORMAL GRADE OF REINFORCING BARS SHALL BE 1/2" DIA. TYPE 40 UNLESS OTHERWISE SPECIFIED.
2. GROUTING RESISTANT JOINT SEALING COMPOUND SHALL BE USED TO SEAL ALL JOINTS.
3. UNDESIRABLE SOIL OR CONTAMINATED MATERIAL SHALL NOT BE ALLOWED TO REMAIN IN CONTACT WITH THE TANK WALLS.
4. 1/2" THICK ADHESIVE IMPREGATED EXPANSION JOINT MATERIAL.