

PRINTED: Oct 10, 2013

THE FOLLOWING BUILDING CODES AND STANDARDS SHALL BE REFERENCED DURING CONSTRUCTION:

Table listing building codes and standards including IBC 2009, ASCE 7, ACI 308, ACI 301, ACI 305, ACI 306, ACI 308, and others.

REFERENCE ARCHITECTURAL PLANS FOR DIMENSIONS NOT SHOWN. REFERENCE MECHANICAL, ELECTRICAL, AND ARCHITECTURAL PLANS FOR SIZES AND LOCATIONS OF WALL AND SLAB OPENINGS, DUCTS, PIPING, CURBS, AND EQUIPMENT PADS.

EXISTING DIMENSIONS AND CONDITIONS ARE FOR REFERENCE ONLY. CONTRACTOR SHALL VERIFY ALL EXISTING CONSTRUCTION AND DIMENSIONS IN THE FIELD PRIOR TO CONSTRUCTION OR FABRICATION.

THE CONTRACTOR SHALL NOTIFY THE ENGINEER IF DEVIATIONS OR CHANGES ARE REQUIRED TO THE CONTRACT DOCUMENTS OR APPROVED SHOP DRAWINGS DUE TO INTERFERENCES, FABRICATION ERRORS, OR OTHER CAUSES.

THE STRUCTURE IS SELF-SUPPORTING AND STABLE AFTER THE ENTIRE BUILDING IS COMPLETELY CONSTRUCTED. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR ERECTION PROCEDURES AND SEQUENCING DURING CONSTRUCTION AND ERECTION TO PROVIDE AND ENSURE LOCAL AND OVERALL STABILITY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION AND ERECTION.

GENERAL NOTES SCALE: NTS

LIVE LOAD: LIVING AREA = 40 PSF LIVE LOAD
SNOW LOADS: GROUND SNOW LOAD, Pg = 50 PSF
SNOW EXPOSURE FACTOR, Ce = 1.0
SNOW LOAD IMPORTANCE FACTOR, I = 1.0
THERMAL FACTOR, Ct = 1.1
FLAT ROOF SNOW LOAD, Pf = 38.5 PSF + DRIFT
WIND LOADS: BASIC WIND SPEED = 100 MPH
IMPORTANCE FACTOR, Iw = 1.0
WIND EXPOSURE B
MAIN WINDFORCE-RESISTING SYSTEM (INCLUDES WINDWARD + LEeward) = 15 PSF

DESIGN CRITERIA SCALE: NTS

ALL CONCRETE WORK, INCLUDING MATERIAL SELECTION, ADMIXTURES, MIXING, AND PLACEMENT OF CONCRETE SHALL BE IN CONFORMANCE WITH APPLICABLE BUILDING CODES. IN ADDITION, REFERENCE THE FOLLOWING CONCRETE STANDARDS AND SPECIFICATIONS:

Table listing design criteria for reinforced concrete including ACI 318, ACI 301, ACI 305, ACI 306, and ACI 308.

Table with 4 columns: LOCATION, MAX W/C RATIO, fc, and AIR-ENTRAINMENT. Rows include INT. CONC./WALLS/SLABS, FOUNDATIONS, FOOTINGS, & FOUNDATION WALLS, INT. SLAB-ON-GRADE, and EXT. SLAB-ON-GRADE.

WHERE: W/C = WATER TO CEMENT RATIO AND fc = COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS
MAXIMUM AGGREGATE SIZE SHALL BE 3/4", IN CONFORMANCE WITH ASTM C33.
USE PORTLAND CEMENT TYPE II, IN CONFORMANCE WITH ASTM 150.
AIR ENTRAINING ADMIXTURES SHALL CONFORM TO ASTM C 260.
ADMIXTURES SHALL CONFORM TO "SPECIFICATION FOR CHEMICAL ADMIXTURES FOR CONCRETE" ASTM C 494.
FLY ASH USED AS ADMIXTURES SHALL CONFORM TO ASTM C 618.
CALCIUM CHLORIDE OR ADMIXTURES CONTAINING CALCIUM CHLORIDE IS NOT PERMITTED.

CONCRETE EXPOSED TO FREEZING AND THAWING, INCLUDING FOUNDATIONS, FOOTINGS, FOUNDATION WALLS, AND EXTERIOR WALKWAYS SHALL BE AIR ENTRAINED WITH AIR CONTENT BETWEEN 5% AND 6%. CONTRACTOR SHALL NOT PLACE CONCRETE ON FROZEN GROUND OR IN WATER. ADEQUATE EQUIPMENT SHALL BE PROVIDED FOR HEATING CONCRETE MATERIALS AND PROTECTING CONCRETE DURING NEAR-FREEZING OR FREEZING WEATHER. REFERENCE ACI 306, AS NOTED ABOVE, FOR RECOMMENDATIONS FOR COLD WEATHER CONCRETING.

CONTRACTOR SHALL SUBMIT PROPOSED CONCRETE MIX DESIGN AND LABORATORY TESTS OF FABRICATED CYLINDERS VERIFYING CONCRETE STRENGTH OR PERFORMANCE HISTORY OF MIX TO ENGINEER FOR ACCEPTANCE PRIOR TO PLACEMENT OF CONCRETE. CONCRETE USED ON SITE SHALL BE FIELD TESTED IN ACCORDANCE WITH AND IN THE PRESENCE OF AN APPROVED TESTING AGENCY. FIELD TESTING INFORMATION SHALL INDICATE SLUMP, AIR CONTENT, AND TEMPERATURE. COMPRESSION TEST 1 CYLINDER AT 7 DAYS AND 2 AT 28 DAYS. HOLD AN ADDITIONAL CYLINDER FOR A 56 DAY BREAK, IF NECESSARY. PROVIDE A SET OF 4 CYLINDERS FOR EACH PLACEMENT AND PER 50 CUBIC YARDS OF CONCRETE PLACED. THE OWNER SHALL PAY FOR ALL CONCRETE TESTING.

CONCRETE NOTES SCALE: NTS

USE DEFORMED BILLET-STEEL REINFORCING BARS, GRADE 60, IN CONFORMANCE WITH ASTM A615. REINFORCEMENT SHALL BE ACCURATELY PLACED AND SUPPORTED PRIOR TO CONCRETE PLACEMENT, AND SHALL BE SECURED AGAINST DISPLACEMENT.

THE CONTRACTOR SHALL SUBMIT REINFORCING SHOP DRAWINGS TO THE ENGINEER FOR REVIEW AND ACCEPTANCE PRIOR TO COMMENCING FABRICATION. REINFORCEMENT SHALL BE DETAILED IN ACCORDANCE WITH ACI "MANUAL OF STANDARD PRACTICE FOR DETAILING OF REINFORCED CONCRETE STRUCTURES". SHOP DRAWINGS SHALL SHOW REINFORCING STEEL PLACEMENT DETAILS AND SECTIONS.

Table: MINIMUM CONCRETE COVER FOR REINFORCEMENT. Columns: Location (Earth/Weather, Earth/Weather, Not Exposed, Not Exposed), Cover (3 inches, 2 inches, 1 1/2 inches, 1 1/2 inches).

CONTINUOUS REINFORCEMENT SHALL BE TENSION LAP SPLICED PER LAP SPLICE LENGTH TABLE, U.N.O.

Table: LAP SPLICE LENGTH TABLE. Columns: Bar Size, Min Lap Splice (Inches). Rows: #3, #4, #5, #6, #7, #8, #9.

REINFORCEMENT HOOKS SHALL CONFORM TO STANDARD HOOKS ACCORDING TO ACI 318. WELDING OF REINFORCEMENT IS NOT PERMITTED, U.N.O.

CONCRETE REINFORCING NOTES SCALE: NTS

SUBGRADE PREPARATION AND DETERMINATION (INCLUDING ALLOWABLE BEARING PRESSURE, STRUCTURAL FILL GRADATION REQUIREMENTS, COMPACTION REQUIREMENTS AND POST-CONSTRUCTION SETTLEMENT ANALYSIS) BENEATH FOOTINGS AND SLABS-ON-GRADE AND BEHIND FOUNDATION WALLS SHALL BE PROVIDED BY A GEOTECHNICAL ENGINEER. ALL FILL USED TO SUPPORT FOUNDATIONS AND SLABS-ON-GRADE SHALL CONSIST OF A WELL-GRADED, GRANULAR MATERIAL PER THE RECOMMENDATIONS OF THE GEOTECHNICAL ENGINEER.

PRESUMED ALLOWABLE SOIL BEARING PRESSURE USED IN DESIGN = 2,000 PSF. BEARING CAPACITIES SHALL BE VERIFIED BY GEOTECHNICAL ENGINEER. MINIMUM FROST DEPTH COVER = 4'-6" FOR EXTERIOR FOOTINGS BELOW FINAL EXTERIOR GRADE. CONTRACTOR SHALL NOTIFY ENGINEER OF ANY DISCREPANCIES.

FOUNDATIONS SHALL BEAR ON UNDISTURBED NATIVE SOIL, UNLESS NOTED OTHERWISE. BEARING ELEVATIONS SHALL BE LOWERED WHERE SUITABLE SOILS ARE NOT ENCOUNTERED. WHERE OVEREXCAVATION HAS OCCURRED, CONTRACTOR MAY PLACE LEAN CONCRETE ON TOP OF NATIVE SOIL. THE CONTRACTOR SHALL NOTIFY THE GEOTECHNICAL AND STRUCTURAL ENGINEER IF ANY UNSUITABLE SOILS ARE ENCOUNTERED PRIOR TO PLACING FOUNDATIONS.

FOUNDATION WALLS SHALL BE BACKFILLED SIMULTANEOUSLY ON BOTH SIDES OF THE WALL. FOUNDATION WALLS AND SLAB-ON-GRADES SHALL REACH THEIR FULL 28 DAY COMPRESSIVE STRENGTH PRIOR TO BACKFILLING. THE CONTRACTOR SHALL PROVIDE TEMPORARY SHORING/BRAACING FOR WALLS WHEN BACKFILL IS PLACED PRIOR TO CONCRETE ACHIEVING ITS FULL 28 DAY STRENGTH. BACKFILL FOR FOUNDATION WALLS IS BASED ON DRAINED CONDITIONS. SEE ARCHITECTURAL, CIVIL, AND MECHANICAL DRAWINGS FOR FOUNDATION DRAINAGE SYSTEM.

PROTECT FOUNDATIONS FROM FROST AND KEEP BOTTOM OF TRENCH DRY DURING CONSTRUCTION. IF GROUNDWATER IS ENCOUNTERED NEAR OR ABOVE THE BASE OF THE FOOTINGS, EXCAVATIONS SHALL BE WATERED DURING CONSTRUCTION. SURFACE WATER SHALL BE DIVERTED AWAY FROM EXCAVATIONS.

CONTRACTOR SHALL BE RESPONSIBLE FOR THE SHORING AND BRAACING OF EXISTING STRUCTURES DURING EXCAVATION, BACKFILLING, AND CONSTRUCTION. CONTRACTOR SHALL SLOPE EXCAVATIONS TO ACHIEVE SOIL STABILITY.

FOUNDATION NOTES SCALE: NTS

ALL LUMBER SHALL BE VISUALLY GRADED AND STAMPED WITH GRADE DESIGNATION, SPECIES, AND ADDITIONAL INSPECTION INFORMATION, U.N.O.

CARE SHALL BE TAKEN TO PROTECT TIMBER FROM WEATHER AND DAMPNESS. DO NOT STACK IN SUCH A WAY AS TO CAUSE WARPING OR PREVENT ADEQUATE AIR CIRCULATION.

WOOD GRADES AND SPECIES: 1. SPRUCE-PINE-FIR, No.1/No.2 OR BETTER FOR TYPICAL LUMBER (JOISTS, WALLS, ETC) U.N.O. 2. USE SOUTHERN YELLOW PINE FOR EXTERIOR EXPOSURE APPLICATIONS AND WHERE SHOWN ON DRAWINGS AS PRESERVATIVE PRESSURE TREATED LUMBER (PT OR PPT). 3. WHERE NOTED LVL ON DRAWINGS, PROVIDE VERSA LAM 3100 BY BOISE CASCADE, OR EQUIVALENT, WHICH HAS THE FOLLOWING MINIMUM ALLOWABLE STRESSES:

Table: A. LVL PROPERTIES. Columns: Property (Fb, Fv, Ft), Value (3100 PSI, 285 PSI, 1555 PSI), Property (Fc), Value (2510 PSI, 750 PSI, 2,000,000 PSI).

STRUCTURAL LUMBER SHALL HAVE A MAXIMUM MOISTURE CONTENT OF 19%. PROVIDE PRESSURE TREATED OR WOLVANIZED LUMBER FOR ALL LUMBER IN CONTACT WITH MASONRY OR CONCRETE. ALL CONNECTORS THAT ARE IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE HOT-DIP GALVANIZED, U.N.O.

NOMINAL SIZES ARE TYPICALLY REFERENCED ON THE DRAWINGS. PROVIDE ACTUAL SIZES AS SET FORTH IN U.S. DEPARTMENT OF COMMERCE VOLUNTARY PRODUCT STANDARD PS20-99.

ALL PLYWOOD SHALL BE APA RATED CDX SHEATHING: 1. USE 1/2" PLYWOOD WALL SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO WALL STUDS. STAGGER PANEL ENDS AND BLOCK ALL PANEL EDGES. 2. USE 3/8" PLYWOOD ROOF SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO FRAMING. STAGGER PANEL ENDS. USE SHEATHING CLIPS BETWEEN SHEETS WHERE BLOCKING IS NOT REQUIRED. 3. USE 3/4" PLYWOOD FLOOR SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO FRAMING. STAGGER PANEL ENDS.

PROVIDE FULL DEPTH BLOCKING AT ENDS AND INTERIOR SUPPORTS OF ALL JOISTS AND RAFTERS WHERE JOISTS AND RAFTERS FRAME OVER SUPPORTS. PROVIDE 1x3 DIAGONAL BRIDGING OR FULL DEPTH SOLID BLOCKING FOR EACH 8'-0" OF SPAN FOR ALL JOISTS AND RAFTERS.

WHERE BEAMS ARE LABELED ON PLAN, DO NOT SPLICE BEAM NOR ANY PLY OF BEAM BETWEEN SUPPORTS.

FASTENERS SHALL COMPLY WITH RECOMMENDED FASTENING SCHEDULE OF REFERENCED BUILDING CODE, U.N.O. ON DRAWINGS, SPIKE TOGETHER ALL FRAMING MEMBERS WHICH ARE BUILT-UP USING A MINIMUM OF 2-ROWS OF 16d NAILS AT 12" O.C. STAGGERED, UNLESS OTHERWISE NOTED IN BOCA OR ON THE DRAWINGS. NAIL MULTIPLE LVL'S TOGETHER AS RECOMMENDED BY THE MANUFACTURER USING A MINIMUM OF 2-ROWS OF 16d NAILS AT 12" o.c. STAGGERED. ALL FASTENERS, NUTS, AND WASHERS SHALL BE HOT-DIPPED GALVANIZED.

ALIGN COLUMNS SUCH THAT COLUMNS BEAR CONTINUOUSLY TO FOUNDATION SUPPORT.

PROVIDE HORIZONTAL BLOCKING FOR ALL LOAD BEARING WALLS AT 4'-0" O.C. VERTICAL, MAXIMUM.

SUBMIT SHOP DRAWINGS FOR ALL PREFABRICATED WOOD JOISTS AND WALL PANELS TO ENGINEER FOR REVIEW PRIOR TO CONSTRUCTION.

WOOD NOTES SCALE: NTS

ALL STRUCTURAL STEEL WORK SHALL CONFORM TO:

AISC AMERICAN INSTITUTE OF STEEL CONSTRUCTION, MANUAL OF STEEL CONSTRUCTION, NINTH EDITION
AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES

STRUCTURAL STEEL MEMBERS SHALL BE IN CONFORMANCE WITH THE FOLLOWING:

Table: ALL STEEL, U.N.O. Columns: Item (Angles, Plates, Tubing, Pipe), Specification (ASTM A992, A36, A500, A53).

SHOP DRAWINGS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW PRIOR TO COMMENCING FABRICATION.

- SHOP DRAWINGS SUBMITTALS SHALL INCLUDE: 1. CERTIFIED MILL TEST REPORTS OF STRUCTURAL STEEL (INCLUDING NAMES AND LOCATIONS OF MILLS AND SHOPS). 2. CERTIFIED MILL TEST REPORTS OF BOLTS, NUTS AND WASHERS (INCLUDING NAMES AND LOCATIONS OF MILLS AND SHOPS). 3. STRUCTURAL STEEL FABRICATION AND ERECTION DRAWINGS WHICH INCLUDE BOLTED CONNECTIONS (SHOP AND FIELD) AND WELDED CONNECTIONS (SHOP AND FIELD) DEPICTING AWS WELDING SYMBOLS. 4. METAL DECK SHOP DRAWINGS DEPICTING SHEAR STUD LAYOUT ON BEAMS AND GRIDERS.

OWNER SHALL RETAIN A QUALIFIED TESTING AGENCY TO PERFORM AND VERIFY THE FOLLOWING: 1. VISUAL INSPECTION OF ALL WELDS. 2. ULTRASONIC TESTING, IN ACCORDANCE WITH ASTM E-164, ON 100% OF ALL FIELD FULL PENETRATION WELDS. 3. PROVIDE RANDOM VERIFICATION VIA ULTRASONIC TESTING OF SHOP FULL PENETRATION WELDS. 4. FIELD BOLTED CONNECTIONS, INCLUDING VERIFICATION OF BOLT GRADES. 5. SHEAR STUD QUANTITY, PROPER INSTALLATION, SIZE, AND SPACING. SHEAR STUDS SHALL CONFORM TO AWS D1.1.

- BOLTED CONNECTIONS: 1. FIELD CONNECTIONS SHALL UTILIZE MINIMUM 3/4" DIAMETER A325 HIGH STRENGTH BOLTS, U.N.O., AND AT BOLTED CONNECTIONS SHALL BE SLIP CRITICAL (SC) AT ALL MOMENT FRAMES, BRACED FRAMES, AND AT ADDITIONAL LOCATIONS INDICATED IN THE DRAWINGS. SLIP CRITICAL CONNECTIONS SHALL UTILIZE LOAD INDICATOR WASHERS OR TENSION CONTROL BOLTS. BOLT HOLES SHALL BE STANDARD SIZE, U.N.O. 2. HIGH STRENGTH BOLTS SHALL BE INSTALLED AND TIGHTENED PER AISC SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 BOLTS. 3. ANCHOR BOLTS SHALL CONFORM TO ASTM F1554, GRADE 36, STANDARD HEX HEAD FURNISHED WITH HEAVY HEX NUTS AND LOCK WASHERS. 4. CONTRACTOR SHALL DESIGN CONNECTIONS NOT ALREADY DETAILED ON STRUCTURAL DRAWINGS. DESIGN SHALL BE STAMPED BY A LICENSED STRUCTURAL ENGINEER AND SUBMITTED PRIOR TO COMMENCING FABRICATION.

WELDED CONNECTIONS: 1. WELDING SHALL CONFORM TO AWS D1.1. USE LOW-HYDROGEN SMAW ELECTRODES WITH MINIMUM TENSILE STRENGTH OF 70 KSI.

- STRUCTURAL STEEL SHALL RECEIVE THE FOLLOWING PROTECTIVE COATINGS: 1. DO NOT PAINT SURFACES TO RECEIVE METAL DECK AND/ OR SHEAR CONNECTORS FASTENED BY WELDING, CONTACT SURFACES OF HIGH STRENGTH BOLTED CONNECTIONS, FINISHED BEARING SURFACES, AND SURFACES TO BE WELDED IN THE FIELD. IF REQUIRED, PROTECT THESE SURFACES BY RUST-INHIBITING COATING THAT CAN BE REMOVED EASILY PRIOR TO ERECTION. 2. UNEXPOSED STRUCTURAL STEEL SHALL BE CLEANED IN ACCORDANCE WITH SSPC-SP3 AND PAINTED WITH PRIMER PAINT, TNEPEC 10-99, OR EQUIVALENT, U.N.O. 3. EXPOSED STRUCTURAL STEEL TO RECEIVE ZINC-RICH EPOXY PAINT SHALL BE FIRST CLEANED IN ACCORDANCE WITH SSPC-SP6 ,COMMERCIAL BLAST CLEANING. USE TNEPEC ZIN-RICH EPOXY PAINT, OR EQUIVALENT. APPLY FINISH COAT PER ARCHITECT. 4. EXPOSED STRUCTURAL STEEL TO BE HOT-DIPPED GALVANIZED SHALL BE IN ACCORDANCE WITH ASTM A123.

- SHEAR CONNECTOR STUDS: 1. SHEAR CONNECTOR STUDS SHALL BE NELSON, OR EQUIVALENT, 3/4" DIAMETER, U.N.O. WELD STUDS PER STUD MANUFACTURER'S RECOMMENDATIONS THROUGH METAL DECKING. STUD LENGTH SHALL BE 1" BELOW TOP OF CONCRETE SLAB-ON-DECK. 2. SHEAR STUDS, WHERE REQUIRED, ARE INDICATED ON THE DRAWINGS AS [XX], WHERE XX IS THE NUMBER OF STUDS EQUALLY SPACED BETWEEN SUPPORTS ON A BEAM OR GIRDER.


STRUCTURAL STEEL NOTES SCALE: NTS

Table of abbreviations including AB (Anchor Bolt), B/FTG (Bottom of Footing), C (Structural Steel Channel), DIA (Diameter), DIM (Dimension), DISCONT (Discontinuous), (E), EX, EXIST (Existing), EA (Each), EF (Each Face), EL, ELEV (Elevation), EQ (Equal), EQUIP (Equipment), ES (Each Side), EW (Each Way), EXP (Expansion), EXT (Exterior), F (Footing Designation), FDN (Foundation), FF (Finish Floor), FLG (Flange), FLR (Floor), FT (Foot), FTG (Footing), FV (Field Verify), G (Gage), GALV (Galvanized), HOR, HORIZ (Horizontal), HSS (Hollow Structural Shape), HT (Height), IF (Inside Face), IN (Inch), INFO (Information), JT (Joint), K (KIP), KSI (Kips per Square Inch), L (Angle), LL (Double Angle), LB (Pound), LF (Linear Foot), LLH (Long Leg Horizontal), LVL (Long Leg Vertical), MAX (Maximum), MECH (Mechanical), MFR (Manufacturer), MIN (Minimum), MISC (Miscellaneous), NF (Near Face), NO (Number), NS (Near Side), NTS (Not to Scale), OC (On Center), OF (Outside Face), OPNG (Opening), OPP (Opposite), P (Plate), PL (Plate), PP (Partial Penetration Weld), PREFAB (Prefabricated), PSF (Pounds per Square Foot), PSI (Pounds per Square Inch), REIN (Reinforcing), REQ, REQD (Required), RD (Roof Drain), SC (Slip Critical), SECT (Section), SHEATH (Sheathing), SIM (Similar), SOG (Slab-on-Grade), SPAC (Spacing), SPEC (Specifications), SS (Stainless Steel), STD (Standard), STIFF (Stiffener), STL (Steel), STR (Straight), STRUCT (Structural), T (Top), T&B (Top and Bottom), TOC (Top of Concrete), T/FTG, TOF (Top of Footing), TEMP (Temperature), T/SHELF (Top of Shelf), T/SLAB (Top of Slab), T/STL (Top of Steel), T/WALL (Top of Wall), TS (Structural Tubing), TYP (Typical), UNO (Unless Noted Otherwise), VER, VERT (Vertical), VIF (Verify in Field), W (Structural Steel Wide Flange), WITH (With), W/O (Without), WP (Work Point), WT (Weight), WWF (Welded Wire Fabric).

ABBREVIATIONS SCALE: NTS

Table showing symbols for SLOPE DESIGNATION, ELEVATION MARK, ROOF PITCH, SPAN DIRECTION, and SECTION MARK, along with corresponding material patterns for UNDISTURBED EARTH, LEDGE, COMPACTED STRUCTURAL FILL, CONCRETE, GROUT, BRICK, and CMU.

LEGEND SCALE: NTS

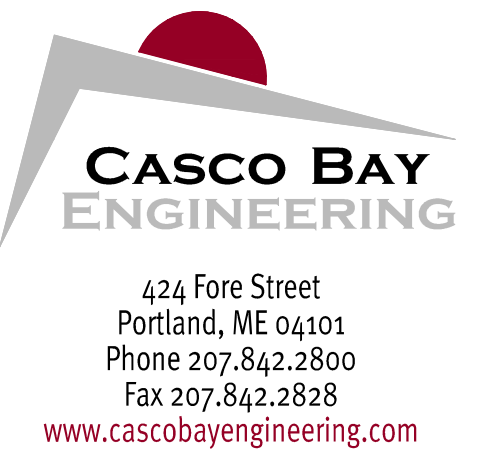

CLIENT: MIKE D'AMBOISE
93 CUMBERLAND AVE
PORTLAND, ME 04101

CUMBERLAND AVE. RENOVATION
93 CUMBERLAND AVE
PORTLAND, ME

BUILDING RENOVATION

Table: ISSUED DESCRIPTION FOR PERMIT ONLY. Columns: No., Date, By, SJP, ED.

SHEET TITLE:

STRUCTURAL NOTES

Table: DESIGNED: SJP, DRAWN: SJP, DATE: 9-17-13, PROJECT NUMBER: 13-099

S000