



**THE BODY ARCHITECT**  
SCALE: 1/4" = 1'-0"  
DATE: 01 OCT 2020  
PROJECT: NYS  
RICHARD W. SADOW Design & Decoration  
Proposed Floor Plan  
A2

- Code requirements for existing fire stairs:
1. Minimum 22" width.
  2. 9" max. rise, 9" min. tread.
  3. Solid treads.
  4. Min. nosing of 1"
  5. Existing guardrails a min. of 30"
  6. Vertical rails 4" O.C.
- Existing stair complies with 1, 2, 3 & 5.  
 Stair treads do not have a 1" nosing.  
 Stair needs vertical rails, min. 4" O.C.


① PLAN

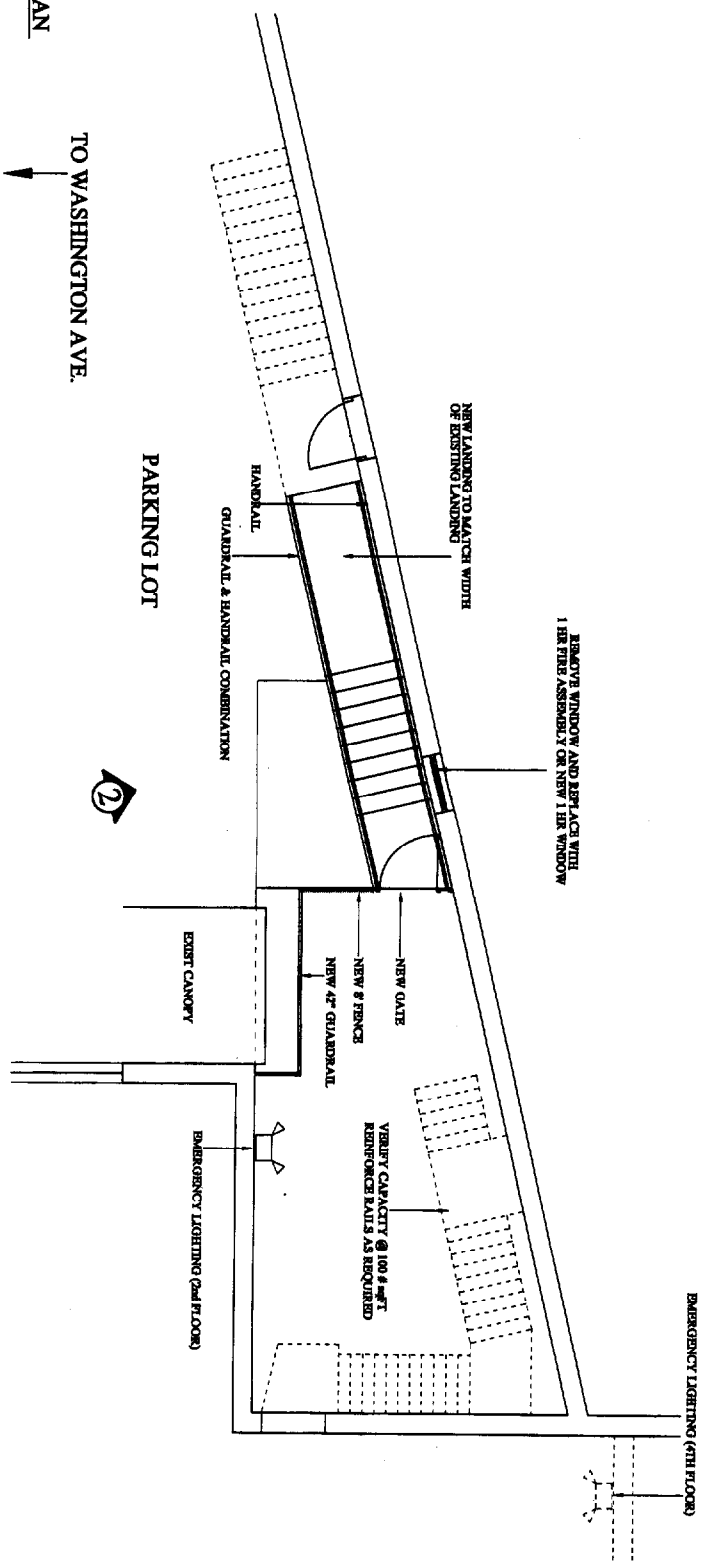

② ELEVATION

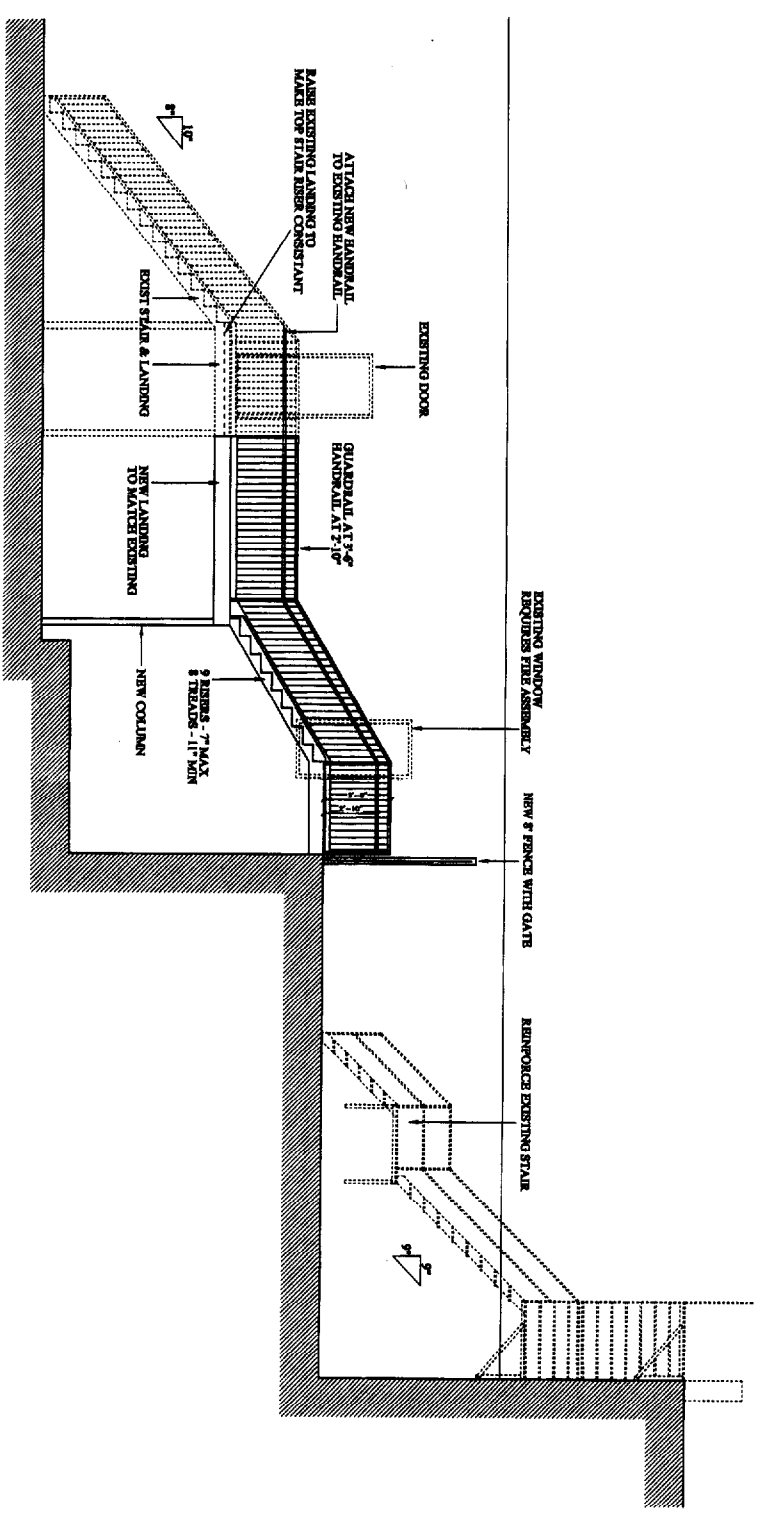

<b>A1</b>	STAIR ADDITION TO EXIST FIRE ESCAPE STAIR	OCT 09, 2003	1/4" = 1'-0"	Project: <b>75 WASHINGTON AVE.</b> PORTLAND, MAINE	<b>ARCHETYPE, P.A.</b> ARCHITECTS 48 Union Wharf Portland, Maine 04101 (207) 772-6022 Fax (207) 772-4058		
		Revisions					

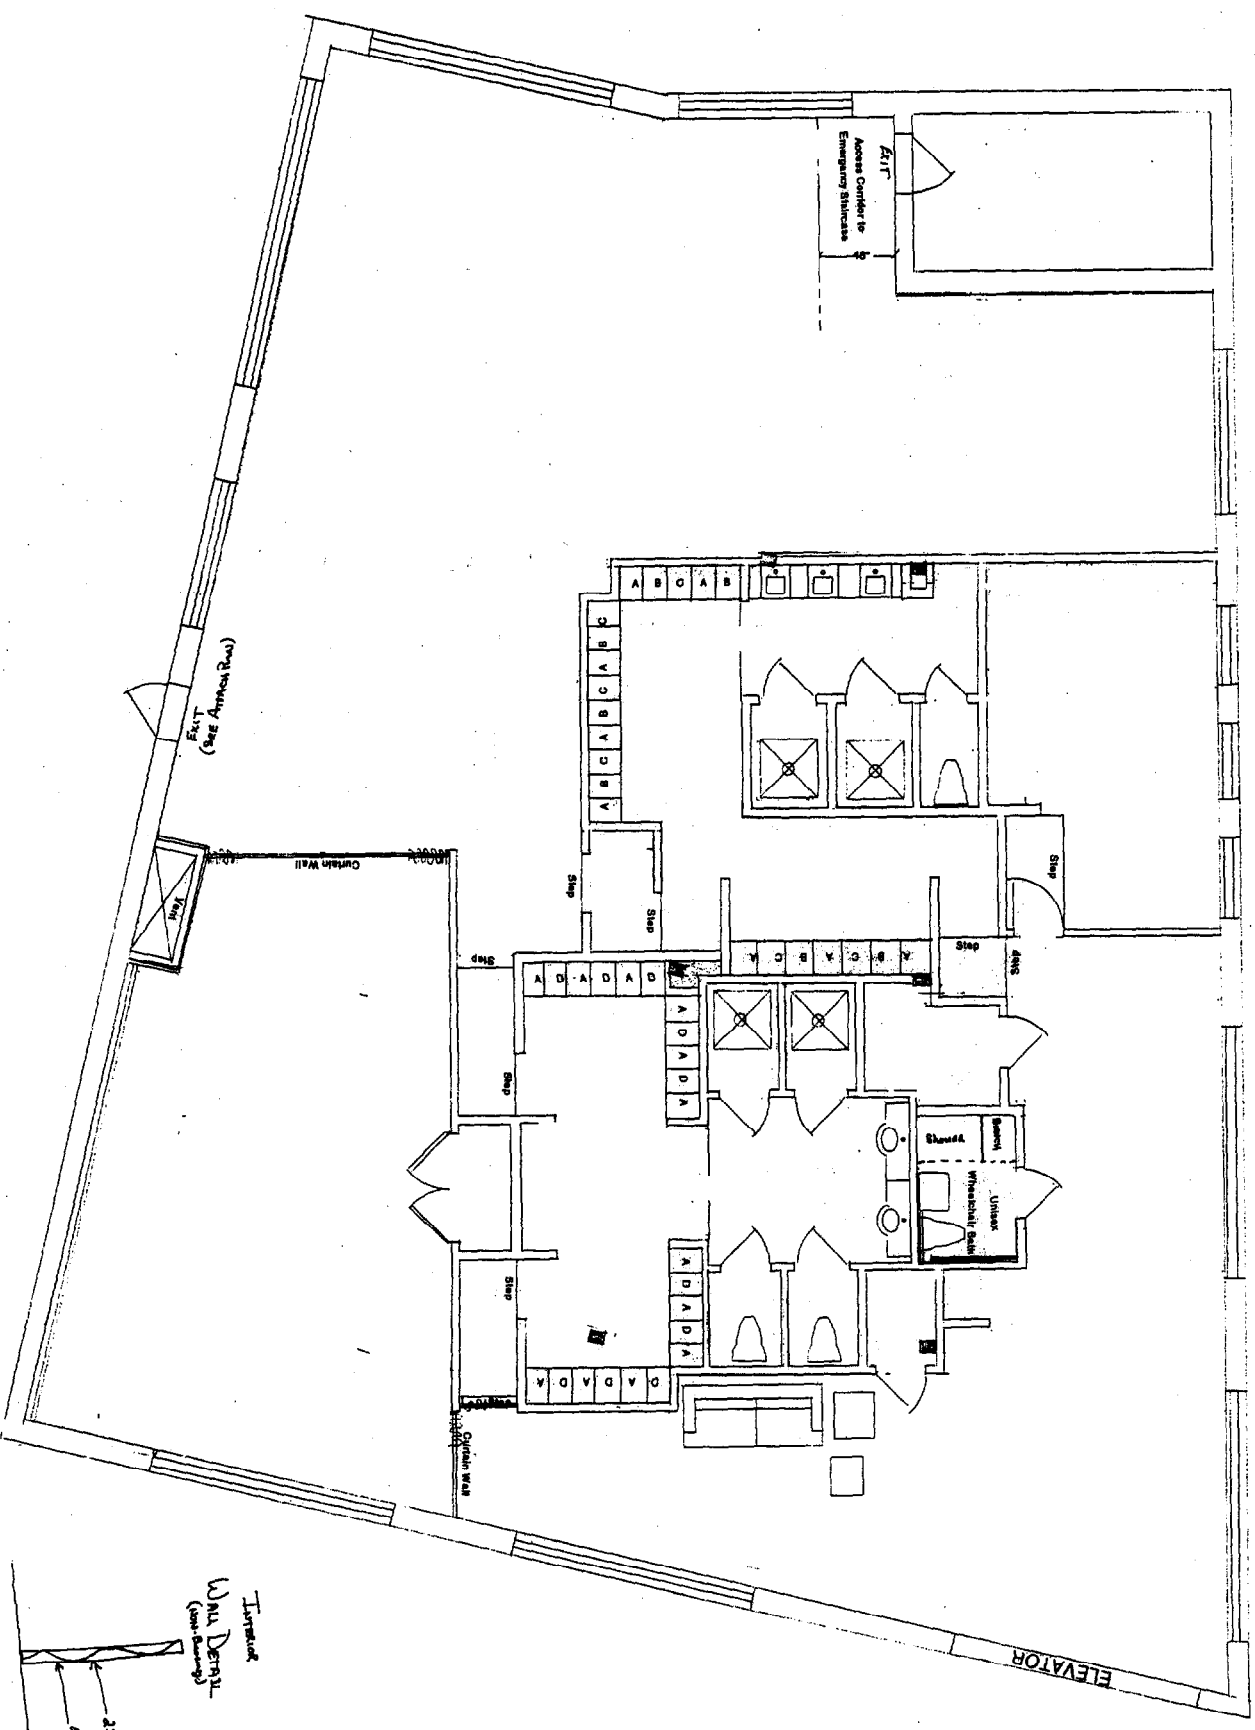

**THE BODY ARCHITECT**

116 - 21st St. New York, N.Y. 10011  
 TEL: 212-691-1000 FAX: 212-691-1001  
 WWW: www.thebodyarchitect.com

**RICHARD W. SADOW Design & Decoration**

Proposed Floor Plan

A2