



- INSTALLATION NOTES**
1. INSULATE ALL HOOD MAKEUP AIR DUCTWORK WITH 2" FSK DUCT WRAP.
 2. INSULATE ALL GREASE DUCT WITH TWO (2) LAYERS OF 1½" 3M FIRE BARRIER DUCT WRAP 615+ IF LOCATED WITHIN 18" OF COMBUSTIBLE CONSTRUCTION.
 3. DESIGN ALL HOOD MAKEUP DUCTWORK AT 2" W.G. AND SEAL PER SMACNA CLASS B SEALING STANDARDS.
 4. KITCHEN HOOD EXHAUST DUCTWORK SHALL BE CONTINUOUSLY WELDED 16 GAUGE STEEL INSTALLED IN ACCORDANCE WITH NFPA 96 REQUIREMENTS. MAINTAIN A MINIMUM OF 18" TO COMBUSTIBLE CONSTRUCTION.
 5. INSTALL GREASE DUCT ACCESS PANELS AS INDICATED AND CONSTRUCT PER NFPA 96. OPENINGS TO BE A MINIMUM OF 1½" UP FROM THE BOTTOM OF THE DUCT.

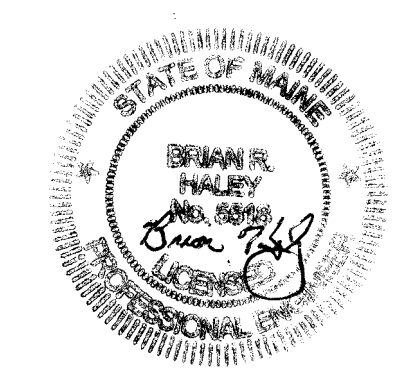

FOR CONSTRUCTION


HALEY'S METAL SHOP, INC.
 539 ELM STREET
 BIDDEFORD, MAINE 04005
 PH: 207-284-8571, FAX: 207-284-9597

DATE: 12/22/16

SCALE: 3/8"=1'-0"

**CONG TU BOT RESTAURANT
 PORTLAND, MAINE
 KITCHEN VENTILATION PLAN**

HVAC

M-1