




1 TYPICAL WALL HANDRAIL SECTION 3" = 1'-0"

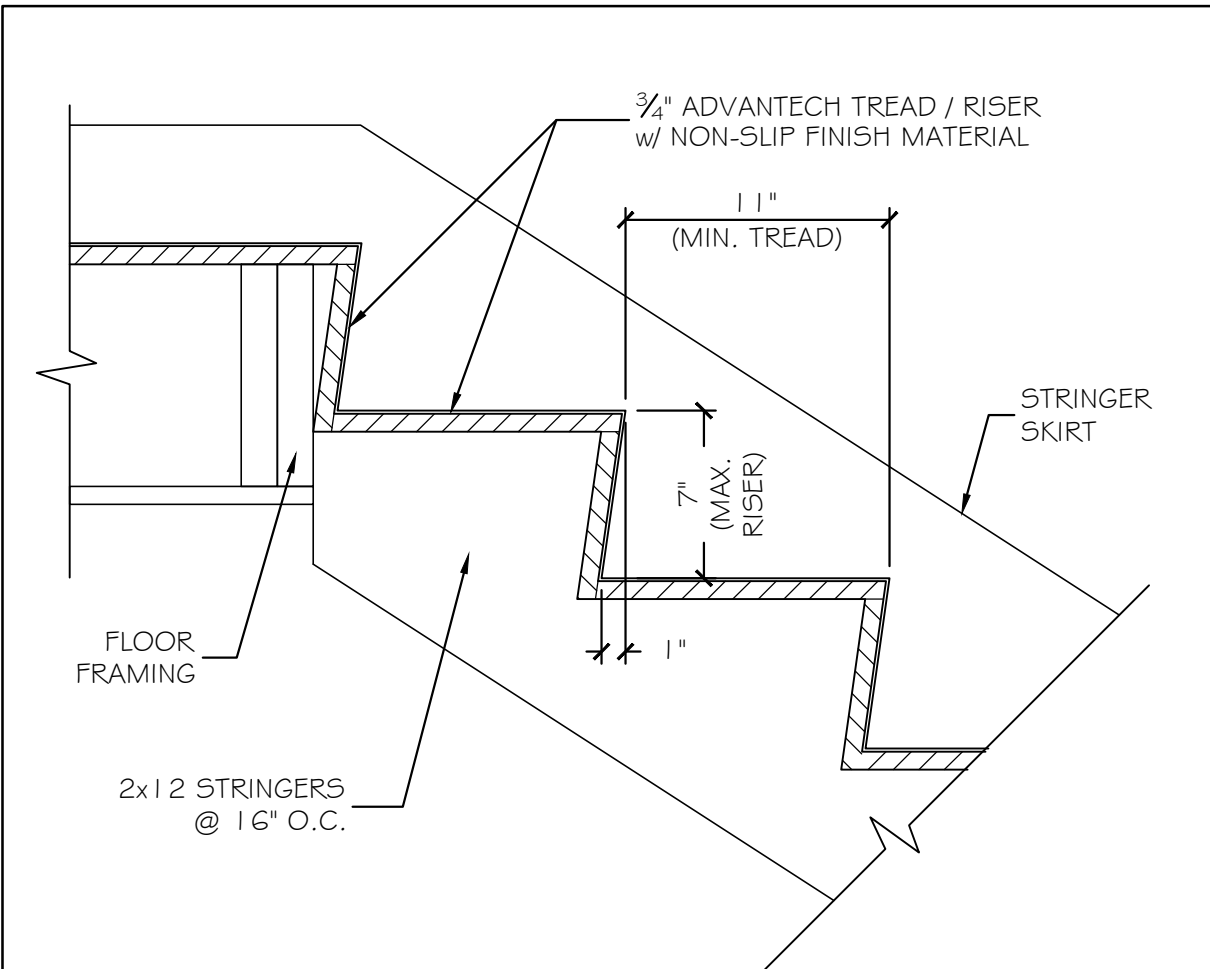


5 METAL STAIR RISE / RUN DETAIL 1 1/2" = 1'-0"

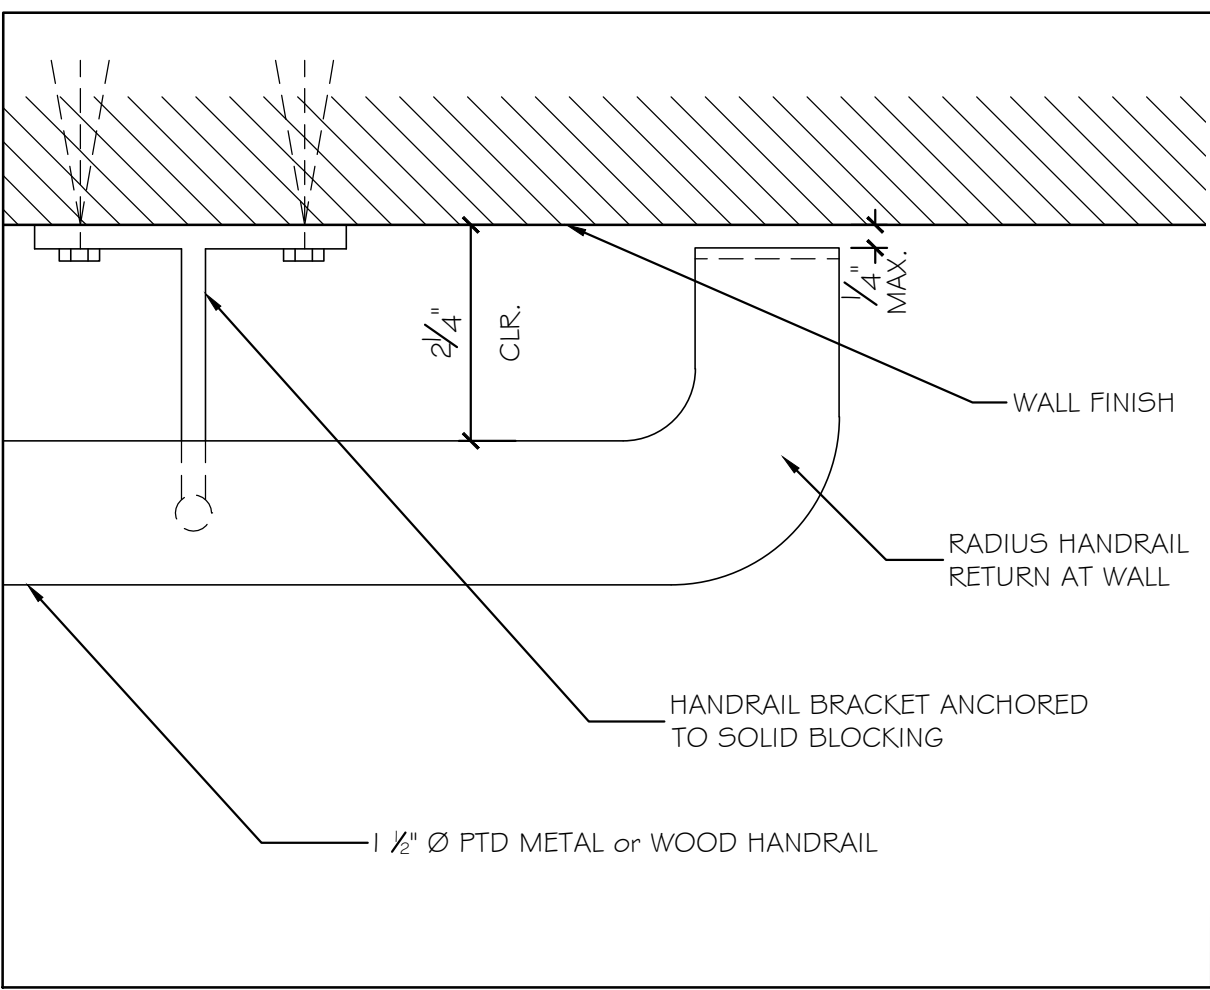


2 HANDRAIL RETURN AT WALL 6" = 1'-0"

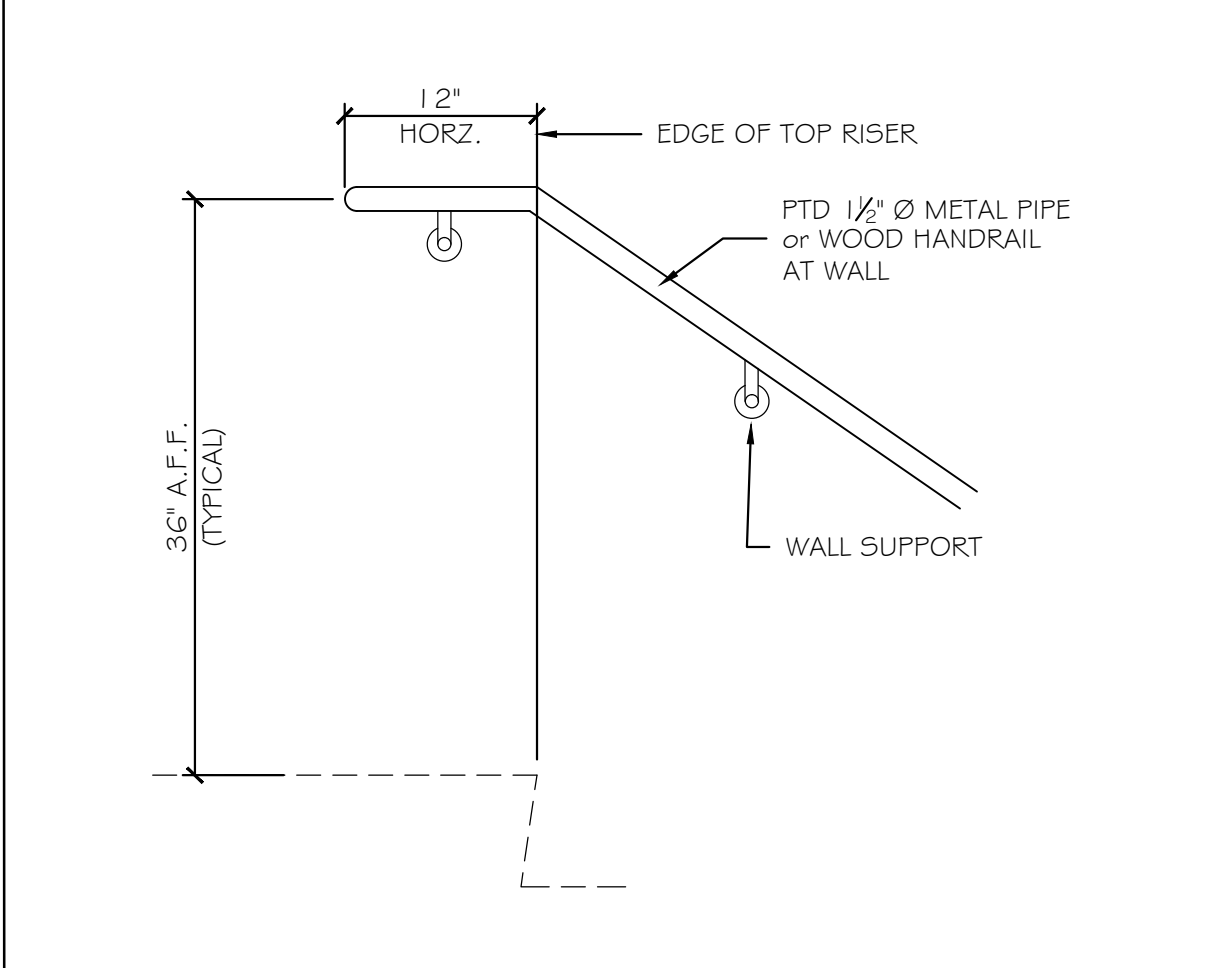

3 TYPICAL WALL HANDRAIL - TOP 1" = 1'-0"

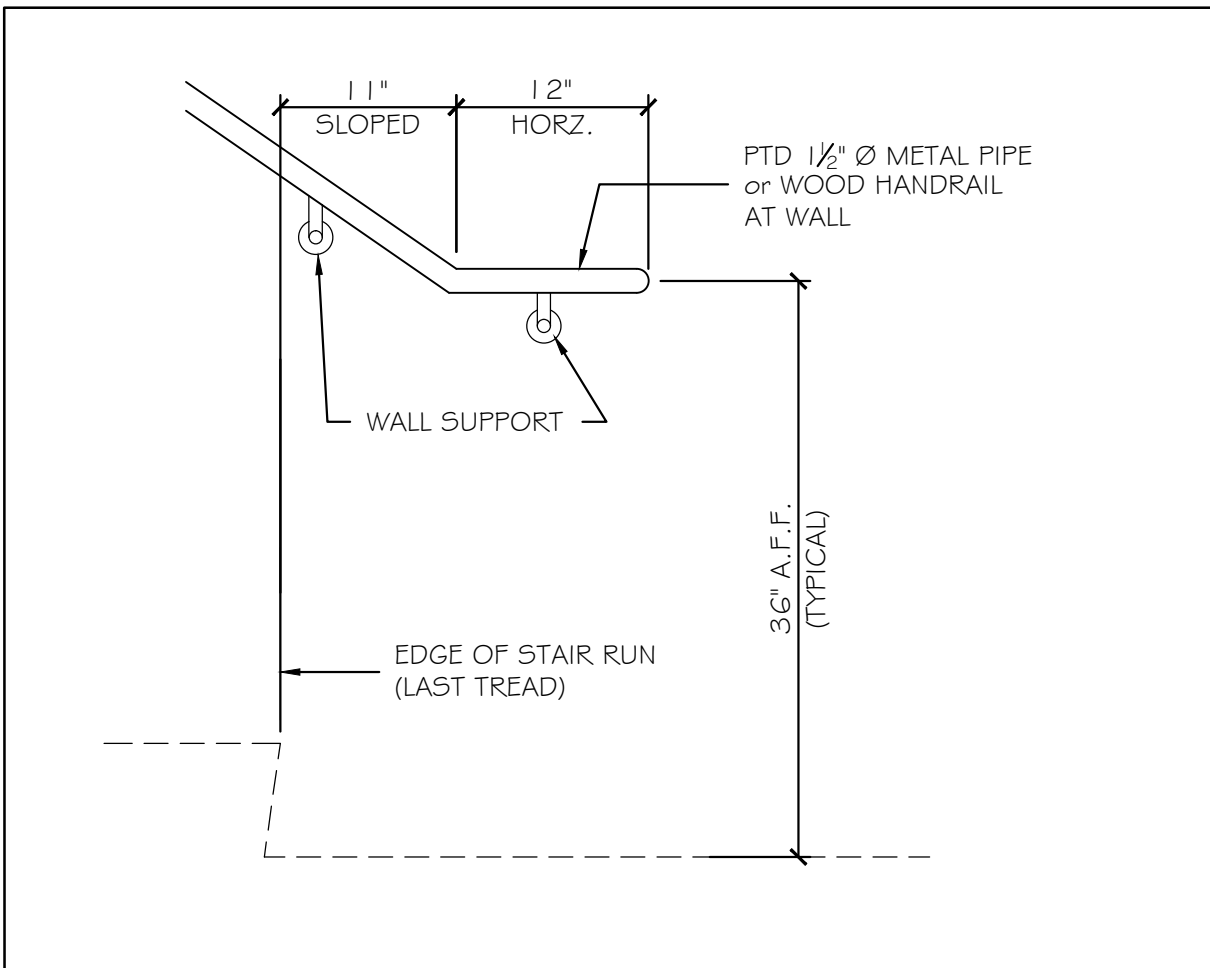

4 TYPICAL WALL HANDRAIL - BOTTOM 1" = 1'-0"

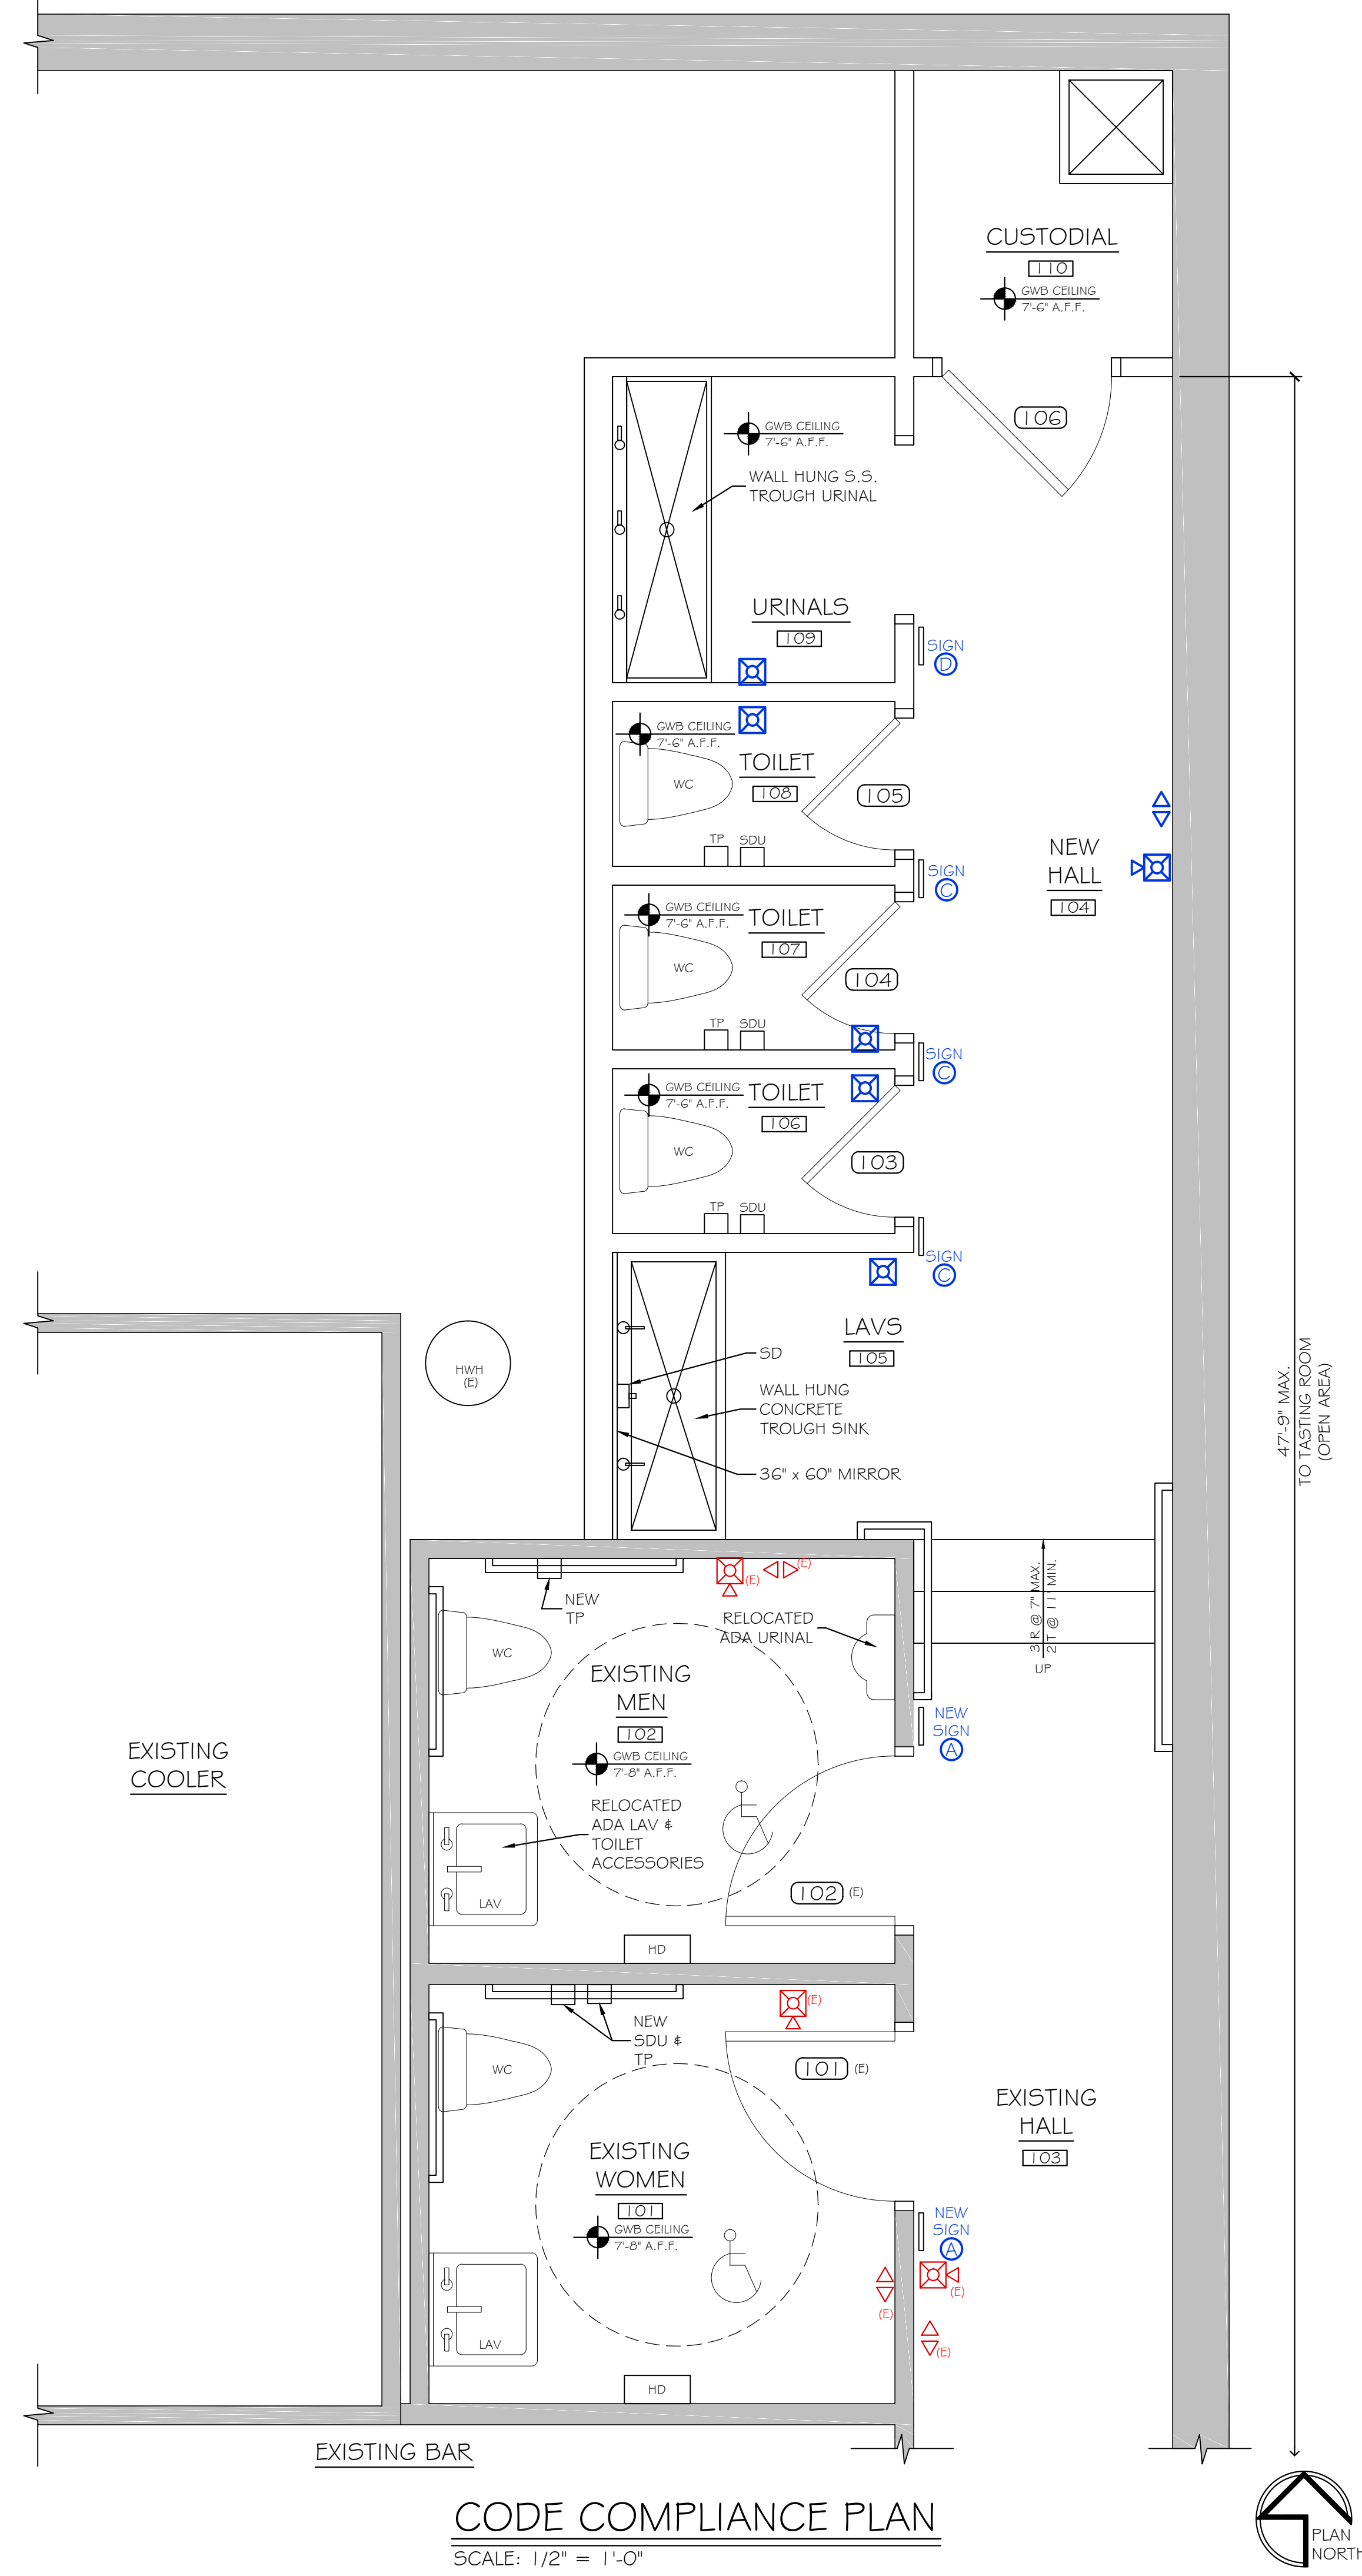


CODE COMPLIANCE PLAN SCALE: 1/2" = 1'-0"

NFPA LEGEND

SYMBOL	DESCRIPTION
(E)	EXISTING FIXTURE
◀▶	EMERGENCY LIGHT
◻	HORN / STROBE UNIT
◻	STROBE UNIT

- LIFE SAFETY NOTES**
- THE ENTIRE BUILDING HAS AN EXISTING NFPA 13 FIRE SUPPRESSION SPRINKLER SYSTEM. SPRINKLER SYSTEM SHALL BE MODIFIED FOR NEW CONFIGURATION, THEN REVIEWED AND APPROVED BY THE STATE OF MAINE FIRE MARSHAL AS WELL AS THE LOCAL AUTHORITY HAVING JURISDICTION. THE SPRINKLER CONTRACTOR SHALL BEAR SOLE RESPONSIBILITY FOR THE DESIGN AND INSTALLATION OF THE SYSTEM FOR OCCUPANCY. VERIFY SPRINKLER ROOM REQUIREMENTS WITH THE TOWN OF GORHAM ORDINANCES AND AUTHORITY HAVING JURISDICTION.
 - THE BUILDING HAS AN EXISTING FIRE ALARM SYSTEM IN FOR COMPLIANCE WITH NFPA 101 LIFE SAFETY CODE. COORDINATE WITH SPRINKLER SYSTEM FOR FIRE ALARM SYSTEM WORK. VERIFY LOCATION OF ALARMS WITH THE AUTHORITY HAVING JURISDICTION.
 - SEE ACCESSIBILITY DETAILS ON SHEET A-3 FOR MOUNTING HEIGHTS OF LIFE SAFETY DEVICES.
 - SEE SHEET A-3 FOR SIGNAGE.

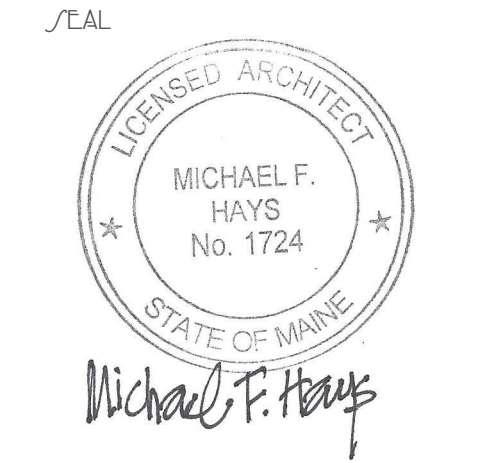

REVISIONS

PROJECT NAME

RENOVATION TO
OXBOW BLENDING & BOTTLING
TOILET ROOM

49 WASHINGTON AVENUE PORTLAND, MAINE 04101

MEET

CODE COMPLIANCE PLAN

DATE: 28 JUNE 2017
SCALE: 1/2" = 1'-0"
DRAWN: MFH / mgk
JOB NO.: 170608