




Install Date: 2017
 Cong Tu Bot
 59 Washington Ave
 Portland, ME 04101

Allstate Fire Equipment
 44 Garden Street
 Danvers, MA 01923
 Linc Mulno
 781-224-1001
 lmulno@lfpfire.com
 MACR 4612

Cong Tu Bot R-102
 R-102

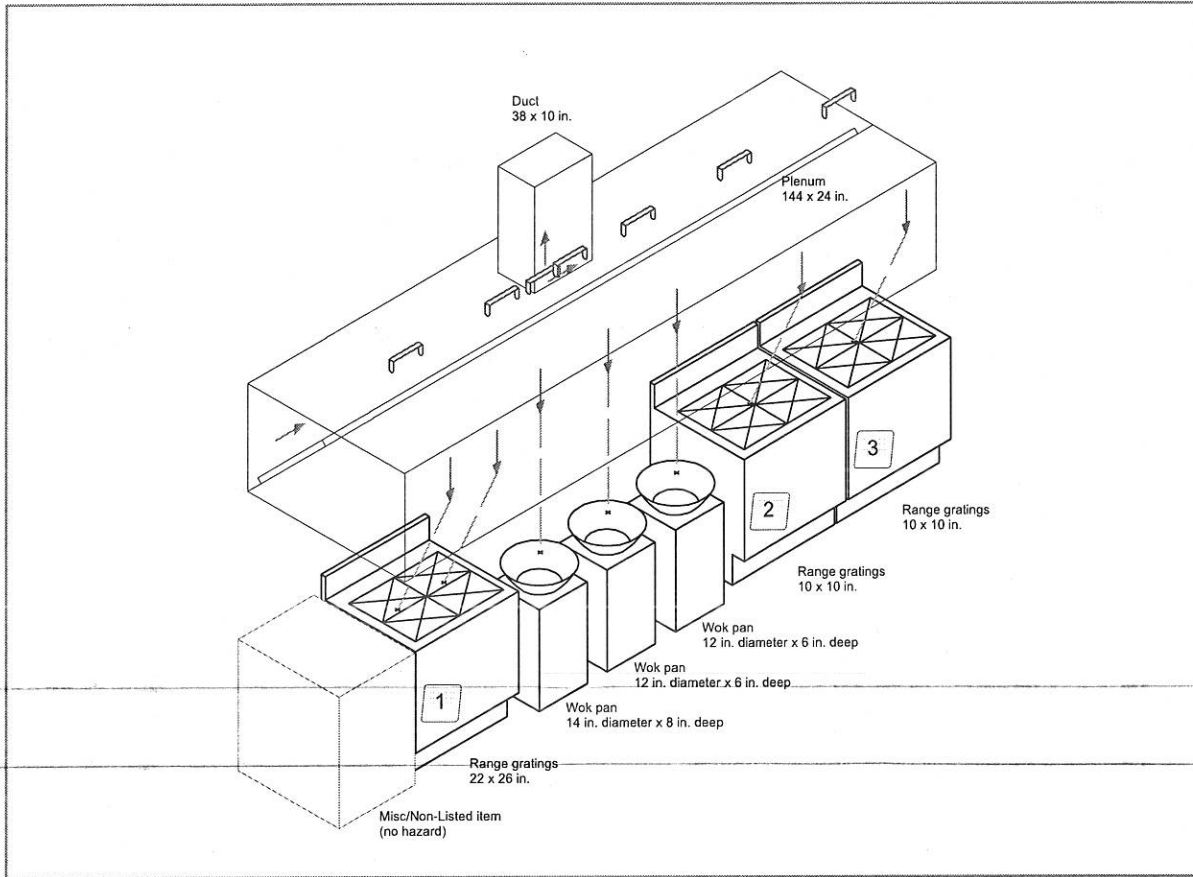

Flow Summary:

Coverage	Overall Dimensions	Nozzle	Flows	Nozzle Location
Hood: Single Bank	144 x 54 in.	1N x2	2	2-4 in. from filter face, center of height dimension, aimed down filter length.
Duct: Square	38 x 10 in.	2W	2	2-8 in. into center of duct opening, aimed up
Range: 4 burners	26 x 32 in.	1F x2	2	40-48 in., front edge of burner, nozzle flats parallel with burner front-to-rea ... See Note 1
Wok	16 x 16 in.	260	2	35-45 in., 0-1 in. from wok center, aimed at center
Wok	16 x 14 in.	1N	1	30-40 in., along/within wok perimeter, aimed at center
Wok	16 x 14 in.	1N	1	30-40 in., along/within wok perimeter, aimed at center
Range: 2 burners	16 x 32 in.	1F	1	40-48 in., front edge of burner, nozzle flats parallel with burner front-to-rea ... See Note 2
Range: 2 burners	24 x 32 in.	1F	1	40-48 in., front edge of burner, nozzle flats parallel with burner front-to-rea ... See Note 3
Total Flow Points			12	