



INSTALL STRICTLY PER
UNDERWRITERS LABORATORIES INC.
ASSEMBLY DESIGN
& USG RECOMMENDATIONS FOR FIRE
& ACOUSTICAL ASSEMBLIES
UL DESIGN # L-514

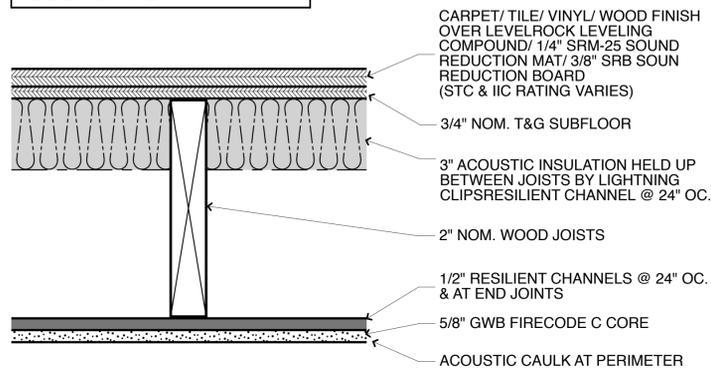


4 Floor/ceiling: Min. 1-HR Fire / 50-STC / 50-IIC rating
NOT TO SCALE

INSTALL STRICTLY PER
UNDERWRITERS LABORATORIES INC.
ASSEMBLY DESIGN
& USG RECOMMENDATIONS FOR FIRE
& ACOUSTICAL ASSEMBLIES
UL DESIGN # U-348

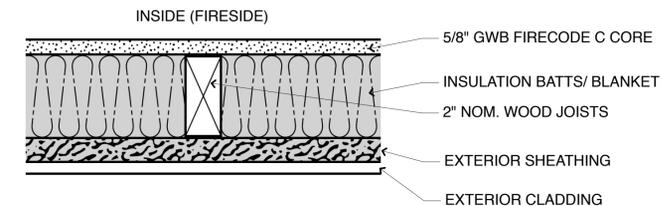


1 Exterior wall: 1-HR rated from within only
NOT TO SCALE

INSTALL STRICTLY PER
UNDERWRITERS LABORATORIES INC.
ASSEMBLY DESIGN
& USG RECOMMENDATIONS FOR FIRE
& ACOUSTICAL ASSEMBLIES
UL DESIGN # L-311

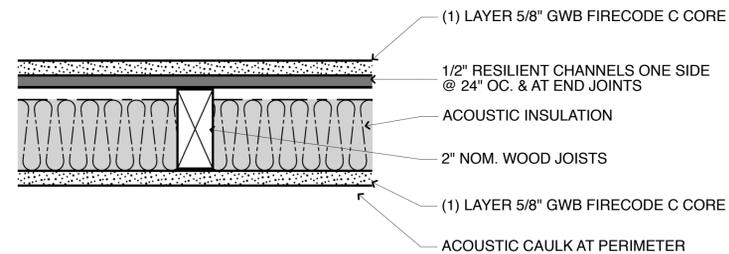

2 Interior wall: Min. 1-HR Fire / 50-STC rating
NOT TO SCALE

INSTALL STRICTLY PER
UNDERWRITERS LABORATORIES INC.
ASSEMBLY DESIGN
& USG RECOMMENDATIONS FOR FIRE
& ACOUSTICAL ASSEMBLIES
UL DESIGN # U-334

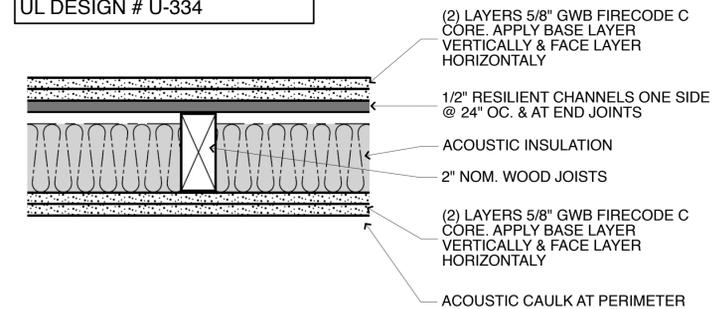

3 Interior wall: Min. 2-HR Fire / 59-STC rating
NOT TO SCALE