



INSTALL STRICTLY PER  
UNDERWRITERS LABORATORIES INC.  
ASSEMBLY DESIGN  
& USG RECOMMENDATIONS FOR FIRE  
& ACOUSTICAL ASSEMBLIES  
**UL DESIGN # L-514**

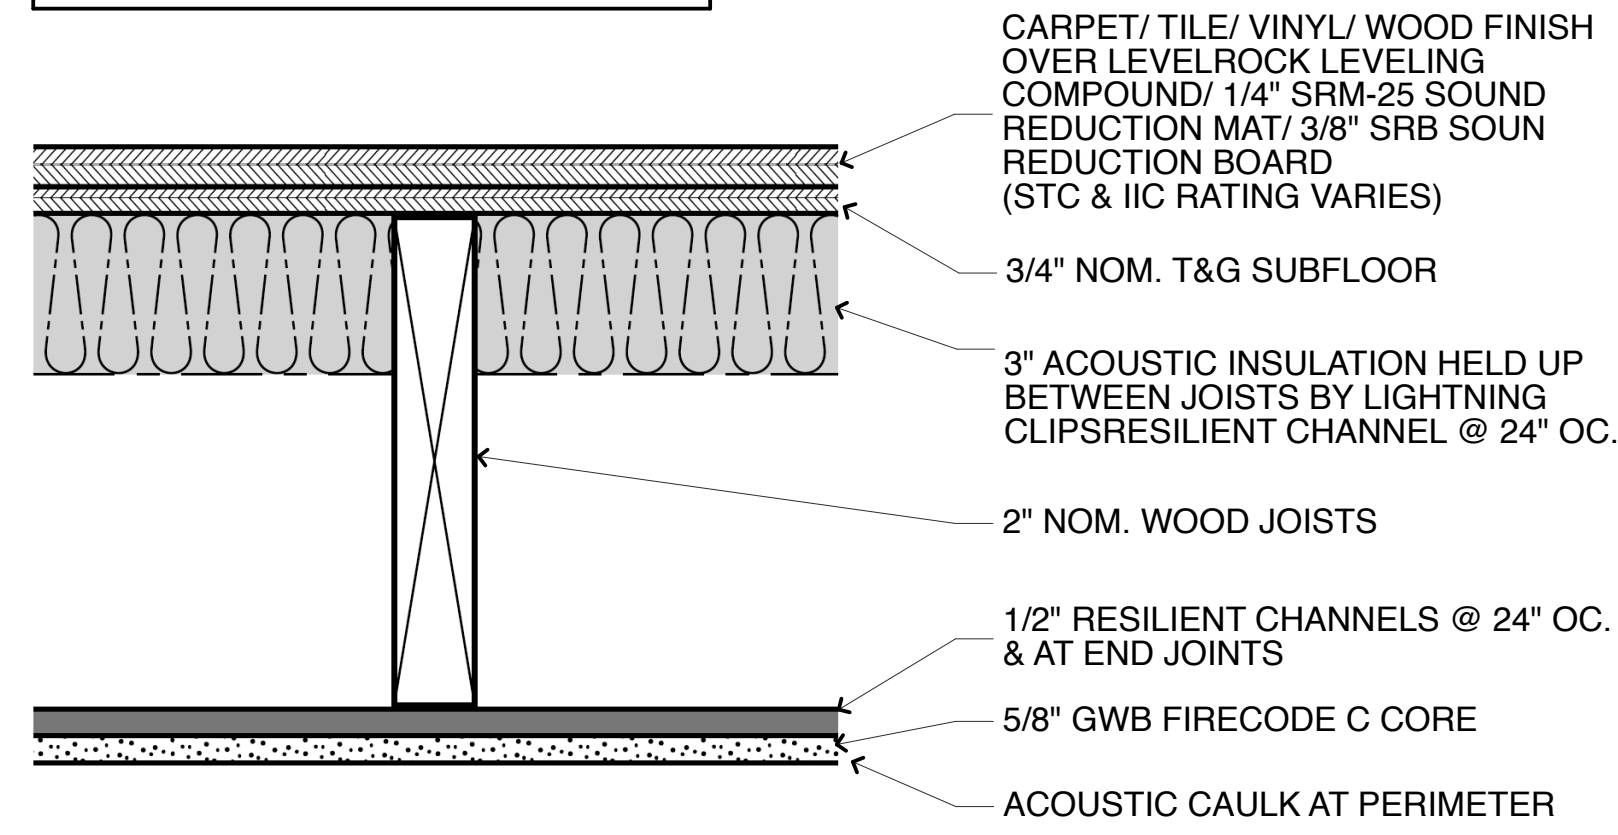


**4** Floor/ceiling: Min. 1-HR Fire / 50-STC / 50-IIC rating  
NOT TO SCALE

INSTALL STRICTLY PER  
UNDERWRITERS LABORATORIES INC.  
ASSEMBLY DESIGN  
& USG RECOMMENDATIONS FOR FIRE  
& ACOUSTICAL ASSEMBLIES  
**UL DESIGN # U-348**

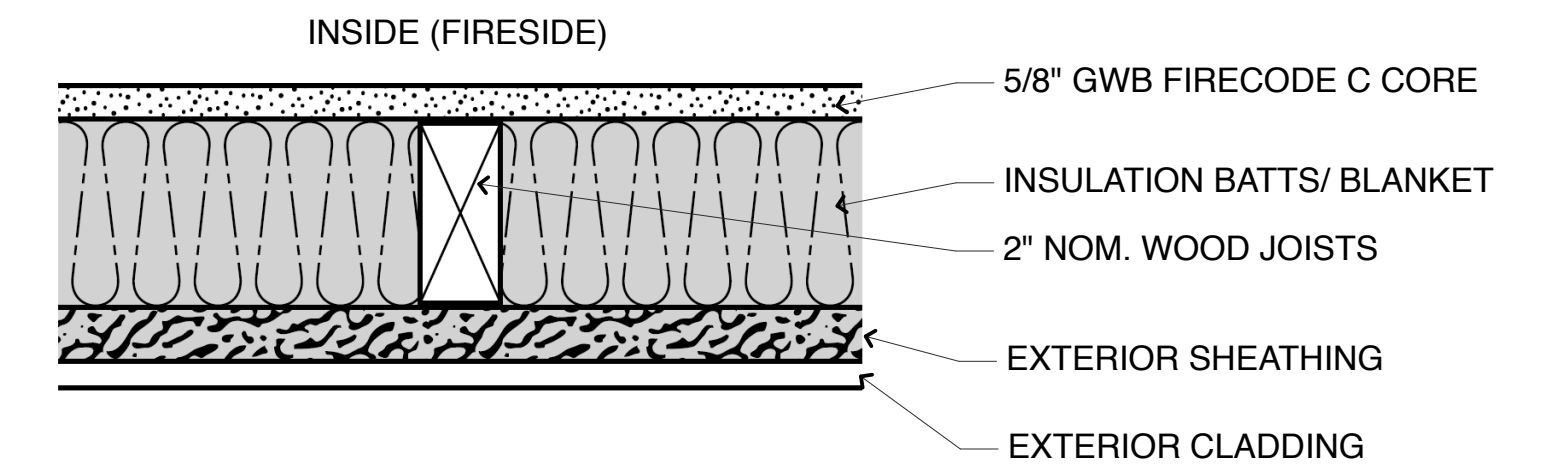


**1** Exterior wall: 1-HR rated from within only  
NOT TO SCALE

INSTALL STRICTLY PER  
UNDERWRITERS LABORATORIES INC.  
ASSEMBLY DESIGN  
& USG RECOMMENDATIONS FOR FIRE  
& ACOUSTICAL ASSEMBLIES  
**UL DESIGN # L-311**

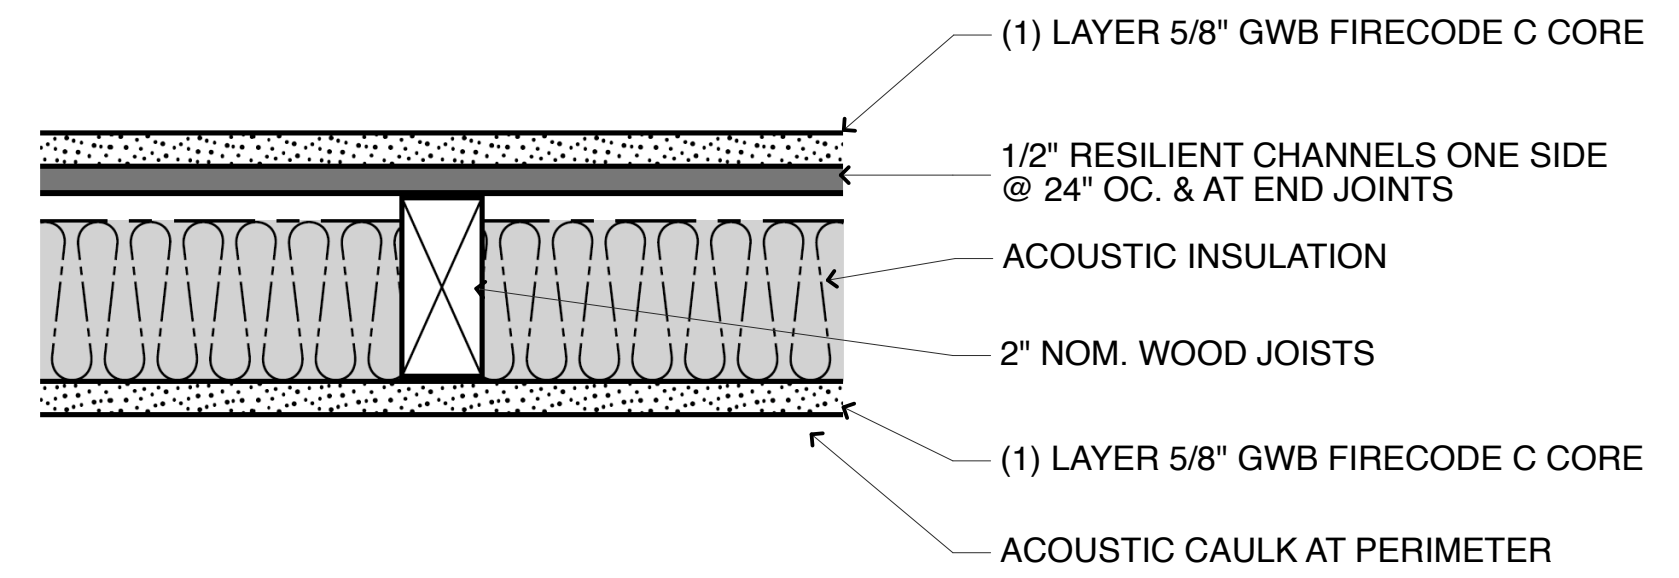

**2** Interior wall: Min. 1-HR Fire / 50-STC rating  
NOT TO SCALE

INSTALL STRICTLY PER  
UNDERWRITERS LABORATORIES INC.  
ASSEMBLY DESIGN  
& USG RECOMMENDATIONS FOR FIRE  
& ACOUSTICAL ASSEMBLIES  
**UL DESIGN # U-334**

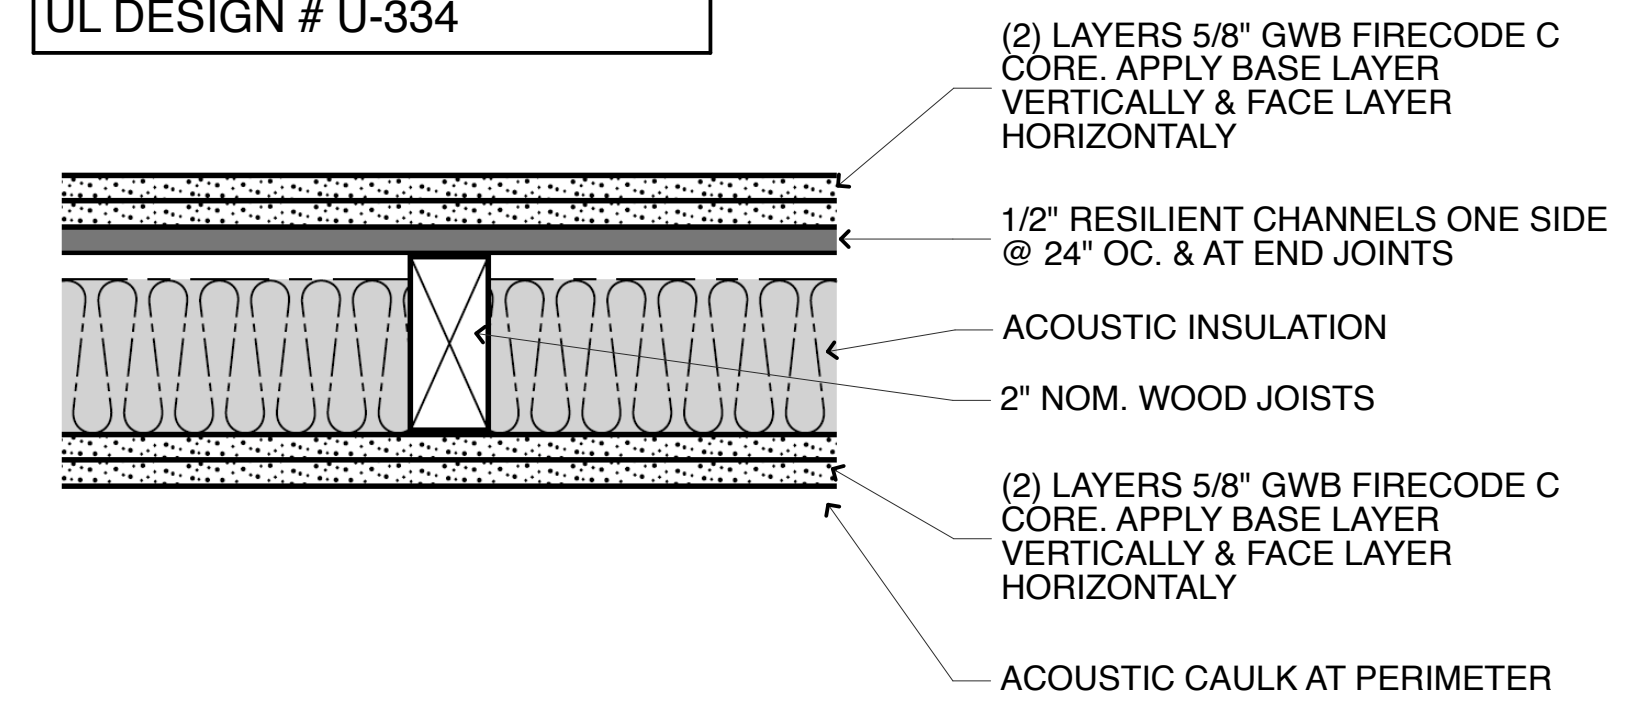

**3** Interior wall: Min. 2-HR Fire / 59-STC rating  
NOT TO SCALE