


Calucci's Portland Me.
Side View
Exhaust. Duct
Install

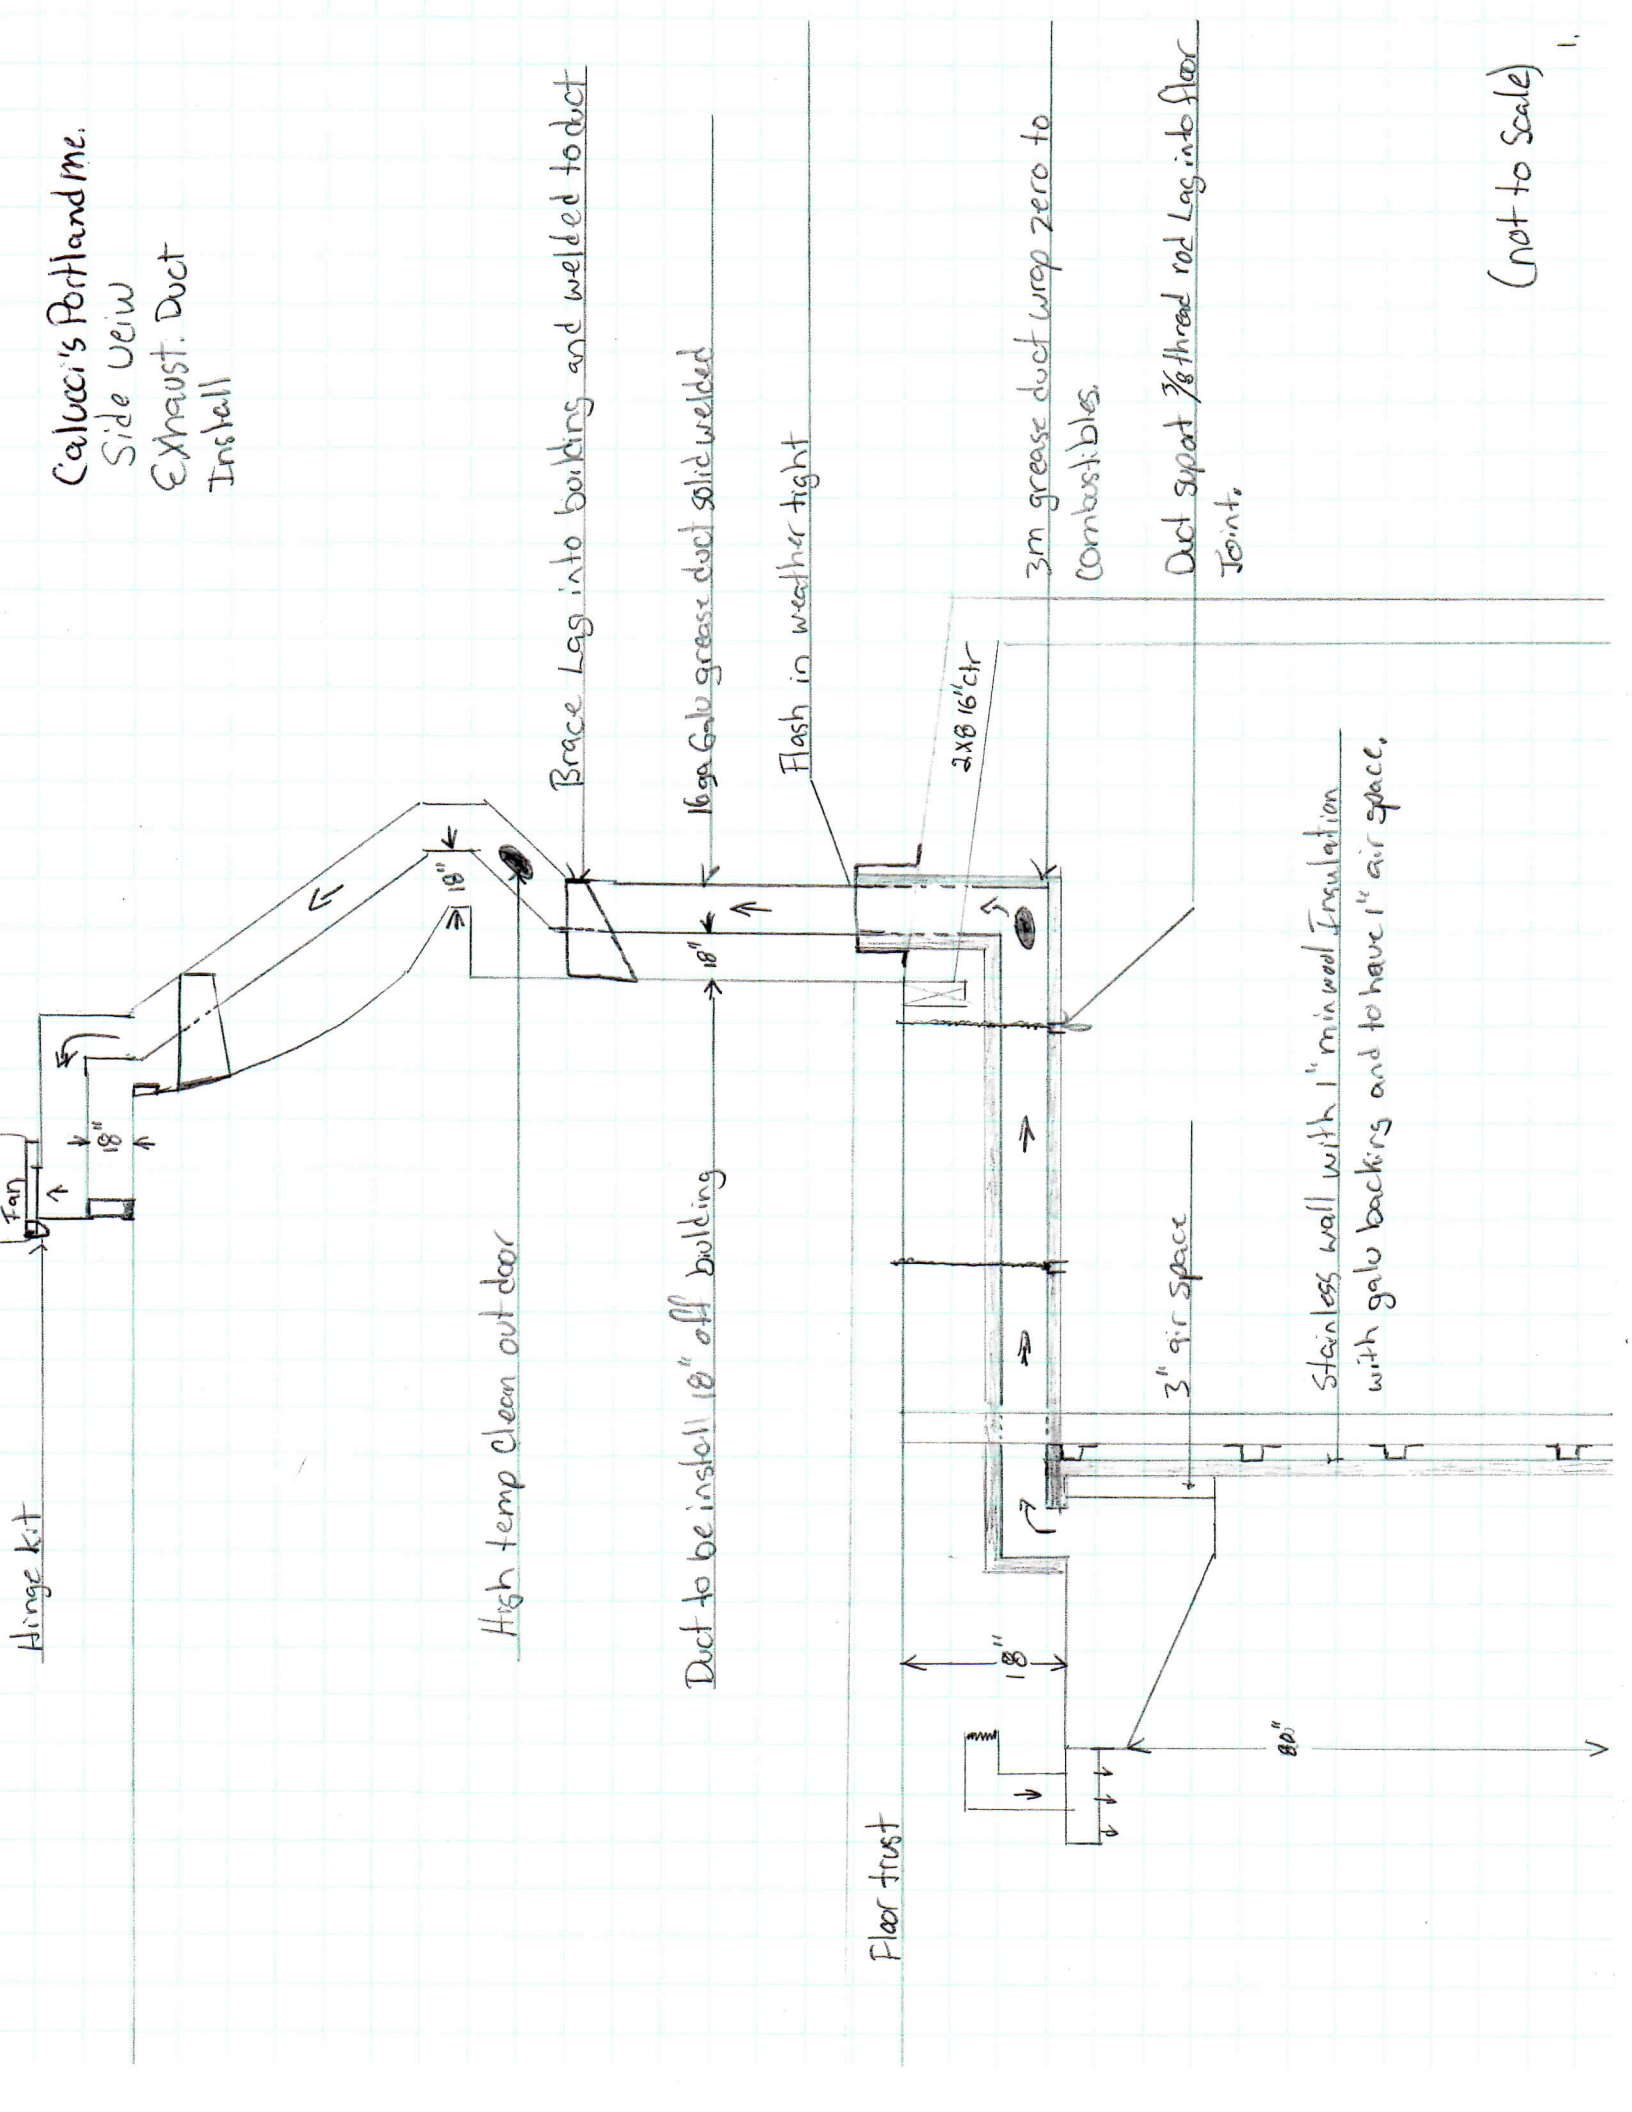

Hinge kit

High temp clean out door

Brace Lag into building and welded to duct

Duct to be install 18" off building

16 ga Galv grease duct solid welded

Flash in weather tight

Floor truss

2x8 16'ctr

3mm grease duct wrap zero to combustibles.

Duct support 3/8 thread rod Lag into floor joint.

Stainless wall with 1" mineral Insulation with galv backing and to have 1" air space.

3" air space

80"

(not to scale)