FACP	FIRE ALARM CONTROL PANEL, MOUNT WITH TOP OF PANEL NOT MORE THAN 72"AFF
FAA	FIRE ALARM ANNUNCIATOR, MOUNT WITH TOP OF PANEL NOT MORE THAN 72"AFF
S	SMOKE DETECTOR
H	HEAT DETECTOR
D	DUCT SMOKE DETECTOR
RTS	REMOTE TEST/INDICATOR FOR DUCT SMOKES, MOUNT ON CEILING BENEATH UNIT, OR WALL MOUNT WHERE INDICATED ON PLANS
SRLY	SUPRESSOR RELAY FOR HOOD
P	MANUAL PULL STATION, MOUNT 48"AFF
H	MINI HORN ~ MOUNT 80"AFF TO BOTTOM OR 6" BELOW CEILING WHICHEVER IS LOWER.
30 C	HORN/STROBE APPLIANCE, 15 CANDELA OR AS NOTED ON PLANS, MOUNT 80"AFF TO BOTTOM OR 6" BELOW CEILING WHICHEVER IS LOWER 'C' INDICATES CEILING MOUNTED UNIT 'E' INDICATES EXTERIOR RATED UNIT
C	VISUAL INDICATING APPLICANCE, 15 CANDELA OR AS NOTED ON PLANS, MOUNT 80"AFF TO BOTTOM OR 6" BELOW CEILING WHICHEVER IS LOWER 'C' INDICATES CEILING MOUNTED UNIT 'E' INDICATES EXTERIOR RATED UNIT
F	SPRINKLER SYSTEM WATER FLOW SWITCH
T	SPRINKLER SYSTEM TAMPER SWITCH
K	KNOX BOX, MOUNT AT LOCATION ACCEPTABLE TO AHJ

2 FA-6 FIRE ALARM LEGEND

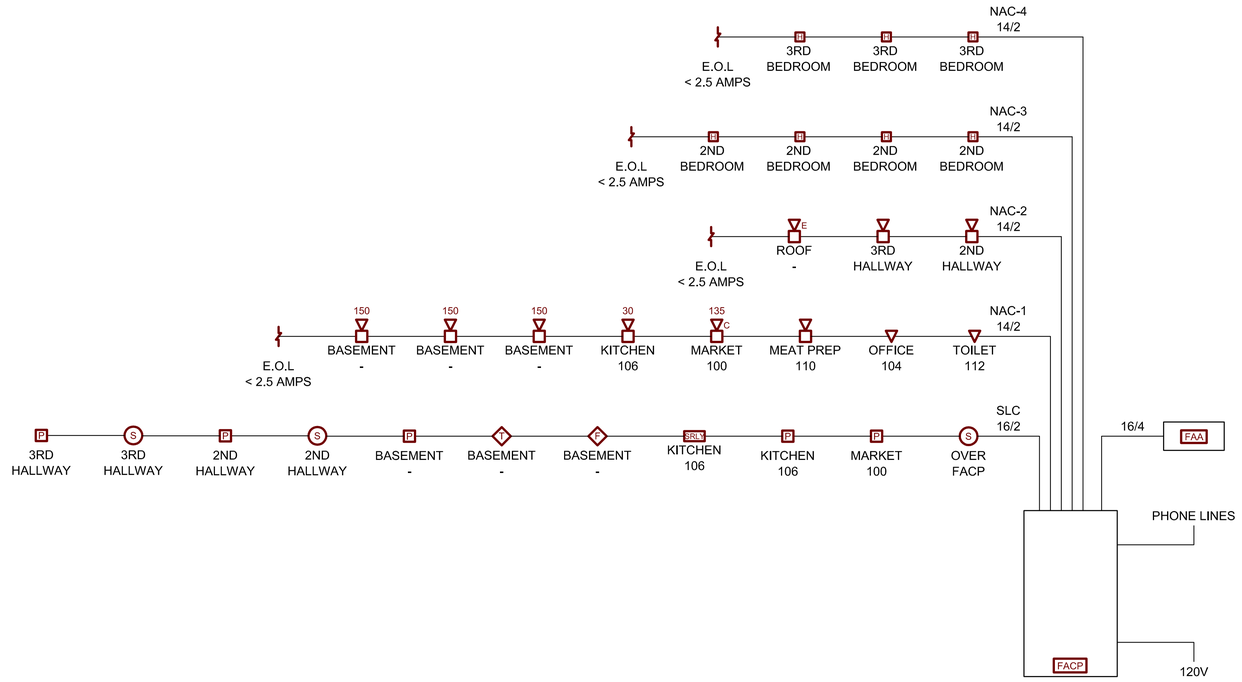

1 FA-6 FIRE ALARM RISER DETAIL

SCALE: N/A

FIRE DEPARTMENT STAMP

connectivity point
Design & Installation
Connectivity Point Design & Installation
P.O. Box 1429
Auburn, ME 04211-1268
Toll Free (Inside only): 1-866-760-0000
Office: (207) 782-0000 Fax: (207) 753-0000
Email: info@connectivitypoint.com

REVISIONS

NUMBER	DATE	BY	DESCRIPTION

Date: 11JUN2014 (24X36)
Drawn By: CRH
Checked By: TP
Project Mgr: TP
Project No: CHS
Cad File: CHS-FA-PLANS.DWG
Graphic Scale: 0 1"

FIRE ALARM RISER PLAN

COLUCCI'S HILLTOP SUPERETTE
135 CONGRESS ST
PORTLAND MAINE

© COPYRIGHT 2014 CONNECTIVITY POINT LLC

FA-6

11JUN2014