

- (1) GENERAL NOTES:  
 A. FIRE ALARM SYSTEM WIRING SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE APPLICABLE STATE AND LOCAL CODES, AND SHALL BE COORDINATED WITH THE LOCAL AUTHORITY HAVING JURISDICTION.  
 B. CAUTION: DO NOT CONNECT ANY POWER TO THE CONTROL PANEL (BATTERIES OR 120V AC) UNTIL ALL OTHER FIELD WIRING IS TESTED AND CONNECTED.  
 C. DO NOT INSTALL FIRE ALARM CONTROL PANEL OR SMOKE DETECTORS IN AN UNHEATED AREA.  
 D. DO NOT INSTALL ANY AC CURRENT-CARRYING CONDUCTORS CLOSE TO OR IN THE SAME RACEWAY WITH FIRE ALARM SYSTEM CONDUCTORS.  
 E. SOLID LINES REPRESENT CONNECTIONS TO BE MADE BY THE SYSTEM INSTALLER.  
 F. ALL RELAYS ARE SHOWN IN NORMAL SUPERVISORY CONDITION. ALL RELAYS ARE FORM "C" TYPE.  
 G. STROBES INSTALLED IN BEDROOMS SHALL BE LOCATED IN A SYMMETRICAL MANNER DOWN CENTER OF HALL WAY WHEN POSSIBLE.

- INSTALLATION NOTES  
 A. SMOKE DETECTORS SHALL NOT BE MOUNTED ANY CLOSER THAN 3' FROM ANY AIR DUCT OPENINGS.  
 B. ELEVATOR LOBBY SMOKE DETECTORS SHALL BE MOUNTED WITHIN 10' OF THE ELEVATOR DOOR OPENINGS.  
 C. MANUAL PULL STATIONS SHALL BE MOUNTED PER ADA REQUIREMENTS: 48" AFF OR 42" AFF TO COMPLY WITH SIDE/FRONT REACH REQUIREMENTS.  
 D. WALL MOUNTED HORN/STROBES & STROBES SHALL BE MOUNTED 6" FROM CEILING, OR 96" TO 80" AFF TO THE CENTER OF STROBE.  
 E. HORN/STROBES & STROBES SHALL BE MOUNTED 15' FROM THE CORNER OF THE WALL. IF THIS IS NOT POSSIBLE, DEVICE SHALL BE CENTERED ON THAT WALL.  
 F. CEILING MOUNTED HALLWAY DEVICES SHALL BE LOCATED IN A SYMMETRICAL MANNER DOWN CENTER OF HALLWAY WHEN POSSIBLE.


- (2) SEE INITIATION CIRCUITS AND NAC CIRCUITS FOR INTEGRATION OF BOTH SLC AND NAC CIRCUITS  
 (3) ALL CABLING IS 14/2 FOR THE NAC CIRCUITS UNLESS OTHERWISE SHOWN  
 (4) ALL CABLING IS 16/2 FOR THE SLC CIRCUITS UNLESS OTHERWISE SHOWN  
 (5)


AC = ALARM CONTROL MODULE  
 R - ARM = ADDRESSABLE RELAY MODULE  
 AV = AUDIO VISUAL DEVICE  
 (SET TO 75cd UNLESS NOTED OTHERWISE)  
 B = EXTERIOR BEACON  
 CO = CO DETECTOR  
 D = DUAL MODULE  
 DUCT=DUCT DETECTOR MINI MODULE  
 F = FLOW  
 FACP = MAIN FIRE PANEL  
 FS = FRESHMART SMOKE DETECTOR  
 H = HEAT DETECTOR  
 I = ISOLATION MODULES  
 T.S. = TWISTED SHIELDED  
 S/CO = SMOKE/CO DETECTOR (00HC941)  
 RL = REMOTE LIGHT  
 F = FIRE EXTINGUISHER MONITORING

K = KNOX BOX  
 LP = LOW AIR  
 MM = MINI MODULE  
 P = PULL STATION MINI MODULE  
 PS = PRESSURE SWITCH  
 RI = REMOTE INDICATOR  
 S = SMOKE  
 SA = SMOKE WITH AUDIBLE BASE  
 T = TAMPER  
 TS = TEST SWITCH  
 V = VISUAL DEVICE ONLY  
 (SET TO 75cd UNLESS NOTED OTHERWISE)  
 MH = MINI HORN  
 RRS = REMOTE TEST MODULE  
 PS = PULL STATION  
 CL = CORRIDOR LIGHT  
 CO = CO DETECTOR (REQUIRES 24 VDC POWER)  
 SCM = INPUT MODULE

WIRELESS HEAT DETECTIONS

1ST FLOOR - 020 - 029  
 2ND FLOOR - 037 - 046  
 3RD FLOOR - 054 - 063  
 4TH FLOOR - 071 - 079

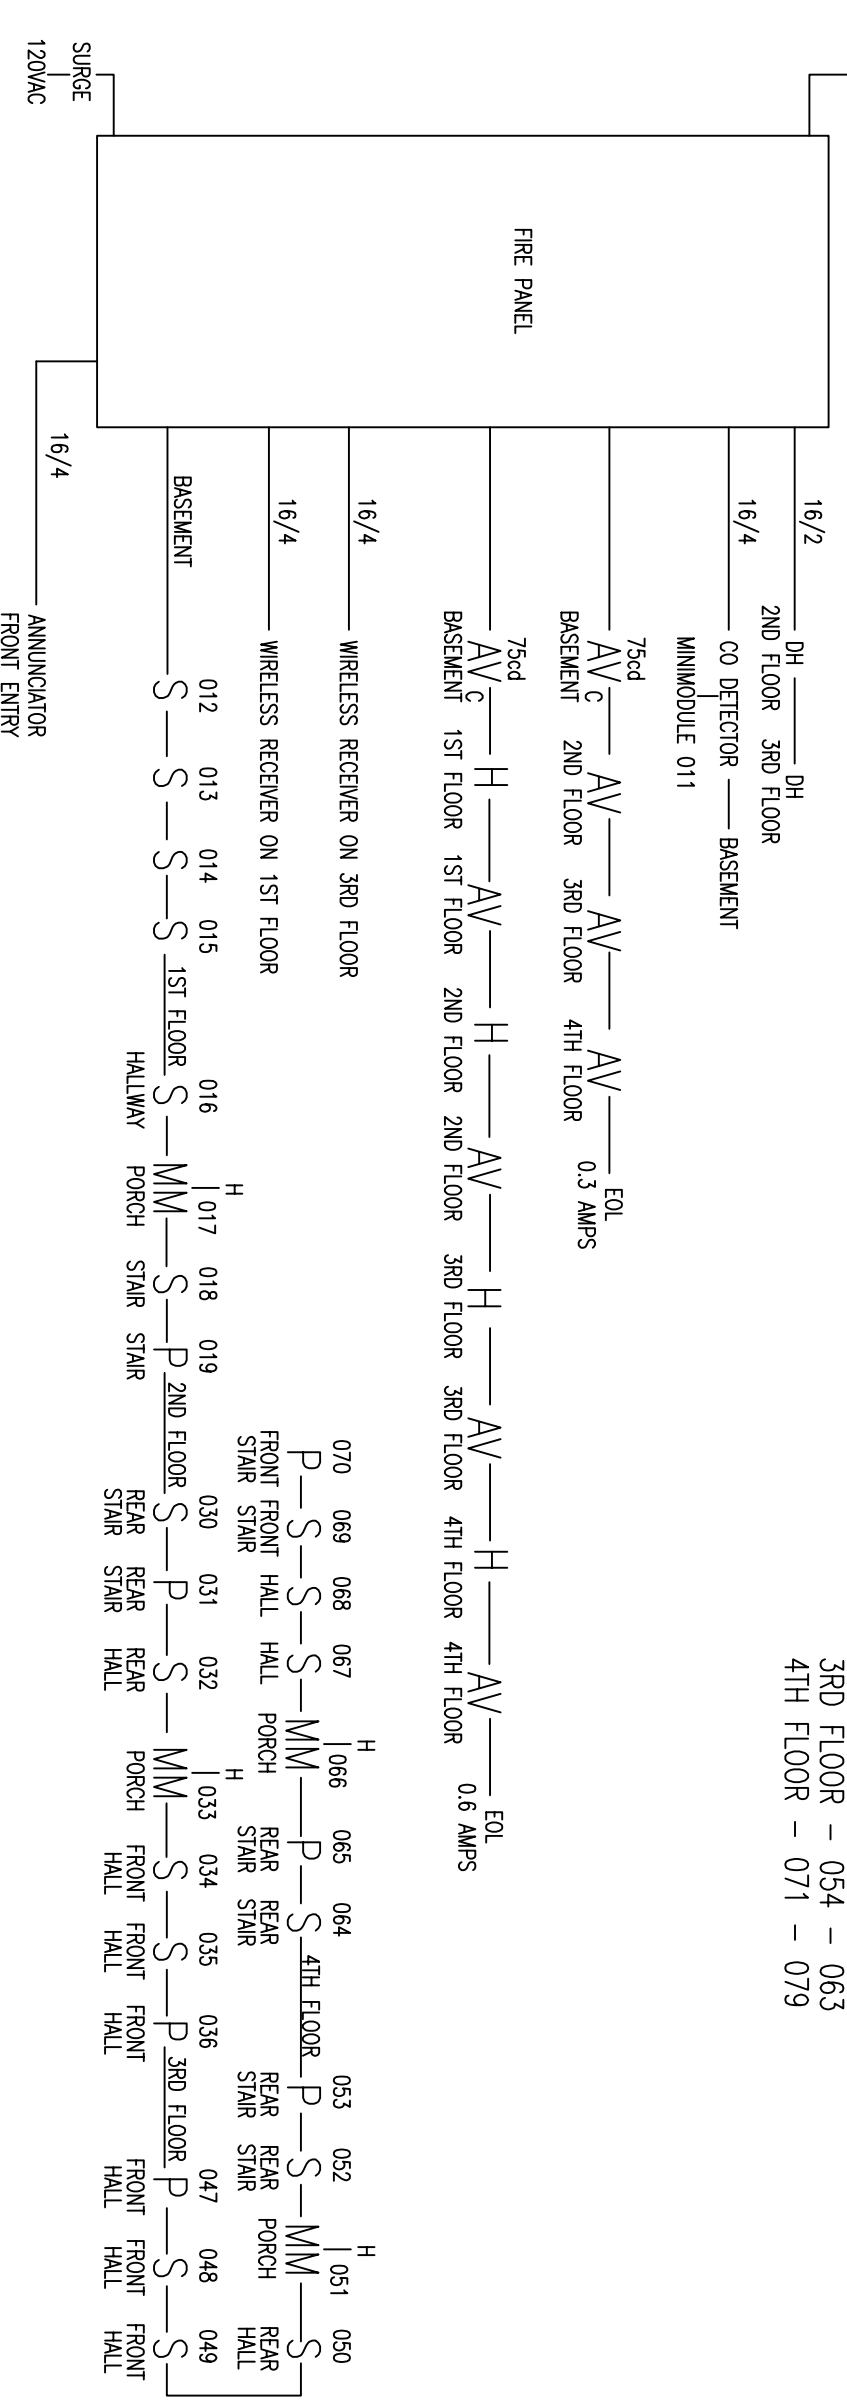

<p>CONSULTANT:</p>  <p>FIRE - SECURITY - ACCESS - CCTV</p> <p>Phone: (207) 775-5755        Fax: (207) 781-2064</p> <p>325 US ROUTE ONE        FALMOUTH, ME 04105</p>		<p>PROJECT:</p> <p><b>119-121 Congress St. Riser</b>  <b>PORTLAND, Maine</b></p>	<p>DRAWING:</p> <p><b>RISERS</b></p>
<p>REVISIONS</p>		<p>DATE: 01/08/17</p> <p>SCALE: NTS</p> <p>DRAWN BY: SSA</p> <p>APPROVED BY: -</p> <p>SHEET: 1</p>	