

NOTE:  
ALL DIMENSIONS TO BE  
CONFIRM FOR ON-SITE  
CONDITIONS, TYP.

# STAIR SECTION

SCALE: 1/4" = 1'-0"

## WINDOW SCHEDULE

NUMBER	DESCRIPTION	ROUGH OPENING	NOTES:
WO-1	DOUBLE HUNG	2'-9 1/2"W x 5'-4" H	
WO-2	DOUBLE HUNG	2'-9 1/2"W x 5'-4" H	
WO-3	DOUBLE HUNG	2'-10"W x 3'-1 1/2" H	
WO-4	DOUBLE HUNG	2'-6 3/4"W x 4'-4" H	
WO-5	DOUBLE HUNG	3'-2"W x 5'-1 1/2" H	EGRESS WINDOW
WO-6	DOUBLE HUNG	3'-2"W x 5'-1 1/2" H	EGRESS WINDOW
WO-7	DOUBLE HUNG	2'-10"W x 3'-1 1/2" H	
WO-8	DOUBLE HUNG	2'-6 3/4"W x 4'-4" H	

## OPENING HEADER SCHEDULE

SPAN	DESCRIPTION	JACK STUDS (NUMBER)	KING STUDS (NUMBER)
3FT	(3) 2x8's	(1) Stud	(0) Studs
4FT	(3) 2x10's	(1) Stud	(1) Studs
6FT	(3) 2x12's	(2) Stud	(2) Studs
8FT	3 1/2"x9 1/4" LVL	(2) Stud	(2) Studs
10FT	3 1/2"x11 1/4" LVL	(3) Stud	N / A
12FT	3 1/2"x11 1/4" LVL	(3) Stud	N / A
15FT	5 1/4"x11 1/4" LVL	(3) Stud	N / A

### CODE REVIEW

MUBEC - MAINE UNIFORM BUILDING AND ENERGY CODE  
2009 INTERNATIONAL RESIDENTIAL BUILDING CODE,  
2009 INTERNATIONAL ENERGY CONSERVATION CODE


### ENERGY CODE NOTES:

1. ALL JOINTS AND PENETRATIONS SHALL BE CAULKED, GASKETED, OR COVERED WITH MOISTURE VAPOR-PERMEABLE WRAPPING MATERIAL.
2. COMPONENT R-VALUES & U-FACTORS SHALL BE LABELED AS CERTIFIED.
3. INSULATION SHALL BE INSTALLED ACCORDING TO MANUFACTURERS INSTRUCTIONS, AND IN A MANNER THAT ACHIEVES THE REQ'D R-VALUE.
4. RECESSED LIGHTING FIXTURES INSTALLED IN THE BUILDING ENVELOPE SHALL BE TYPE C RATED AS MEETING ASTM E283, AND SEALED OR CAULKED.

### RESIDENTIAL SPECIFICATIONS:

- FLOOR SYSTEM:**  
Joists As Indicated  
Bridging at Center  
2x PT Sill w/ Sealer  
Subfloor as Indicated
- EXTERIOR WALLS:**  
2x Studs as Indicated (16" oc)  
Sheathing as Indicated (1/2")  
Air Infiltration Wrap  
Siding/Finish as Indicated
- INTERIOR WALLS:**  
2x4 Studs @ 16" oc  
1/2" Gypboard as Indicated
- ROOF SYSTEM:**  
Rafters/Trusses as Indicated  
Sheathing as Indicated (3/8")  
15# Underlayment  
Ice & Water Shield at Eaves/Valleys  
235# Asphalt Shingles as Indicated
- INSULATION:**  
Exterior Walls R-21  
Attic Cop R-49  
Sills R-19  
Frost Wall R-10
- VENTILATION:**  
Soffit - 2" Contin. Strip  
Ridges - Contin. Shingle  
Circulation Vents Between  
Rafters/Trusses
- BEAMS/HEADERS:**  
(3)2x6 Max. 40" Span  
(3)2x8s Max 80" Span  
Min. 4" Bearing all Beams

- INTERIOR FINISHES:**  
1/2" Gypboard or As Indicated  
At Walls/Ceilings  
Flooring As Indicated  
Paint/Stain As Indicated
- Note: Items not Indicated Shall be Per Contract

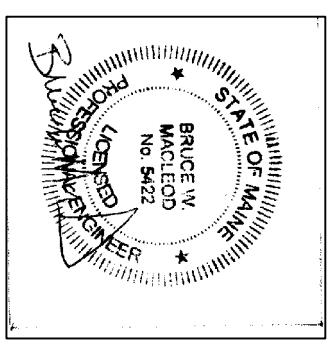

DATE ISSUED 5/6/16

JASON LANDRY CONSULTING, LLC  
17 MASON ROAD GORHAM, MAINE 04038 207-632-3111

MIKE WILSON  
9 MERRILL STREET  
PORTLAND, MAINE

## TITLE: STAIR SECTION & NOTES

DATE: 2/1/16	DRAWN BY: JLL	DRAWING NUMBER: S-3
SCALE: as noted	PROJ NO: 2016-006	

