




Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 04/28/15

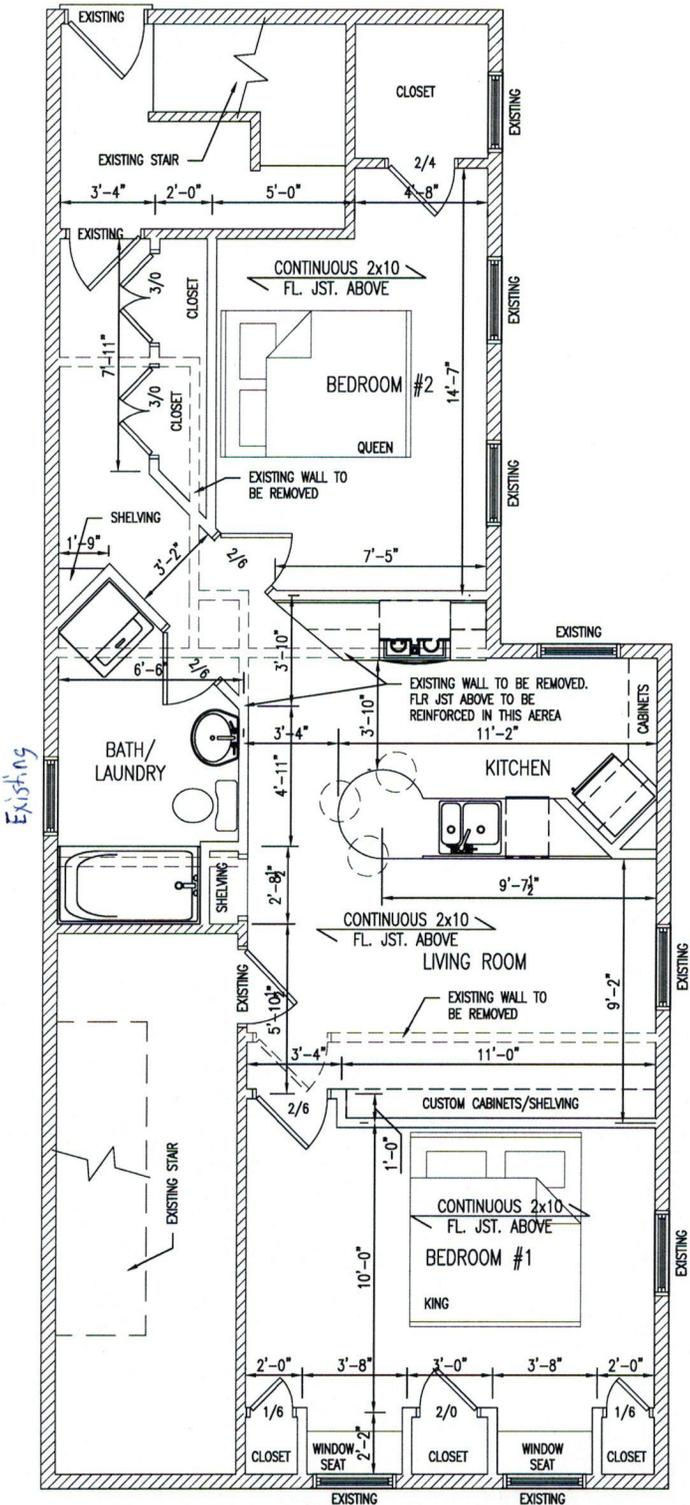

 FLOOR PLAN
1/4" = 1'-0"

SMOKE ALARMS

SHALL BE INTERCONNECTED & INSTALLED IN THE FOLLOWING LOCATIONS

1. EACH SLEEPING AREA
2. OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS
3. ON EACH ADDITIONAL STORY OF THE DWELLING INCLUDING BASEMENTS
4. FIRE SEPARATION PER TOWN AND LOCAL CODE WHEN REQUIRED

5/8" sheetrock on all walls and ceiling

* DENOTES EGRESS WINDOW

CARBON MONOXIDE ALARMS:

SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS

1. OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS
2. IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS THAT HAVE ATTACHED GARAGES

CONSTRUCTION NOTE:

CONTRACTOR TO VERIFY GRADE, STRUCTURAL INTEGRITY OF EXISTING STRUCTURE AND ALL DIMENSIONS IN FIELD BEFORE STARTING NEW CONSTRUCTION. DESIGN SHOWN MAY DIFFER FROM ACTUAL FINISHED CONSTRUCTION. FINAL MATERIALS, WINDOW/DOOR LOCATIONS AND SIZES, TO BE DETERMINED PER OWNER/CONT. OR LOCAL CODES.

*Insulation:
ceilings R30
walls R13*