


44 BARTLETT STREET FOUNDATION DETAIL - FROST WALL



Reviewed for Code Compliance
Inspectors Division
Approved with Conditions

Date: 12/17/14

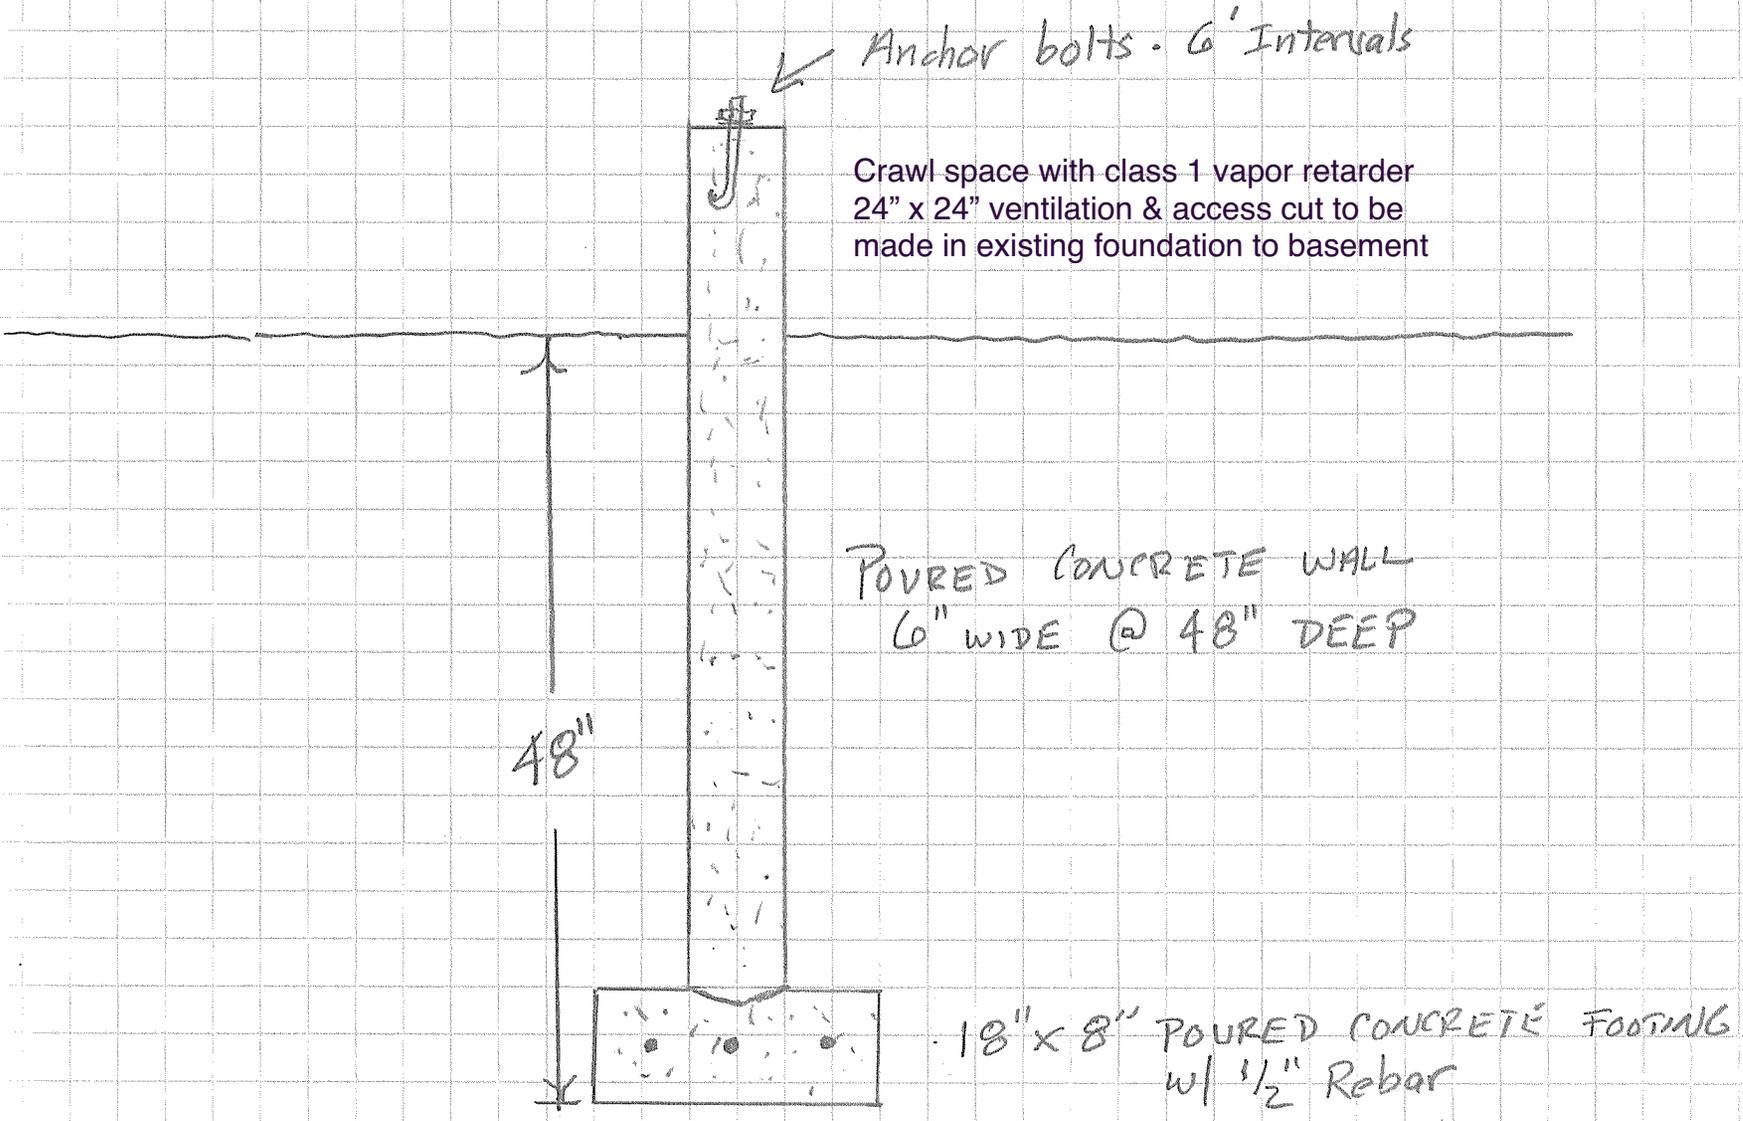

Anchor bolts - 6' Intervals

Crawl space with class 1 vapor retarder
24" x 24" ventilation & access cut to be
made in existing foundation to basement

POURED CONCRETE WALL
6" WIDE @ 48" DEEP

48"

18" x 8" POURED CONCRETE FOOTING
w/ 1/2" Rebar