


HOOD INFORMATION - Job#1910978

HOOD NO.	TAG	MODEL	LENGTH	MAX. COOKING TEMP.	TOTAL EXH. CFM	EXHAUST PLENUM RISER(S)					HOOD CONSTRUCTION	HOOD CONFIG.	
						WIDTH	LENG.	DIA.	CFM	S.P.		END TO END	ROW
1		6030 ND-2	4' 4.00"	700 Deg	1733			16"	1733	-0.840"	430 SS 100%	ALONE	ALONE


HOOD INFORMATION

HOOD NO.	TAG	FILTER(S)				LIGHT(S)			UTILITY CABINET(S)				FIRE SYSTEM PIPING	HOOD HANGING WGT	
		TYPE	QTY.	HEIGHT	LENGTH	QTY.	TYPE	WIRE GUARD	LOCATION	FIRE SYSTEM TYPE	SIZE	ELECTRICAL MODEL #			SWITCHES QUANTITY
1		Captrate Solo Filter	2	20"	16"	2	Screw In Compact	NO	Right			SC-311110FP	1 Light 1 Fan	NO	395 LBS

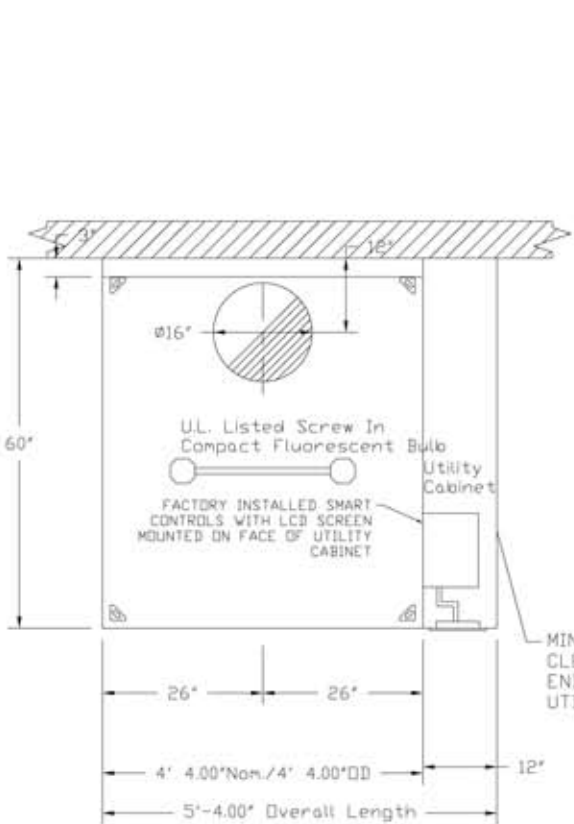

PLAN VIEW - Hood #1
4' 4.00" LONG 6030ND-2

IT IS THE RESPONSIBILITY OF THE ARCHITECT/OWNER TO ENSURE THAT THE HOOD CLEARANCE FROM LIMITED-COMBUSTIBLE AND COMBUSTIBLE MATERIALS IS IN COMPLIANCE WITH LOCAL CODE REQUIREMENTS.

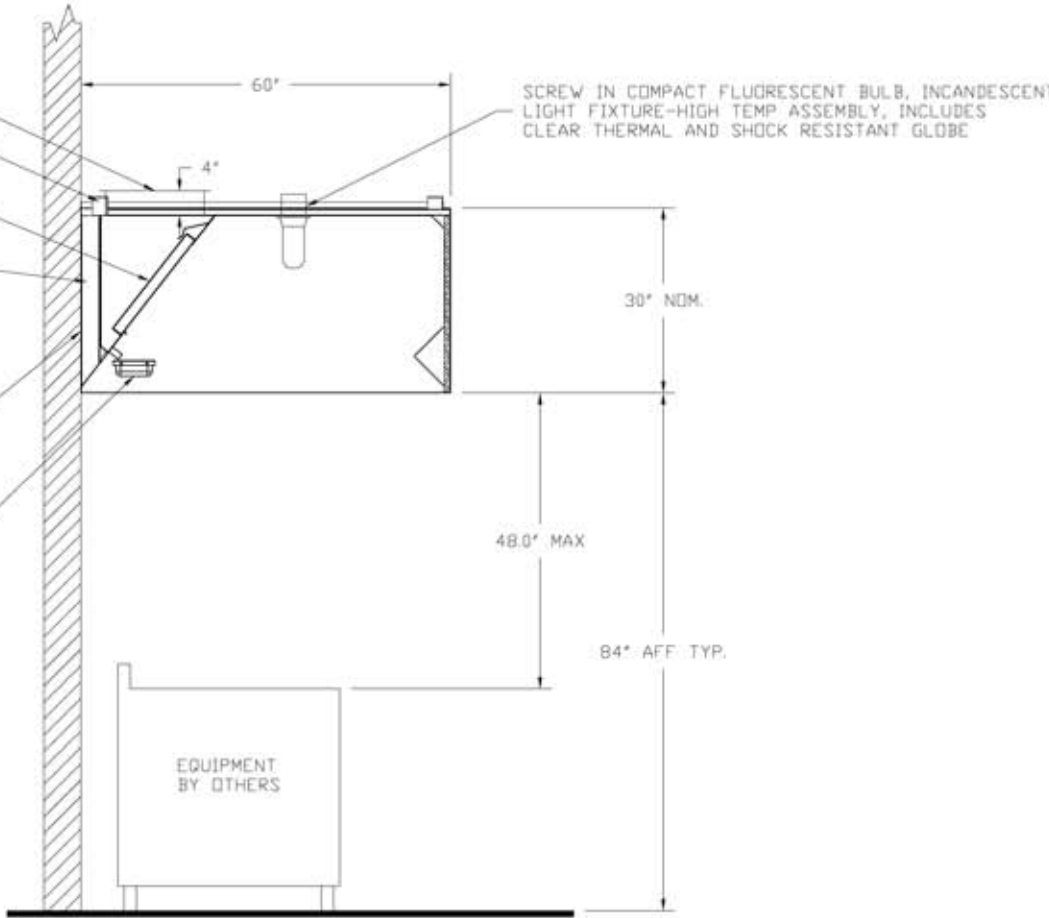

SECTION VIEW - MODEL 6030ND-2
HOOD - #1

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted

Approved with NO Exception Taken

Revise and Resubmit

SIGNATURE _____

Your Title _____ Date _____



JOB 90 Congress St r3	
LOCATION PORTLAND, ME	
DATE 11/26/2013	JOB # 1910978
DWG # 1	DRAWN BY BFC-21
REV.	SCALE 3/8" = 1'-0"