

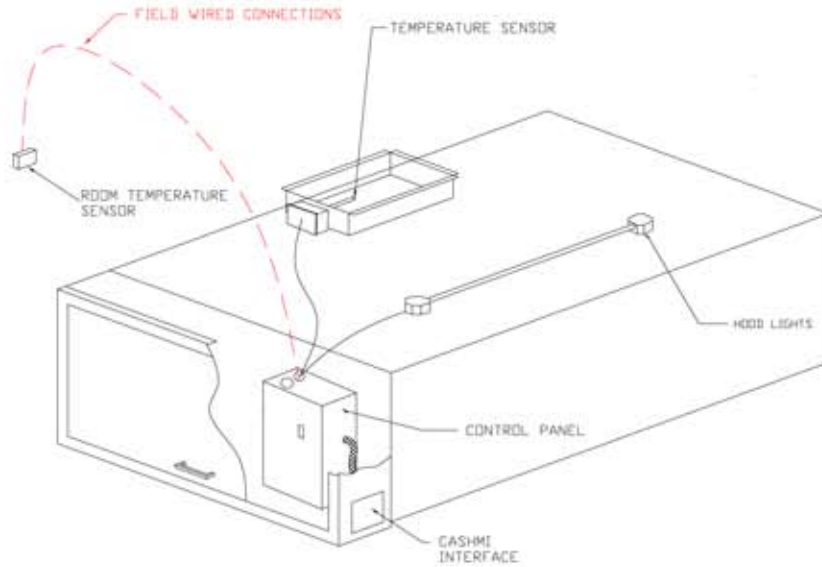
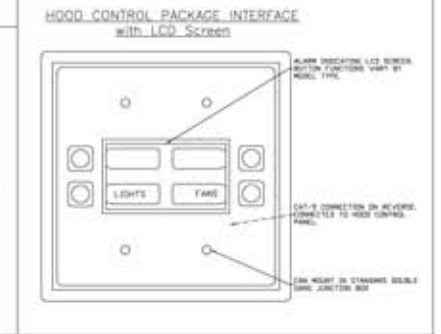


ELECTRICAL PACKAGES - Job#1910978

NO.	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED									
				LOCATION	QUANTITY		TYPE	Ø	H.P.	VOLT	FLA					
				1			SC-311110FP	Utility Cabinet Right	Utility Cabinet Right Hood # 1	1 Light 1 Fan	Smart Controls Thermostatic Control	Exhaust	3	1.500	208	4.7

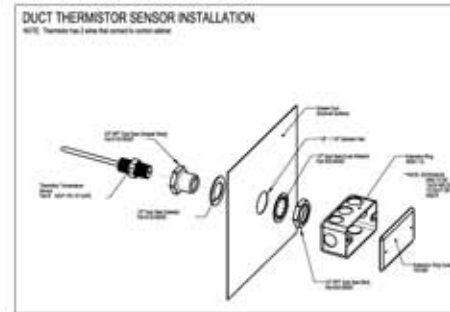

TYPICAL SC CONTROL SYSTEM WITH HOOD MOUNTED PANEL

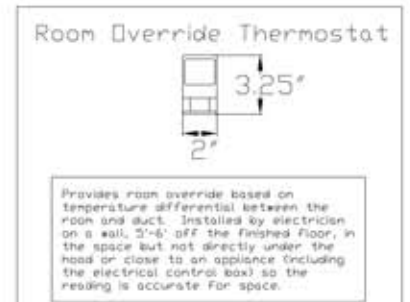

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted

Approved with NO Exception Taken

Revise and Resubmit

SIGNATURE _____

Your Title _____ Date _____



CAPTIVEAIR

JOB 90 Congress St r3	
LOCATION PORTLAND, ME	
DATE 11/26/2013	JOB # 1910978
DWG # 5	DRAWN BY BFC-21
REV.	SCALE 3/8" = 1'-0"