



THIRD FLOOR FRAMING
1/8" = 1'-0"

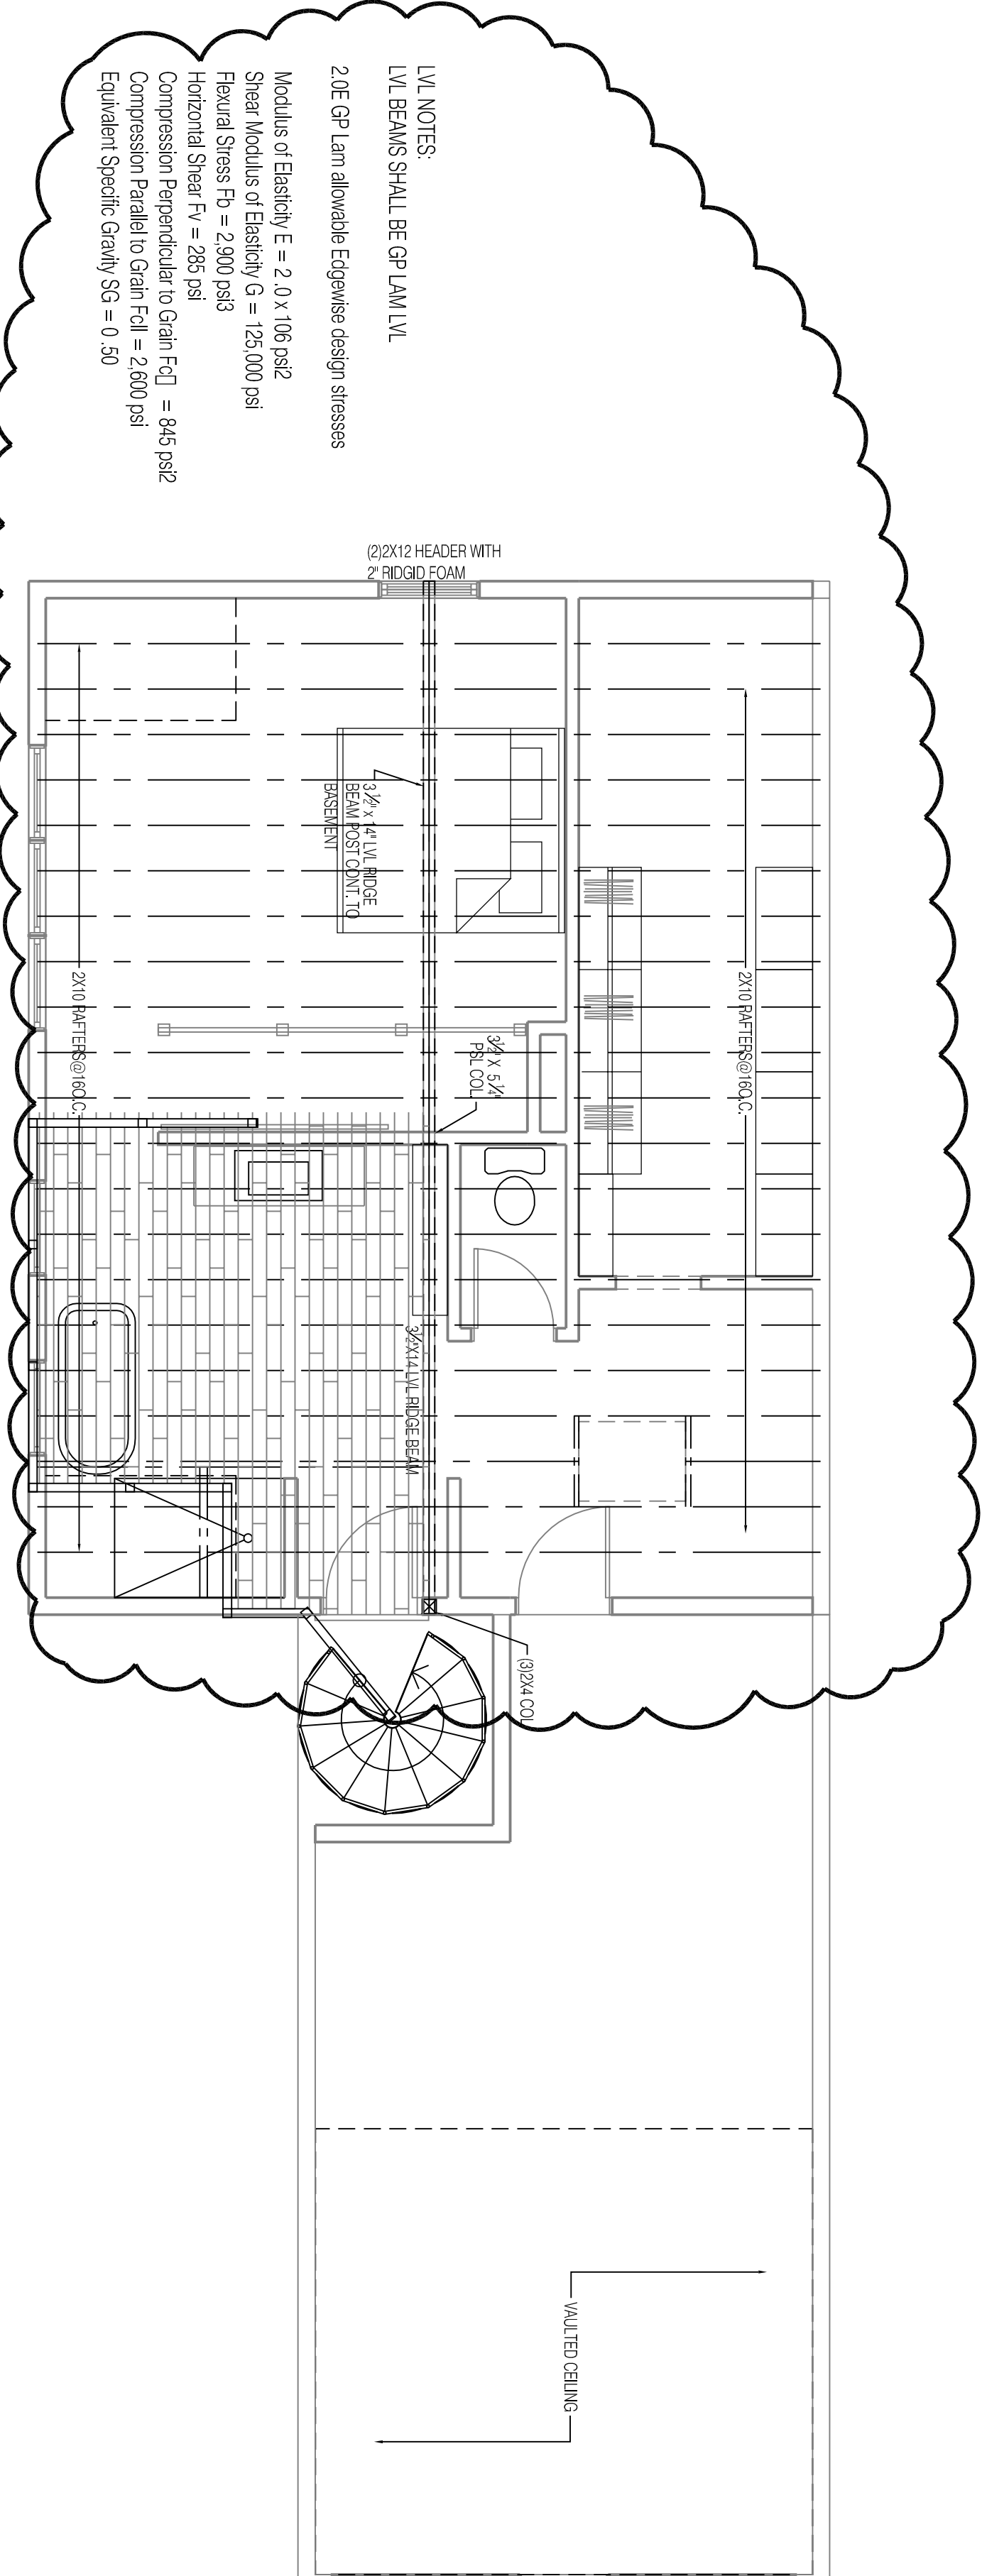

ROOF FRAMING
1/8" = 1'-0"

LVL NOTES:
LVL BEAMS SHALL BE GP LAM LVL
2.0E GP Lam allowable edgewise design stresses
Modulus of Elasticity E = 2.0 x 10⁶ psi²
Shear Modulus of Elasticity G = 125,000 psi³
Flexural Stress F_b = 2,900 psi³
Horizontal Shear F_v = 285 psi³
Compression Perpendicular to Grain F_{c⊥} = 945 psi²
Compression Parallel to Grain F_{c∥} = 2,800 psi³
Equivalent Specific Gravity SG = 0.50

PROSPECT



DESIGN
58 FORE ST., PORTLAND, ME
www.prospectdesign.me
T: 207-749-7400

29 ATLANTIC
29 ATLANTIC AVENUE
SUSAN GRISANTI

75 Market Street, Suite 203, Portland, ME

THIRD FLOOR AND ROOF
FRAMING

SHEET TITLE
REVISION

DRAWN BY: BB
DATE: June 23, 2014

A-104