




Reviewed for Code Compliance  
Inspection Division  
Approved with Conditions

Date: 05/16/14

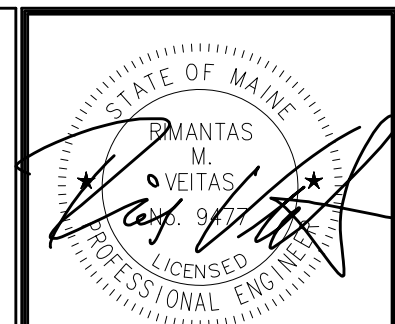

Prepared For:  
**118 on Munjoy Hill, LLC**  
118 CONGRESS STREET  
PORTLAND, ME 04101

Consultant:  
**VEITAS VEITAS engineers**  
480 Centre Street, Suite 200  
Portland, ME 04101  
TEL: (207) 772-4056 FAX: (207) 772-4056

Architect:  
**ARCHITYPE Architects**  
48 Union Wharf Portland, Maine 04101  
(207) 772-6022 Fax (207) 772-4056

Project:  
**118 ON MUNJOY HILL**  
118 CONGRESS STREET  
PORTLAND, MAINE

Revisions:  
**100% CONSTRUCTION DOCUMENTS**

Scale:  
As indicated

Date:  
5 MAR 2014

**S1.05**

#### TYPICAL ROOF CONSTRUCTION

23/32" APA RATED (2040) EXPOSURE 1 OSB W/ EDGE CLIPS PLACED PERPENDICULAR TO SUPPORTING MEMBERS NAILED W/8d RING SHANK NAILS AT 6" O.C. EDGE NAILING & 12" O.C. FIELD NAILING TO SUPPORTING MEMBERS. EACH PANEL SHALL HAVE 1/8" GAP ALL AROUND.

#### TYPICAL ROOF CONSTRUCTION

19/32" APA RATED (2040) EXPOSURE 1 OSB W/ EDGE CLIPS PLACED PERPENDICULAR TO SUPPORTING MEMBERS NAILED W/8d RING SHANK NAILS AT 6" O.C. EDGE NAILING & 12" O.C. FIELD NAILING TO SUPPORTING MEMBERS. EACH PANEL SHALL HAVE 1/8" GAP ALL AROUND. TYPICAL AT HIGH ROOFS.

#### ROOF FRAMING PLAN

1/8"=1'-0"

#### SNOW DRIFT PLAN

1/16"=1'-0"

#### TYPICAL TRUSS LAYOUT @ MECHANICAL UNITS

#### ROOF FRAMING NOTES:

- FOR TYPICAL DETAILS AND GENERAL NOTES SEE DRAWINGS S2.01 TO S2.03.
- FOR PLATE HEIGHT, SEE ARCHITECTURAL DRAWINGS.
- GENERAL CONTRACTOR NOTE: REFER TO ROOF AND FLOOR PLANS FOR LOCATIONS OF POSTS AND JACK STUDS. POSTS AND JACK STUDS SHALL EXTEND DOWN CONTINUOUSLY TO THE FOUNDATION WALL UNLESS INTERRUPTED BY A BEAM OR JACK STUDS. AT ALL JACK STUD AND POST LOCATIONS PROVIDE MATCHING BLOCKING STUDS BELOW FIRST FLOOR SHEATHING DOWN TO FOUNDATION WALL OR LVL BEAMS.
- FRAMING SUPPLIER SHALL SUBMIT WOOD TRUSS AND LVL HANGER INFORMATION FOR APPROVAL.
- X-6" LVL INDICATES THE NUMBER OF 1 3/4" x 5 1/2" LVL'S. X-8" LVL INDICATES THE NUMBER OF 1 3/4" x 7 1/4" LVL'S. X-10" LVL INDICATES THE NUMBER OF 1 3/4" x 9 1/2" LVL'S. X-12" LVL INDICATES THE NUMBER OF 1 3/4" x 11 7/8" LVL'S. X-14" LVL INDICATES THE NUMBER OF 1 3/4" x 14" LVL'S. X-16" LVL INDICATES THE NUMBER OF 1 3/4" x 16" LVL'S.
- "GT" INDICATES GIRDER TRUSS.
- "R=" INDICATES HANGER LOAD.
- "KKS" INDICATES THE NUMBER OF FULL HEIGHT KING STUDS.
- "XJS" INDICATES THE NUMBER OF JACK STUDS.
- INDICATES FLUSH FRAMING WITH HANGERS OR TOP CHORD BEARING FLUSH FRAMING.
- INDICATES TRUSSES/JOISTS CONTINUOUS OVER WALLS/HEADERS.
- INDICATES POINT LOAD ON WOOD TRUSS OR GIRDER TRUSS.
- ALL EXTERIOR HEADERS SHALL BE 3-2x8 UNLESS NOTED OTHERWISE.
- ALL INTERIOR HEADERS SHALL BE 2-2x10 UNLESS NOTED OTHERWISE.
- PROVIDE 1 JACK STUD ON EACH SIDE OF ALL DOOR, WINDOW AND FLUSH FRAME OPENINGS, AND AT EACH END OF BEAMS AND GIRDER TRUSSES UNLESS NOTED OTHERWISE.
- PROVIDE A MINIMUM OF TWO STUDS BELOW BEARING POINT OF ROOF GIRDER TRUSSES (GT) UNLESS NOTED OTHERWISE.
- INDICATES 2x... WALLS BEARING WALLS BELOW.
- AT ALL INTERIOR AND EXTERIOR LOAD BEARING WALLS OVER 8'-0" IN HEIGHT PROVIDE ONE ROW OF WOOD BLOCKING AT MID-HEIGHT OF STUDS.
- "SW", "SHEAR WALL", OR INDICATES SHEAR WALL. SEE DRAWING S3 SERIES DWGS FOR SHEAR WALL SCHEDULE AND DETAILS.
- THE ROOF TRUSSES SHALL BE DESIGNED TO RESIST WIND UPLIFT LOADS AS PER THE STATE BUILDING CODE. TRUSS MANUFACTURER SHALL SUBMIT STAMPED CALCULATIONS AND ERECTION PLAN IDENTIFYING ALL TRUSSES, ALL REQUIRED BRACING AND ALL TIE DOWN HARDWARE FOR WIND UPLIFT.

#### WOOD TRUSS LOAD SCHEDULE

ROOMS:	LIVE LOAD	40 psf
	TOP CHORD DEAD LOAD	35 psf
	BOTTOM CHORD DEAD LOAD	5 psf
	TOTAL	80 psf
CORRIDORS	LIVE LOAD	40 psf
	TOP CHORD DEAD LOAD	25 psf
	BOTTOM CHORD DEAD LOAD	5 psf
	TOTAL	70 psf
ROOF	LIVE/SNOW LOAD	35 psf + allow for drift
	TOP CHORD DEAD LOAD	15 psf
	BOTTOM CHORD DEAD LOAD	5 psf
	TOTAL	55 psf
PRIVATE ROOF DECK	LIVE/LOAD	40 psf + allow for drift
	TOP CHORD DEAD LOAD	20 psf
	BOTTOM CHORD DEAD LOAD	5 psf
	TOTAL	65 psf

#### NOTE:

ALL WET WALLS TO BE 2x6 WALL PANELIZER TO COORD. ALL WET WALL LOCATIONS WITH ARCHITECT.

#### NOTE:

TRUSS MF6. TO COORDINATE FLOOR TRUSS SPACING W/MECHANICAL UNITS. MECHANICAL UNIT TO BE CENTERED BETWEEN 2-FLOOR/ROOF TRUSSES.