




WATER ENTRANCE DETAIL
NTS

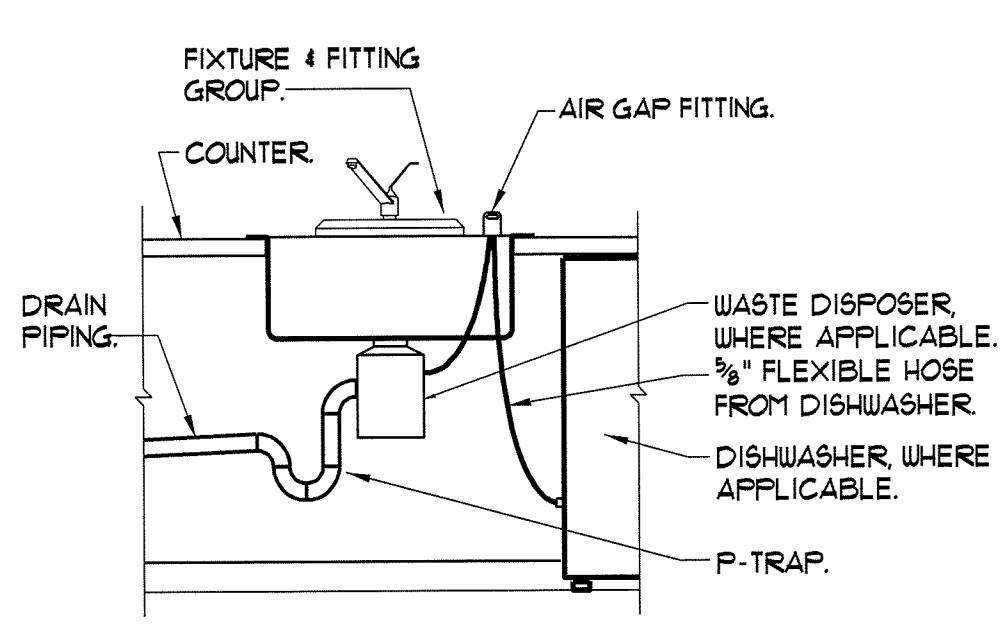


**DISHWASHER DRAIN /
DISPOSAL DETAIL**
NTS

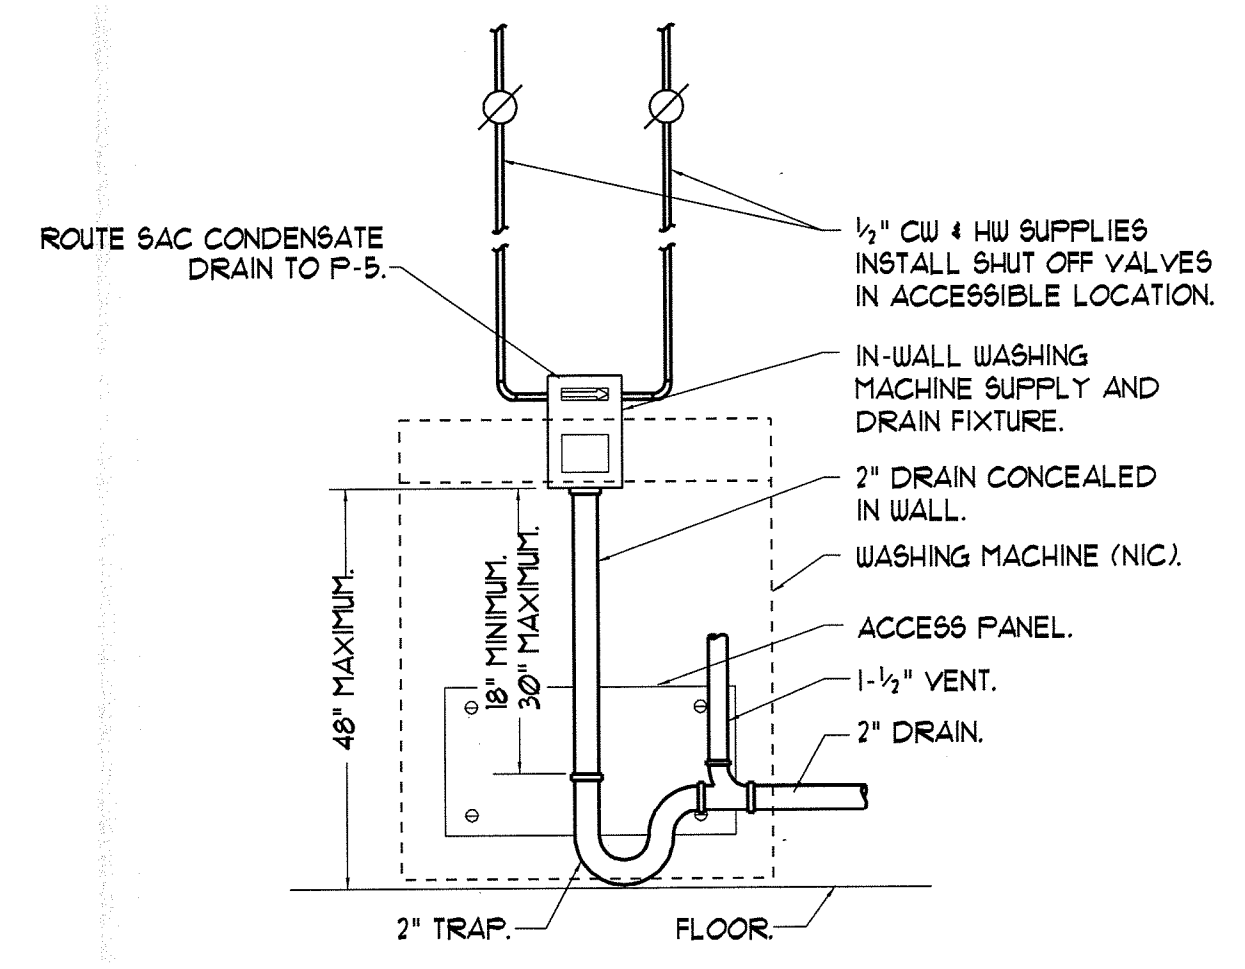


**WASHING MACHINE
HOOK-UP DETAIL**
NTS

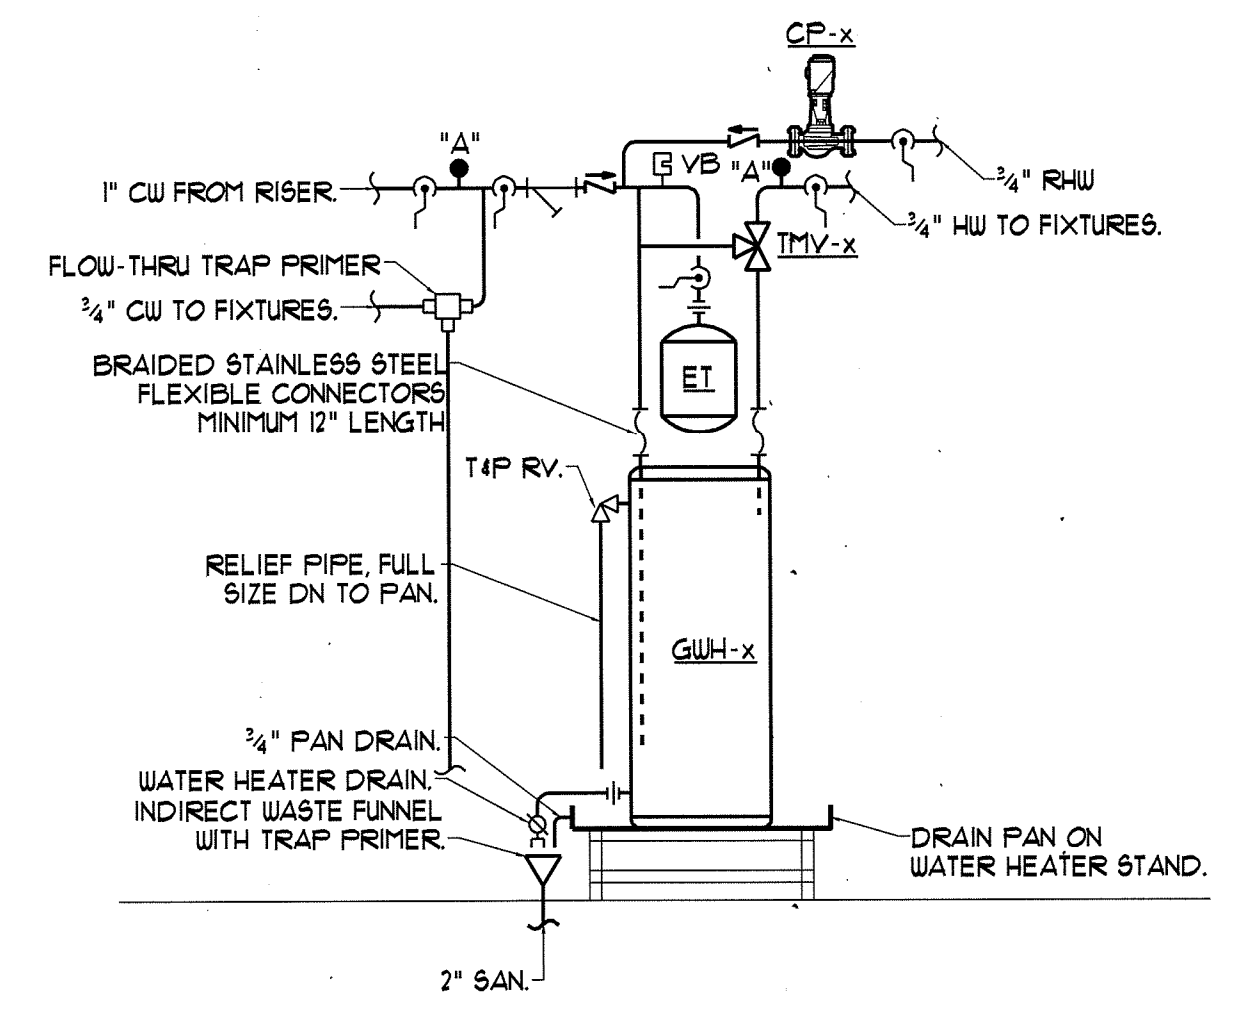


WATER HEATER PIPING SYSTEM SCHEMATIC
NTS
TYPICAL OF ONE PER CONDO.
CONDENSATE DRAINS FROM UNIT AHUs SHALL BE PIPED TO THIS I.W. FUNNEL.

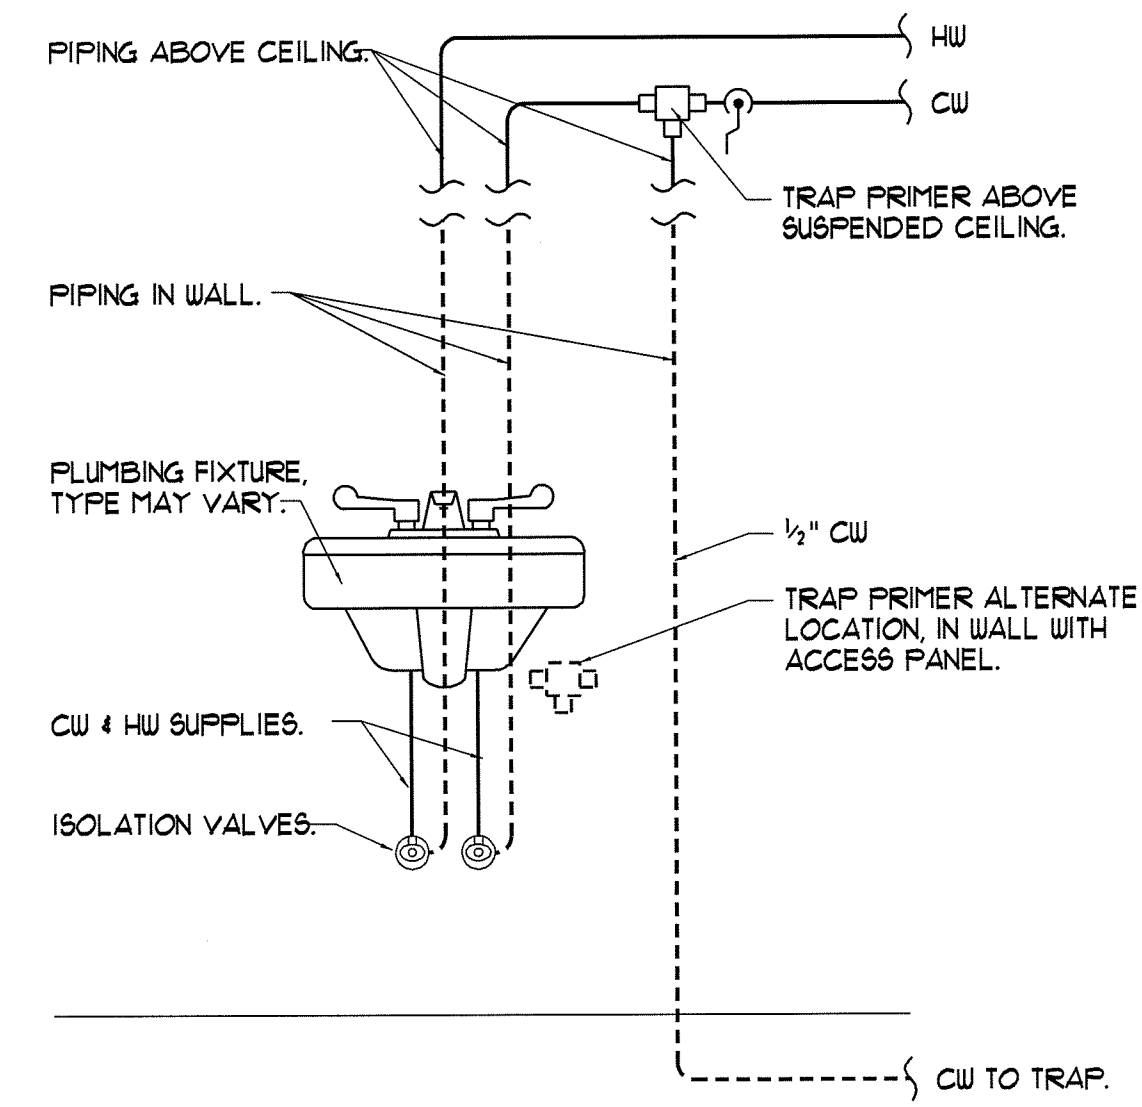

TRAP PRIMER CONNECTION DETAIL
NTS
NOTE - ALL FLOOR DRAINS SHALL HAVE TRAP PRIMERS,
CONNECT TO NEAREST FIXTURE.

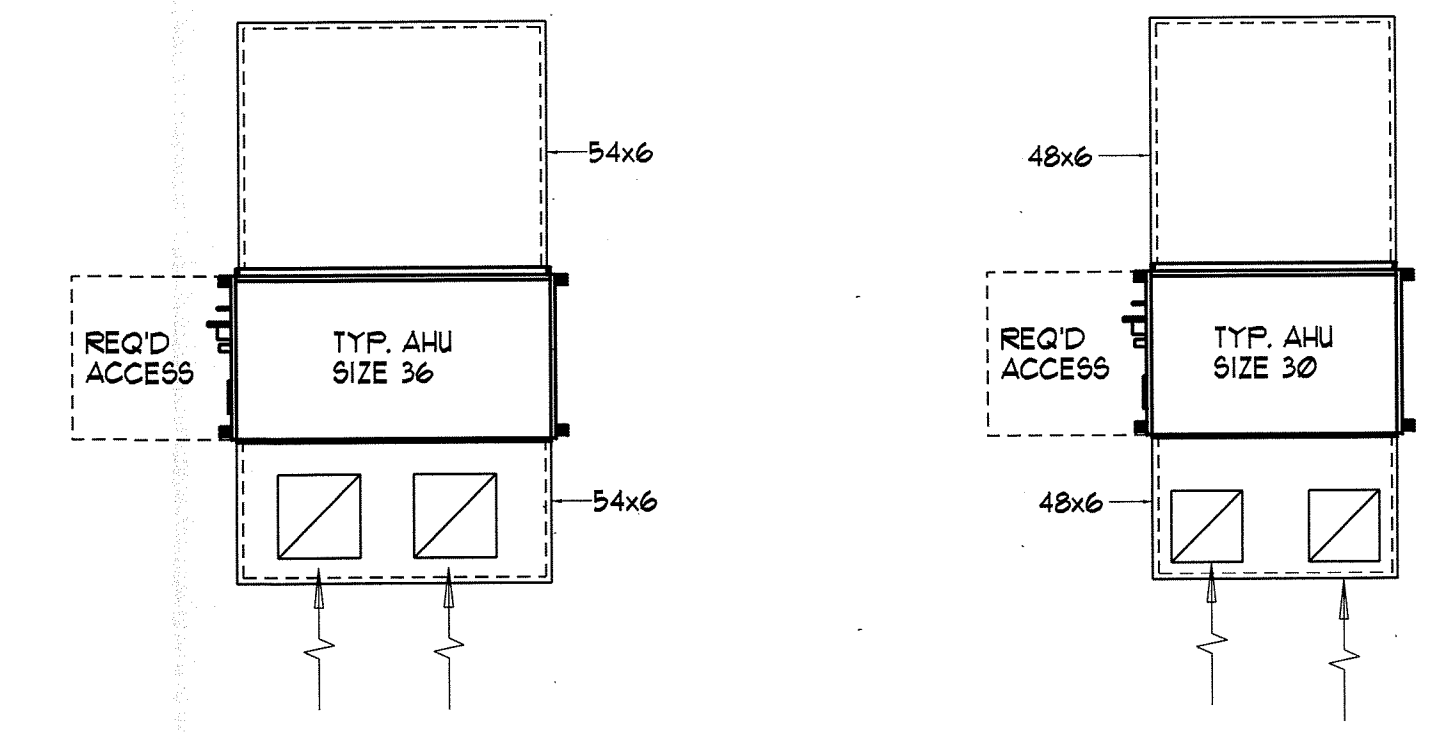

**TYPICAL HORIZONTAL HEAT
PUMP DUCT DIAGRAMS**
NTS

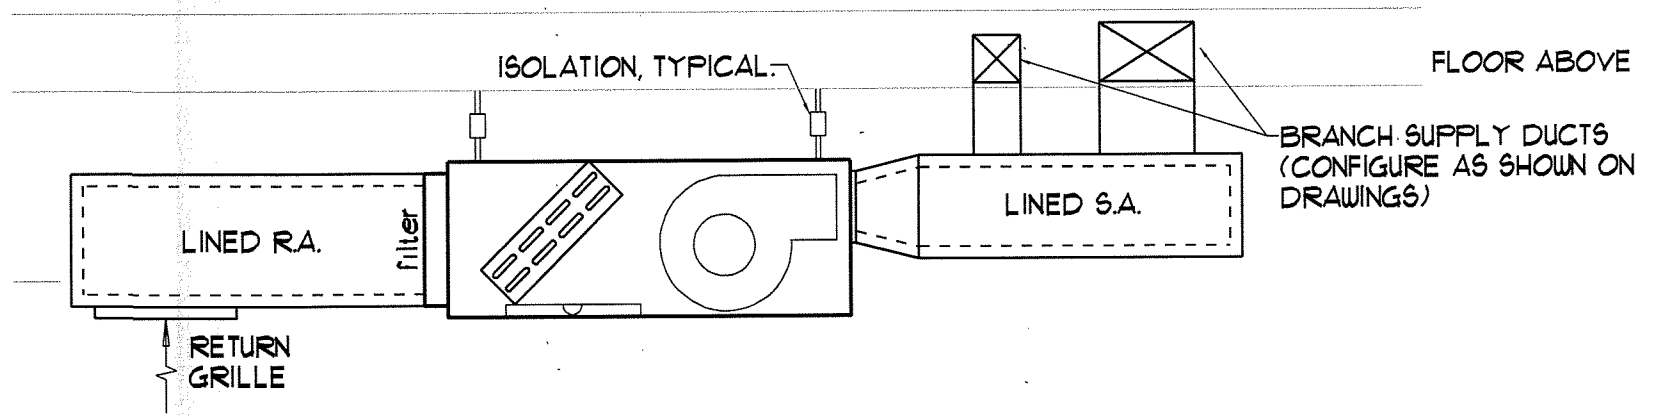

NOTES - UNITS SHALL BE CONFIGURED SIMILAR TO AS SHOWN, SEE
MECHANICAL PLANS.
- UNITS SHALL BE MOUNTED AS TIGHT TO FLOOR ABOVE AS POSSIBLE
WHILE STILL MAINTAINING PROPER CLEARANCES PER MANUFACTURER.