

# WINDOW SCHEDULE

MARK	WIDTH	HEIGHT	Style	NOTES
2	2	2	2	2
1	2'-5 1/2"	4'-0"	Casement	---
2	2'-5 1/2"	4'-0"	Casement	Egress
3	2'-3-0"	2'-0"	Awning	---
4	1'-11 1/2"	2'-0"	Awning	---
5	2'-11 1/2"	5'-0"	Casement	---
6	2'-11 1/2"	5'-0"	Casement	---
7	1'-11 1/2"	3'-6"	Casement	---
8	2'-5 1/2"	4'-0"	Casement	---
9	2'-5 1/2"	4'-0"	Picture	---
10	2'-5 1/2"	4'-0"	Casement	---
11	2'-11 1/2"	5'-0"	Casement	---
12	2'-11 1/2"	5'-0"	Casement	---
13	2'-11 1/2"	3'-0"	Picture	---
14	2'-11 1/2"	3'-0"	Casement	---
15	2'-11 1/2"	3'-0"	Casement	---
16	2'-11 1/2"	3'-0"	Casement	Egress
17	2'-11 1/2"	5'-0"	Casement	Egress
19	2'-11 1/2"	5'-4"	Casement	---
20	1'-11 1/2"	3'-6"	Casement	---
21	1'-11 1/2"	3'-6"	Casement	---
22	2'-5 1/2"	5'-0"	Casement	Egress
23	2'-5 1/2"	5'-0"	Casement	Egress
24	2'-11 1/2"	5'-0"	Casement	Egress
25	2'-11 1/2"	5'-0"	Casement	Egress
26	1'-11 1/2"	4'-0"	Casement	---
27	3'-4 1/2"	2'-5"	Picture	---
28	3'-4 1/2"	2'-5"	Picture	---
29	3'-4 1/2"	2'-5"	Awning	---
30	3'-11 1/2"	2'-5"	Awning	---
31	3'-11 1/2"	2'-5"	Picture	---
32	3'-11 1/2"	2'-5"	Picture	---
33	2'-11 1/2"	5'-4"	Casement	---

WINDOW NOTES:

ALL WINDOWS SHALL BE LOW E ARGON FILLED INSULATING GLASS.  
ALL WINDOWS TO HAVE A U-FACTOR RATING OF 0.30 OR BETTER.  
ALL WINDOW GRILLES SHALL BE SIMULATED DIVIDED LIFE.

ALL GLAZING SHALL CONFORM TO RC 2009 R308  
HAZARDOUS LOCATIONS SHALL HAVE TEMPERED GLASS.  
GLAZING WITH SIL HTS LESS THAN 18" TO BE TEMPERED.  
GLAZING 24" OR CLOSER TO DOORS SHALL BE TEMPERED.  
GLAZING 36" OR CLOSER TO STAIRWAYS AND 36" OR LESS ABOVE FLOOR SHALL BE TEMPERED.  
GLAZING ADJACENT TO STAIRWAYS, LANDINGS AND RAMPS WITHIN 36" HORIZONTALLY OF A WALKING SURFACE AND LESS THAN 60" ABOVE THAT WALKING SURFACE SHALL BE TEMPERED.  
GLAZING IN BATHROOMS WHERE THE BOTTOM EDGE IS LESS THAN 60" ABOVE FLOOR AND CLOSER THAN 60" FROM WATERS EDGE SHALL BE TEMPERED.  
GLAZING WITHIN 60" OF THE BOTTOM TREAD OF A STAIRWAY WHEN THE GLAZING IS LESS THAN 60" ABOVE THE FLOOR SHALL BE TEMPERED.


ALL WINDOWS SHALL CONFORM TO R912 WINDOW FALL PROTECTION  
ALL WINDOWS WITH SIL HTS LESS THAN 24" AND MORE THAN 72" ABOVE GRADE TO HAVE OPENING LIMITERS TO RESTRICT OPENING TO 4".

R10 EMERGENCY ESCAPE AND RESCUE OPENINGS  
SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS WINDOW WITH A SIL HT OF NOT MORE THAN 44" A MINIMUM CLEAR OPENING HEIGHT OF 24" AND A MINIMUM CLEAR OPENING WIDTH OF 20"


# DOOR SCHEDULE

MARK	SIZE		MATL	GLAZING	FIRE RATING LABEL	NOTES
	WD	HGT				
1	3'-0"	7'-0"	---	---	---	---
2	3'-6"	6'-8"	---	---	---	---
3	2'-8"	6'-8"	---	---	---	---
4	3'-6"	6'-8"	---	---	---	---
6	3'-0"	7'-0"	---	---	---	---
7	2'-8"	6'-8"	---	---	---	---
8	3'-0"	6'-8"	---	---	---	---
9	2'-4"	6'-8"	---	---	---	1 Hr rated
10	2'-8"	7'-0"	---	---	---	---
11	8'-0"	8'-0"	---	---	---	Coordinate door ht. With elevator opening
12	6'-0"	7'-0"	---	---	---	Coordinate door ht. With elevator opening
13	3'-0"	7'-0"	---	---	---	---
14	2'-4"	7'-0"	---	---	---	Barn type slider
15	2'-0"	7'-0"	---	---	---	Coordinate door ht. with elevator opening
16	2'-8"	7'-0"	---	---	---	Barn type sliding
17	2'-6"	7'-0"	---	---	---	Barn type slider
18	3'-0"	7'-0"	---	---	---	---
19	2'-8"	7'-0"	---	---	---	---
20	2'-8"	7'-0"	---	---	---	---
22	2'-6"	7'-0"	---	---	---	Barn type slider
23	2'-8"	7'-0"	---	---	---	---
24	3'-0"	7'-0"	---	---	---	---



DOOR #21 IS REMOVED

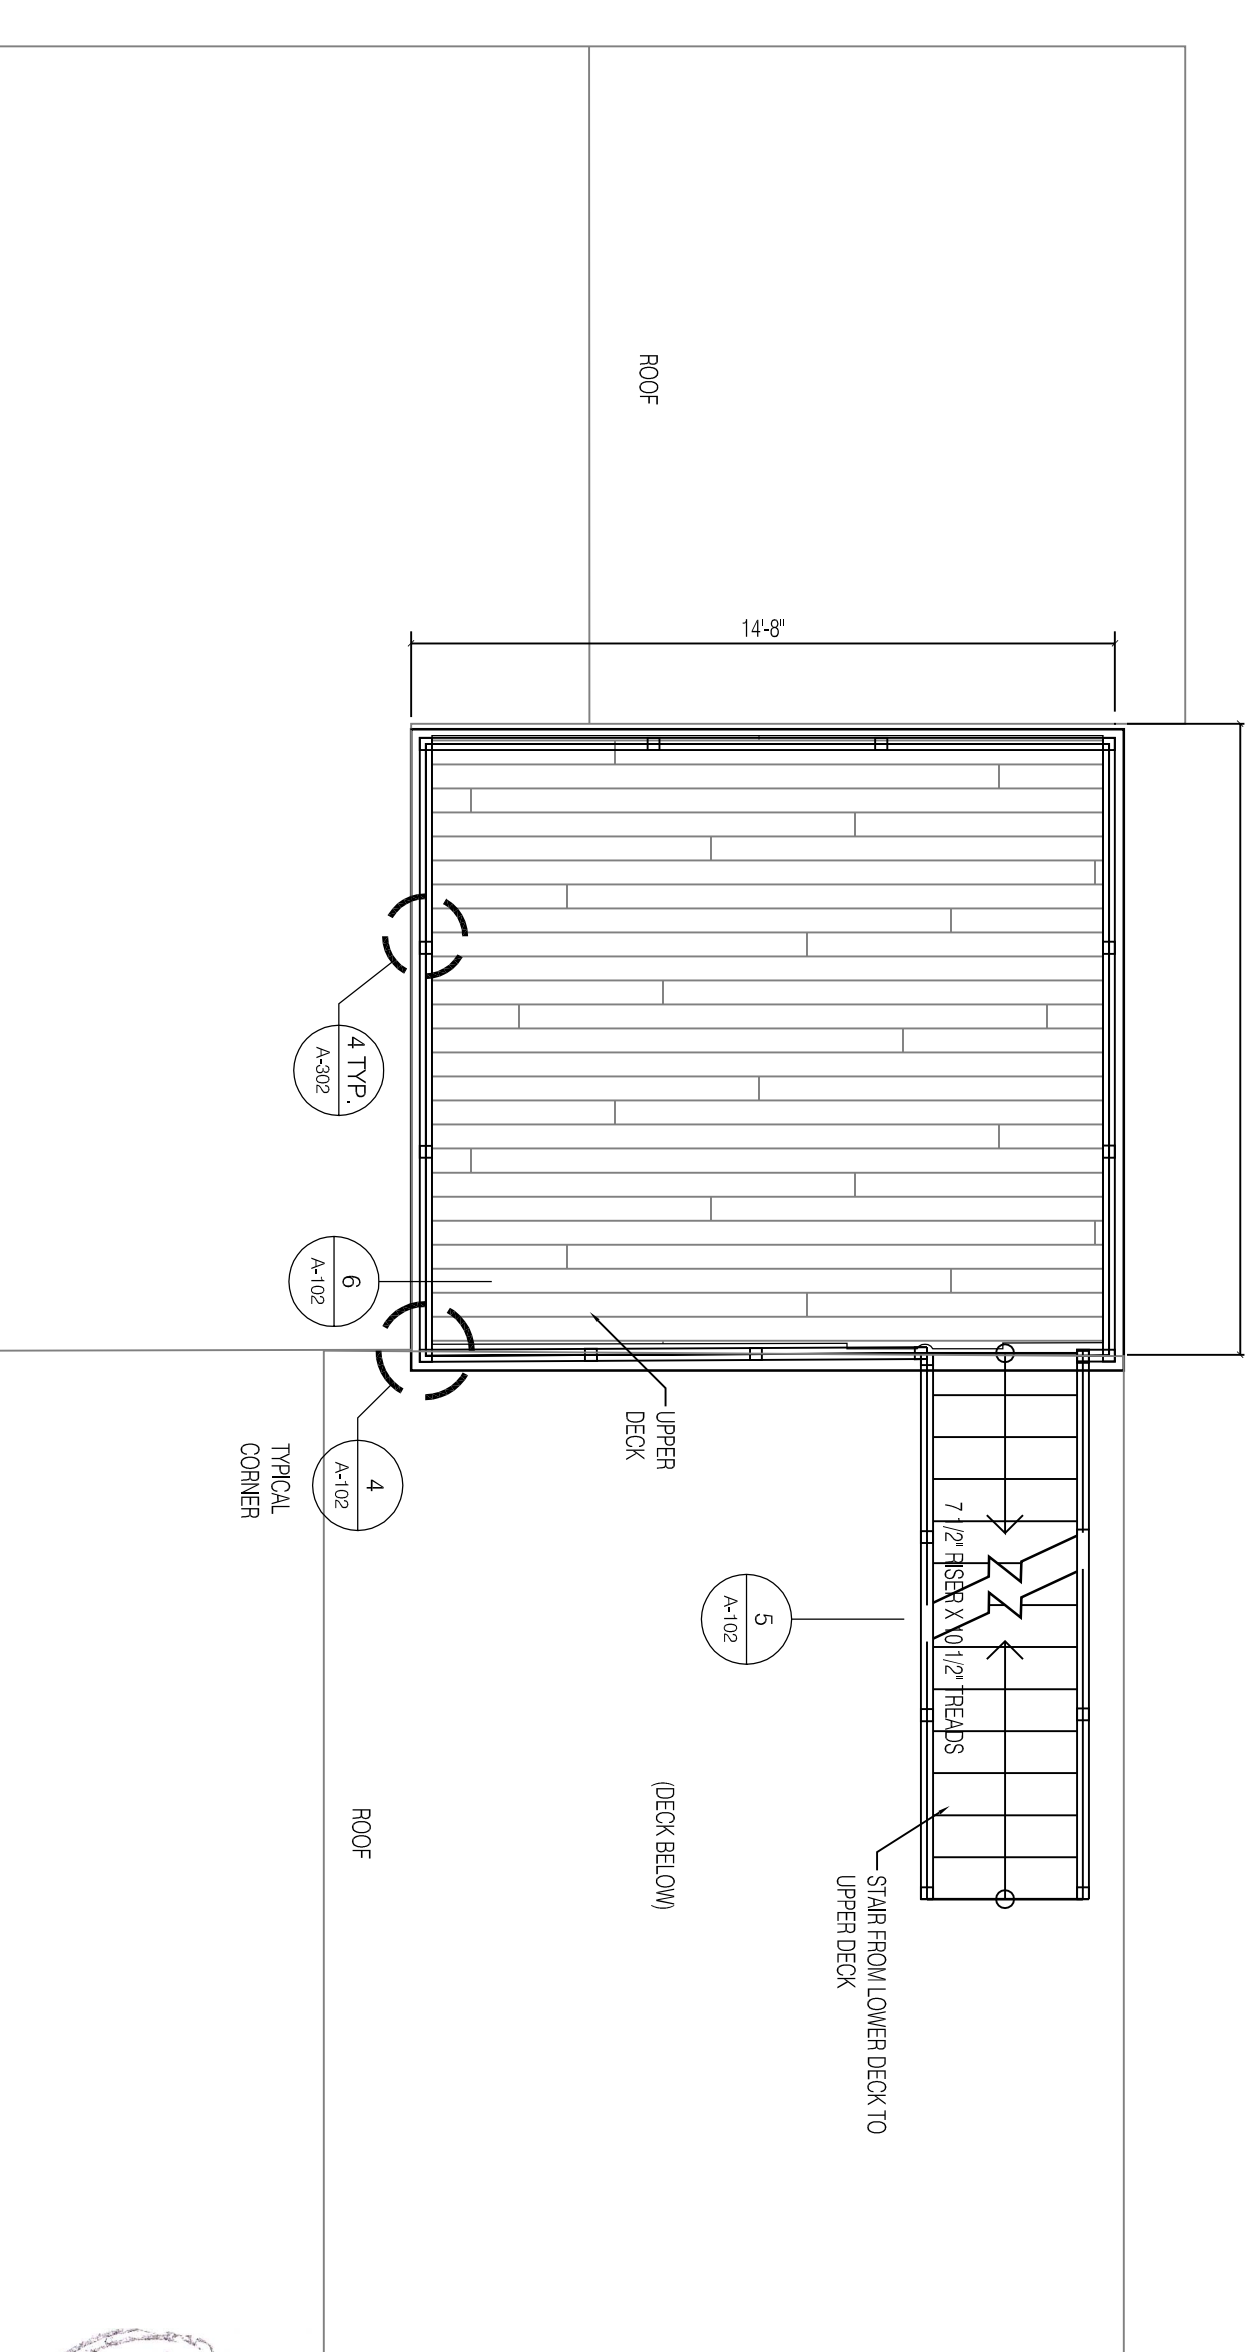

1 UPPER DECK PLAN  
1/4" = 1'-0"

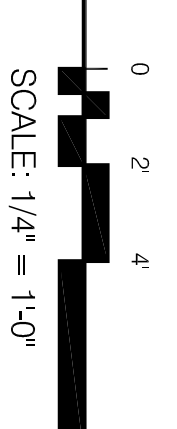

SCALE: 1/4" = 1'-0"

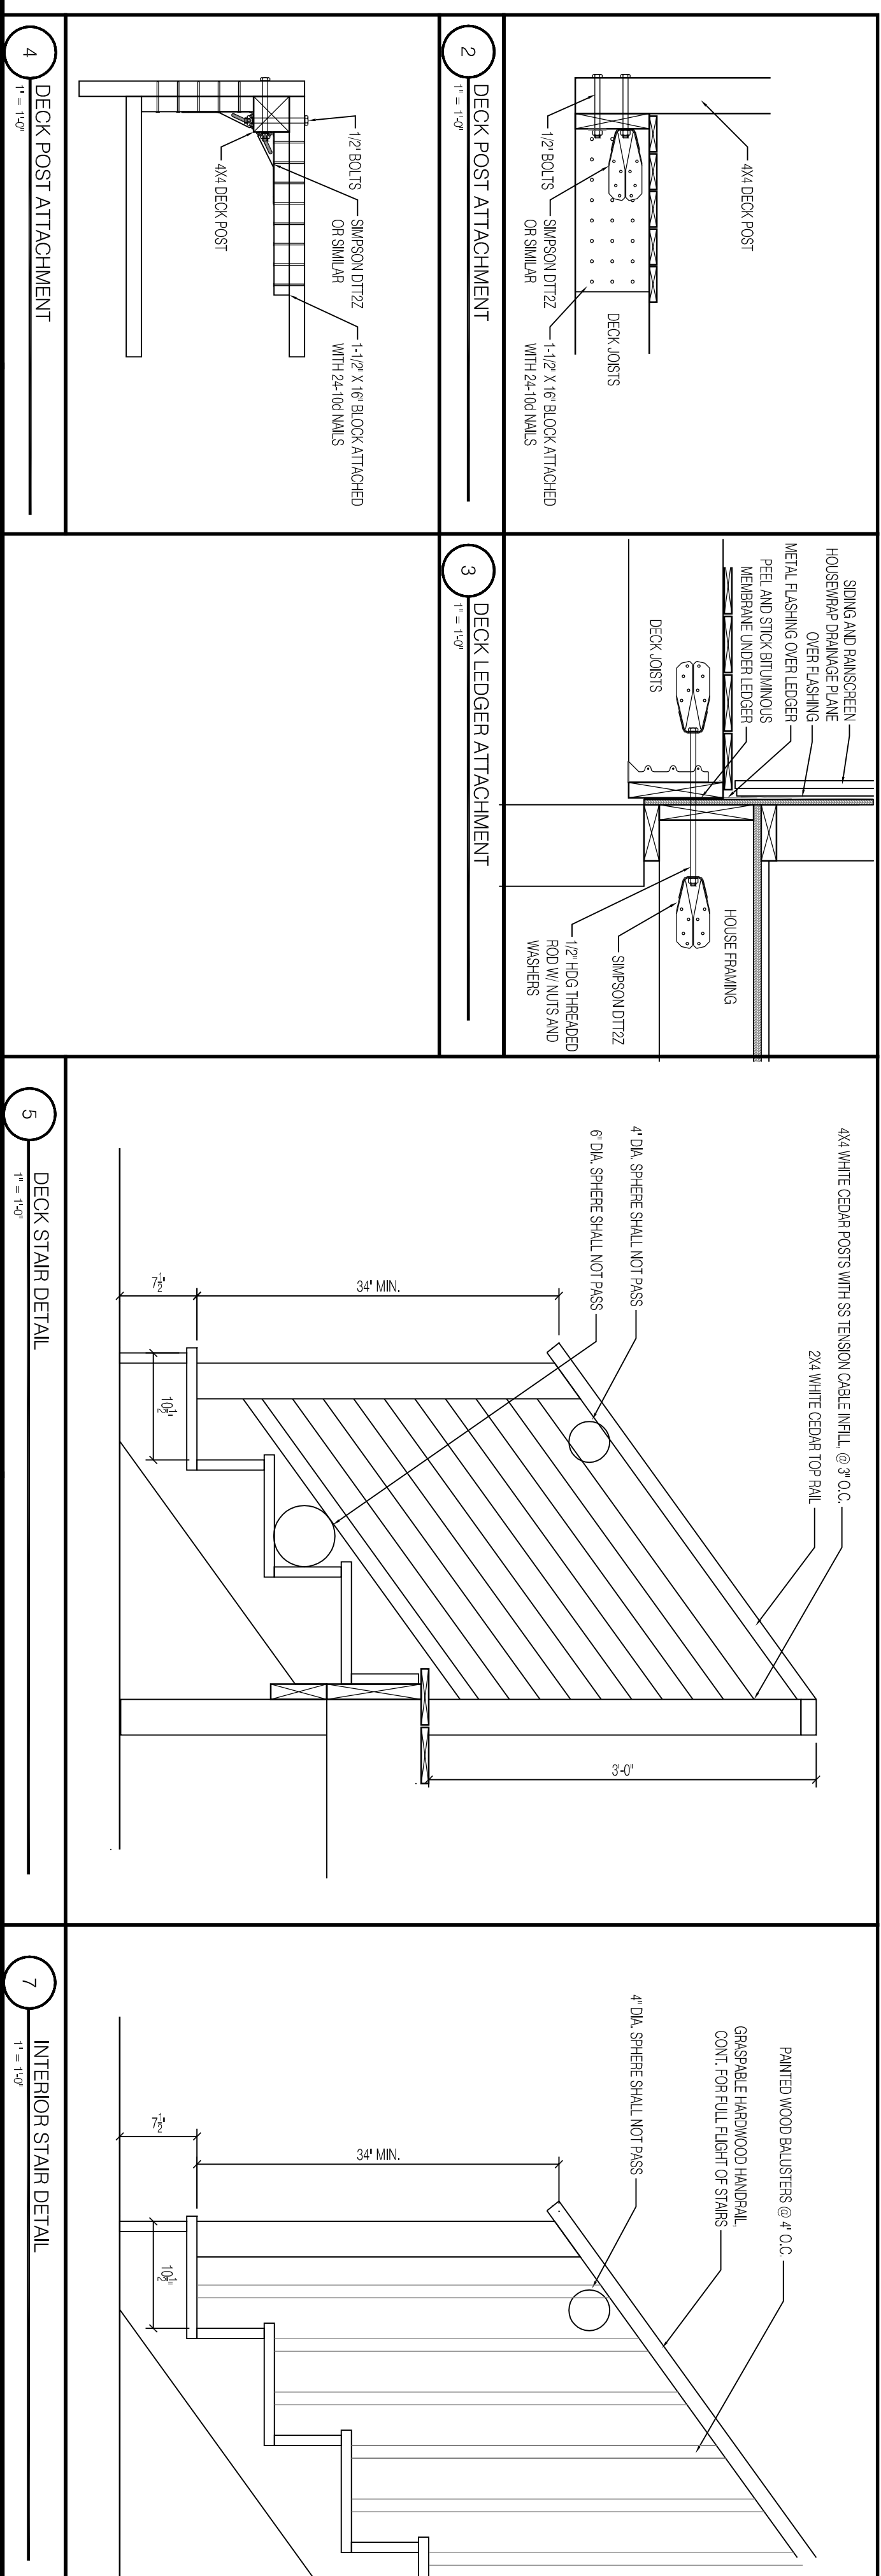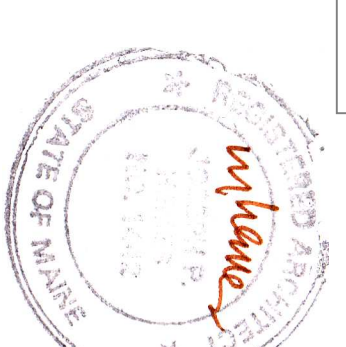


2 DECK POST ATTACHMENT  
1/4" = 1'-0"

3 DECK LEDGER ATTACHMENT  
1/4" = 1'-0"

5 DECK STAIR DETAIL  
1/4" = 1'-0"

7 INTERIOR STAIR DETAIL  
1/4" = 1'-0"

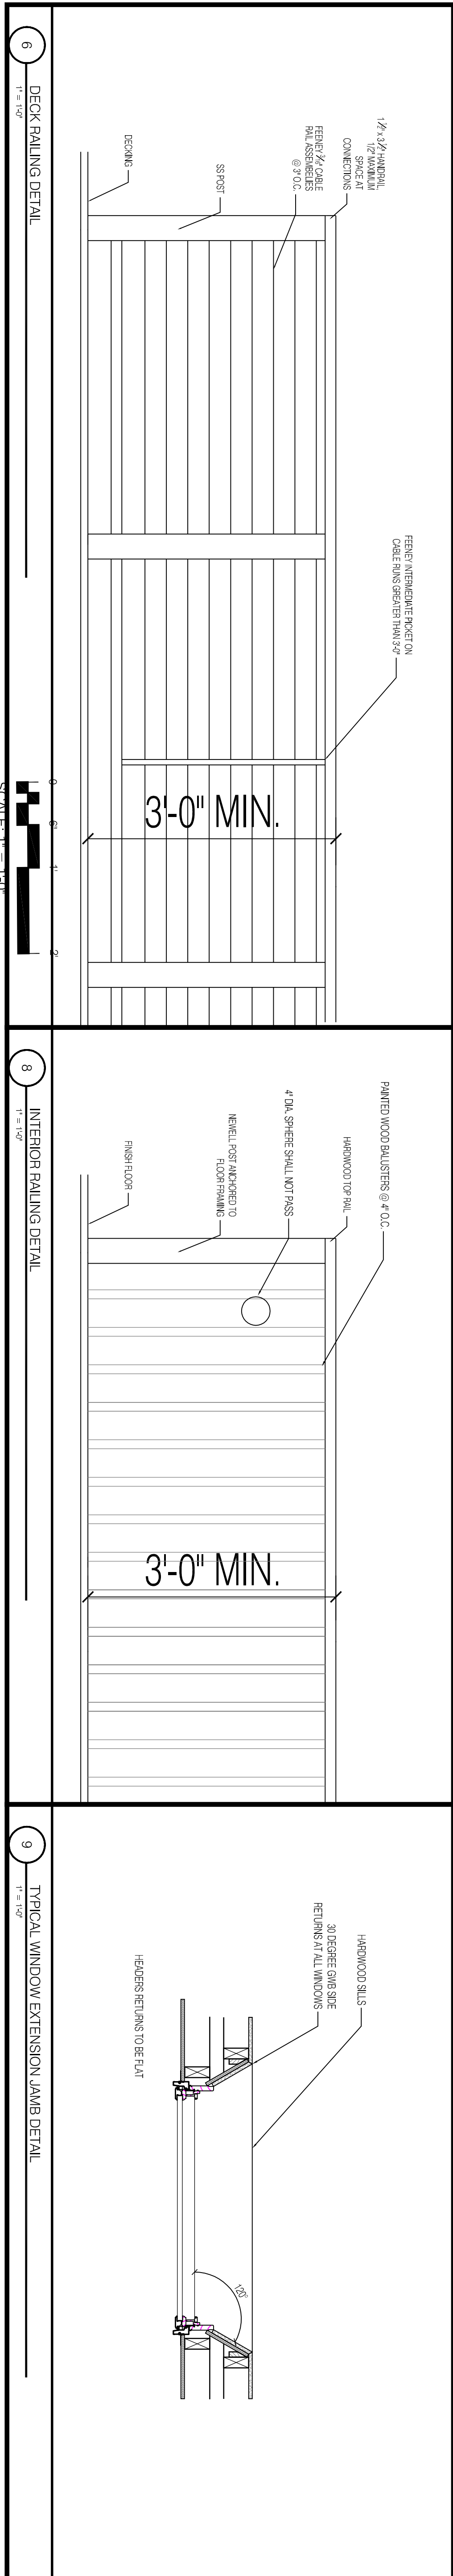

6 DECK RAILING DETAIL  
1/4" = 1'-0"

8 INTERIOR RAILING DETAIL  
1/4" = 1'-0"

9 TYPICAL WINDOW EXTENSION JAMB DETAIL  
1/4" = 1'-0"

# CONSTRUCTION SET

UPPER DECK PLAN, SCHEDULES AND STAIR DETAILS

MONUMENT STREET  
30 MONUMENT ST  
PORTLAND, ME

PROSPECT DESIGN  
58 FORE ST. PORTLAND, ME  
www.prospectdesign.me  
T: 207-749-7400

SHEET TITLE  
REVISION  
February 17, 2015 DOOR SIZES CHANGED  
DRAWN BY: BB  
DATE: March 12, 2015

A-102