


If footing elevations are raised, it is recommended that two inches of insulation extend laterally from the outside building edge for a distance of 4 feet. Insulation should be placed a minimum of 12 inches below local ground surface and above the top of footings. Insulation 1-inch thick should be placed against the outside surface of the foundation wall and terminate at approximately 3 inches below local ground surface.

Please do not hesitate to contact us if you have any questions or if we can be of further service.


Very truly yours:  
R.W. GILLESPIE & ASSOCIATES, INC.



Matthew T. Grady, P.E.  
Geotechnical Engineer



Charles R. Nickerson, P.E.  
Chief Geotechnical Engineer

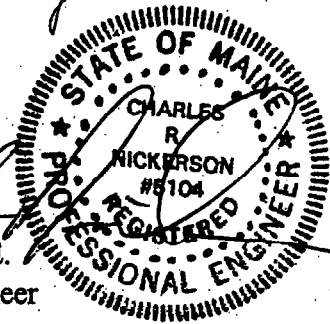

MTG/CRN:ci

cc: Scott Teas, AIA - TFH Architects