



PLAN VIEW RAIN GARDEN

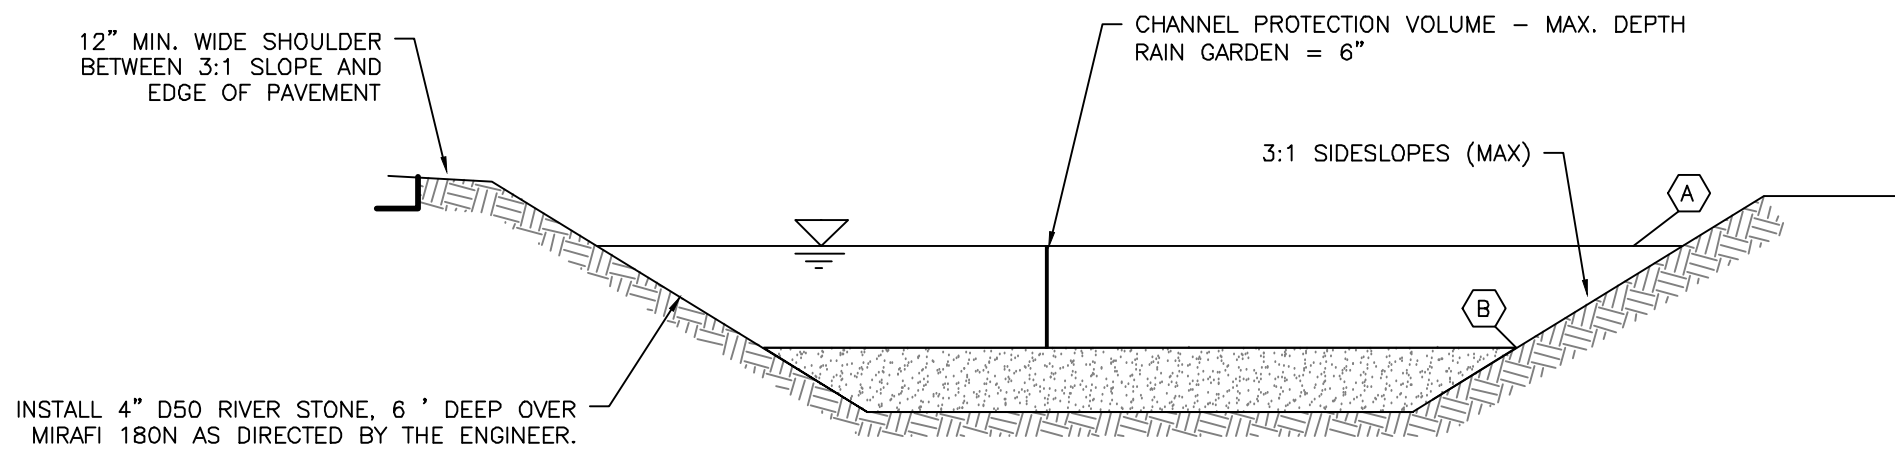

SOIL FILTER CROSS SECTION

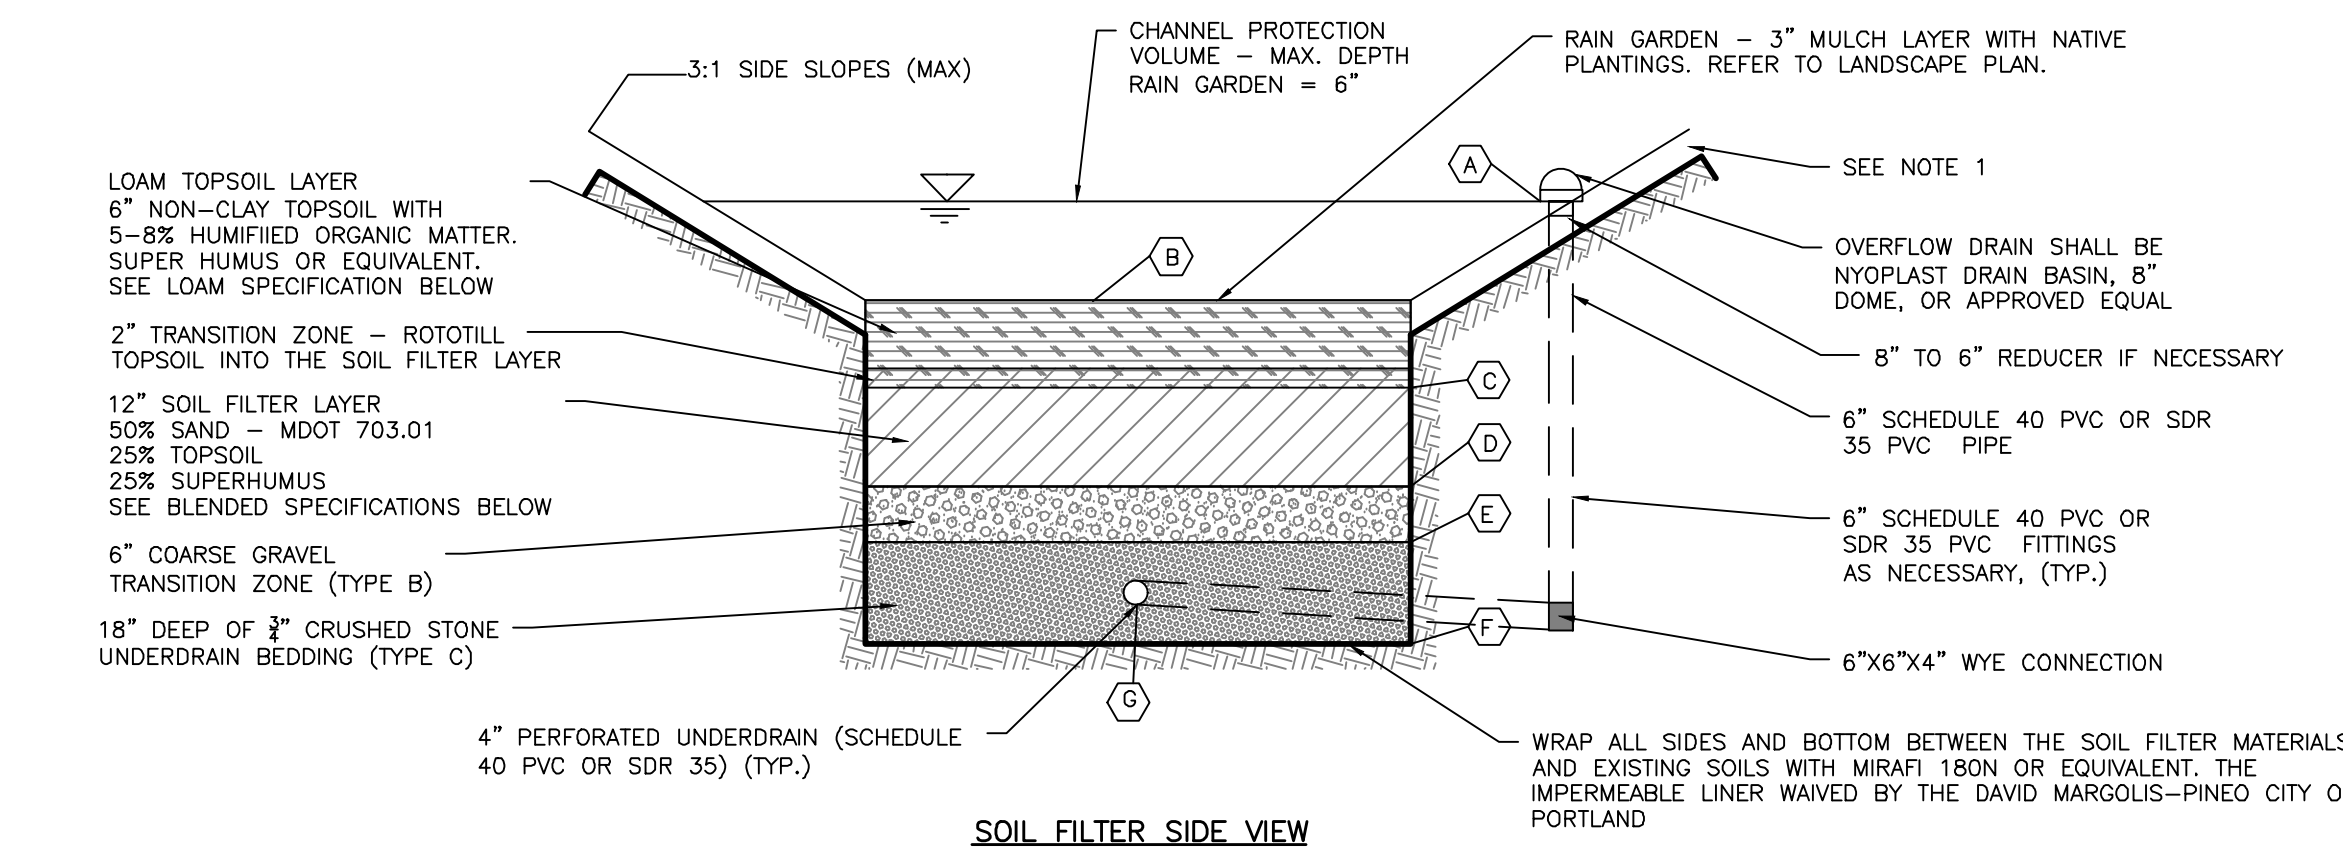

SOIL FILTER SIDE VIEW

- NOTES:
1. THE SIDESLOPES SHALL BE STABILIZED WITH HARDWOOD MULCH.
 2. LIGHT COMPACTION SOIL FILTER AND PIPE BEDDING MATERIAL. (90 TO 92% STANDARD PROCTOR). TESTING SHALL BE PERFORMED BY A QUALIFIED MATERIAL TESTING FIRM.
 3. THE SOIL FILTER MEDIA SHALL NOT BE CONSTRUCTED UNTIL THE AREA DRAINING TO THE BASIN HAS BEEN PERMANENTLY STABILIZED.
 4. A SCHEDULE OF APPROPRIATE PLANTS FOR THE RAIN GARDENS AT THE SITE CONDITIONS IS LOCATED IN THE LANDSCAPE PLAN.
 6. TESTING: SIEVE ANALYSIS INCLUDING HYDROMETER TESTING FOR CLAY CONTENT FOR EACH LAYER SHALL BE PERFORMED BY A QUALIFIED SOIL TESTING LABORATORY AND SUBMITTED TO THE PROJECT ENGINEER FOR APPROVAL 2 WEEKS PRIOR TO CONSTRUCTION. ALL TESTING AND SUBMITTALS SHALL BE IN ACCORDANCE WITH THE MOST RECENT VERSION OF THE MAINE DEP - TECHNICAL DESIGN MANUAL SECTION 7.2.5 TESTING AND SUBMITTALS.
 7. ACORN ENGINEERING, INC., RECOMMENDS THE SOIL FILTER LAYER BE SUPPLIED BY JONES ASSOCIATES, INC., AUBURN, ME.

6" LOAM TOPSOIL LAYER SPECIFICATION	
SIEVE SIZE	% PASSING BY WEIGHT
#4	75-95
#10	60-90
#40	35-85
#200	20-70

SOIL FILTER BED - SUPERHUMUS OR EQUIV. SPECIFICATION	
SIEVE SIZE	% PASSING BY WEIGHT
1"	100
#200	0-5


1. CLAY FRACTION <10% PASSING THE #200 SIEVE.*
 2. LOAM SHALL BE LOOSE AND FRIABLE AND SHALL BE FREE FROM ADMIXTURE OF SUBSOIL, REFUSE, LARGE STONES, CLOUDS OR ROOTS OR RHIZOMES OR "WITCH GRASS" OR OTHER UNDESIRABLE GRASSES.
 *<10% CLAY PASSING THE #200 SIEVE ALLOWED PER EMAIL FROM MARIANNE HUBERT - MDEP TO WILL SAVAGE DATED 9/20/13

12" SOIL FILTER BED - BLENDED SAND, LOAM, SUPERHUMUS SIEVE ANALYSIS	
SIEVE SIZE	% PASSING BY WEIGHT
#10	85-100
#20	70-100
#60	15-40
#200	8-15

1. CLAY FRACTION <2% PASSING THE #200 SIEVE.
 2. SUPERHUMUS OR EQUIVALENT


RAIN GARDEN DETAIL

NOT TO SCALE

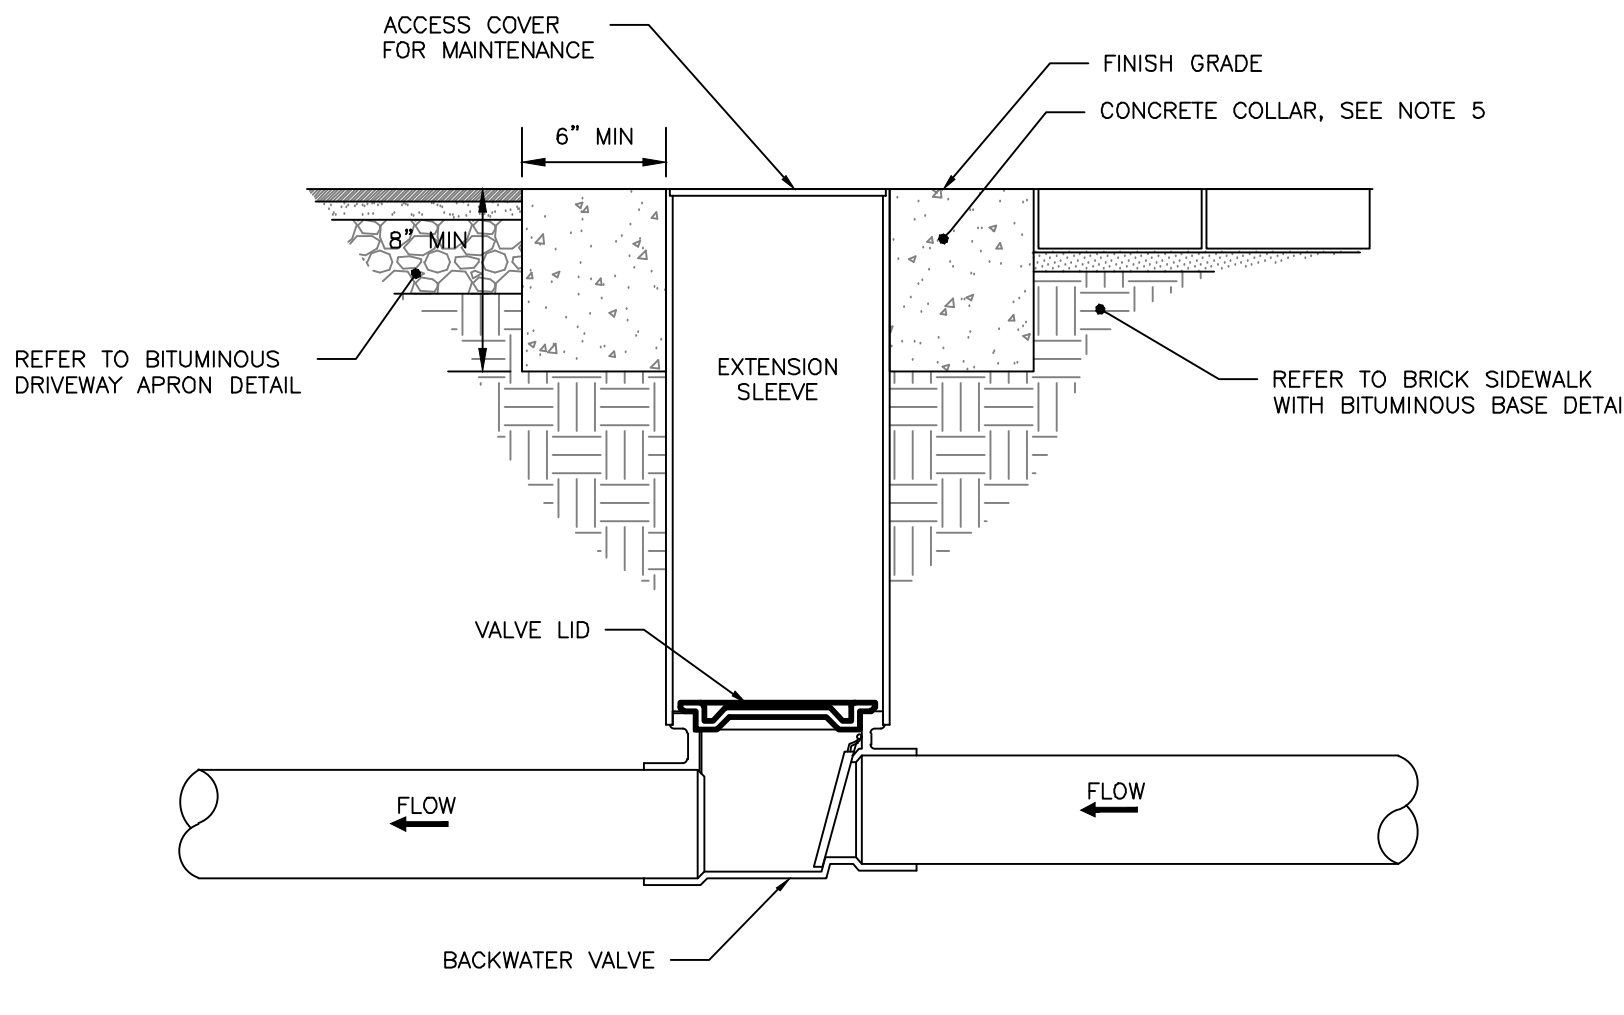

BACKFLOW VALVE ASSEMBLY NOT TO SCALE


- NOTES:
1. BACKFLOW VALVE TO BE PROVIDED BY AGRI DRAIN CORPORATION OR AN APPROVED EQUAL.
 2. VALVE TO BE INSTALLED TO MANUFACTURER'S SPECIFICATIONS AND COMPLY WITH RULES AND REGULATIONS AS OUTLINED IN SECTION 2 OF THE CITY OF PORTLAND TECHNICAL MANUAL.
 3. VALVE SHALL BE INSTALLED WITH A VALVE BOX AND COVER TO PROVIDE EASY ACCESS AND MAINTENANCE; VALVE COVER SHALL STATE "SEWER" ON LID FLUSH TO SURFACE. REFER TO VALVE & BOX COVER DETAIL FOR ADDITIONAL INFORMATION.
 4. CONCRETE COLLAR AT A MINIMUM 24-HOUR COMPRESSIVE STRENGTH OF 3,000 PSI.

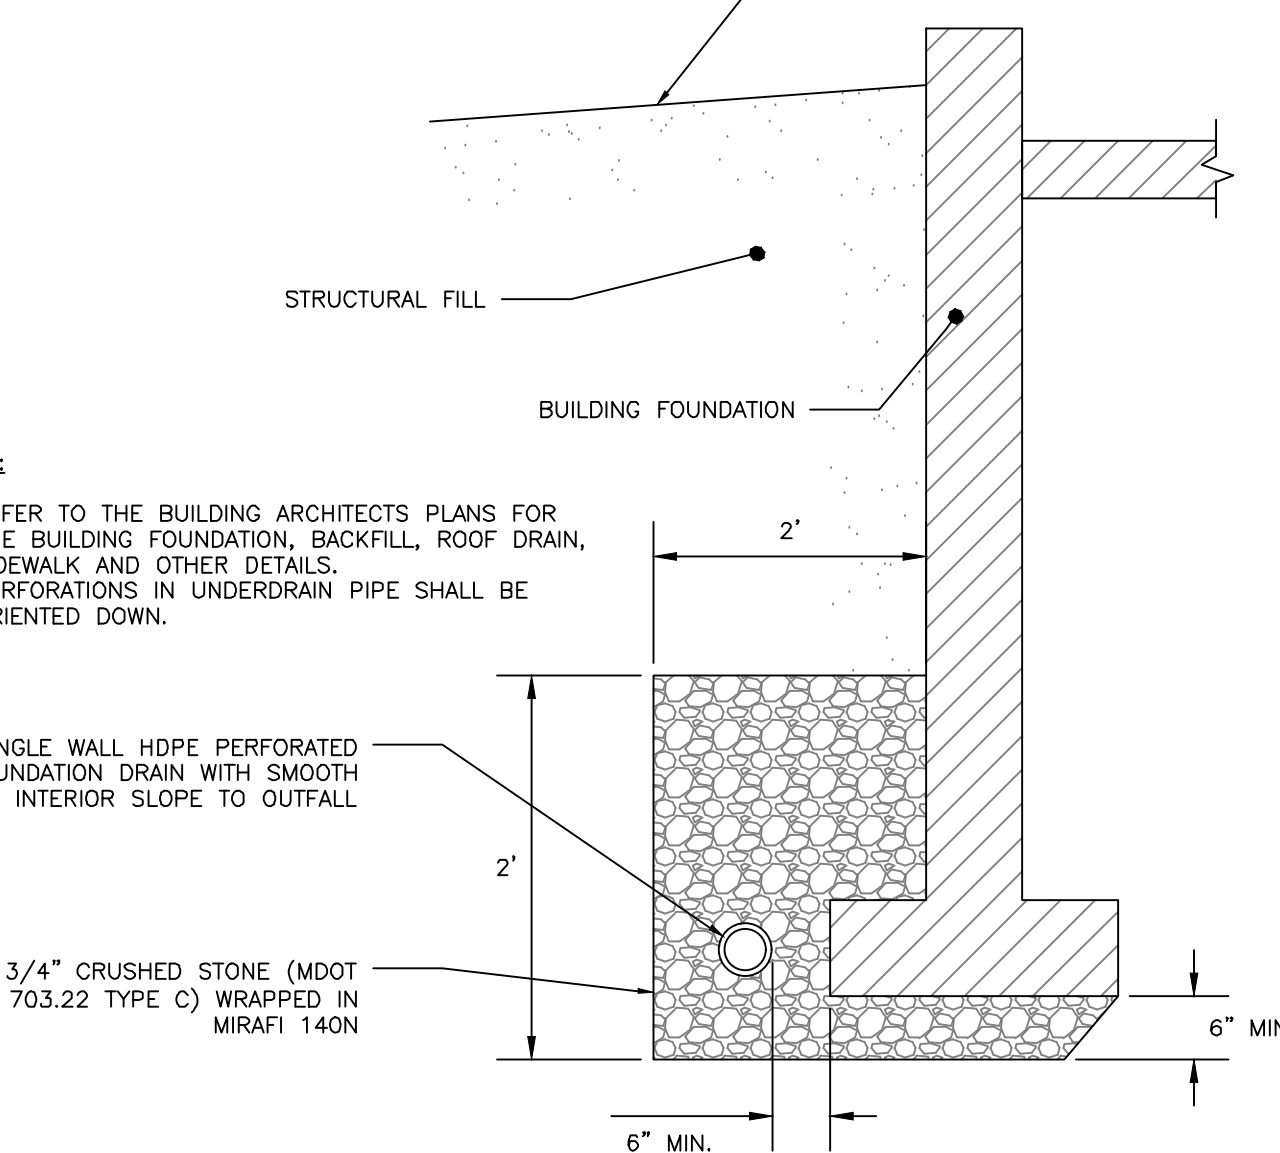

FOUNDATION DRAIN DETAIL NOT TO SCALE

- NOTES:
1. REFER TO THE BUILDING ARCHITECTS PLANS FOR THE BUILDING FOUNDATION, BACKFILL, ROOF DRAIN, SIDEWALK AND OTHER DETAILS.
 2. PERFORATIONS IN UNDERDRAIN PIPE SHALL BE ORIENTED DOWN.

4" SINGLE WALL HDPE PERFORATED FOUNDATION DRAIN WITH SMOOTH INTERIOR SLOPE TO OUTFALL
 3/4" CRUSHED STONE (MDOT 703.22 TYPE C) WRAPPED IN MIRAFI 140N

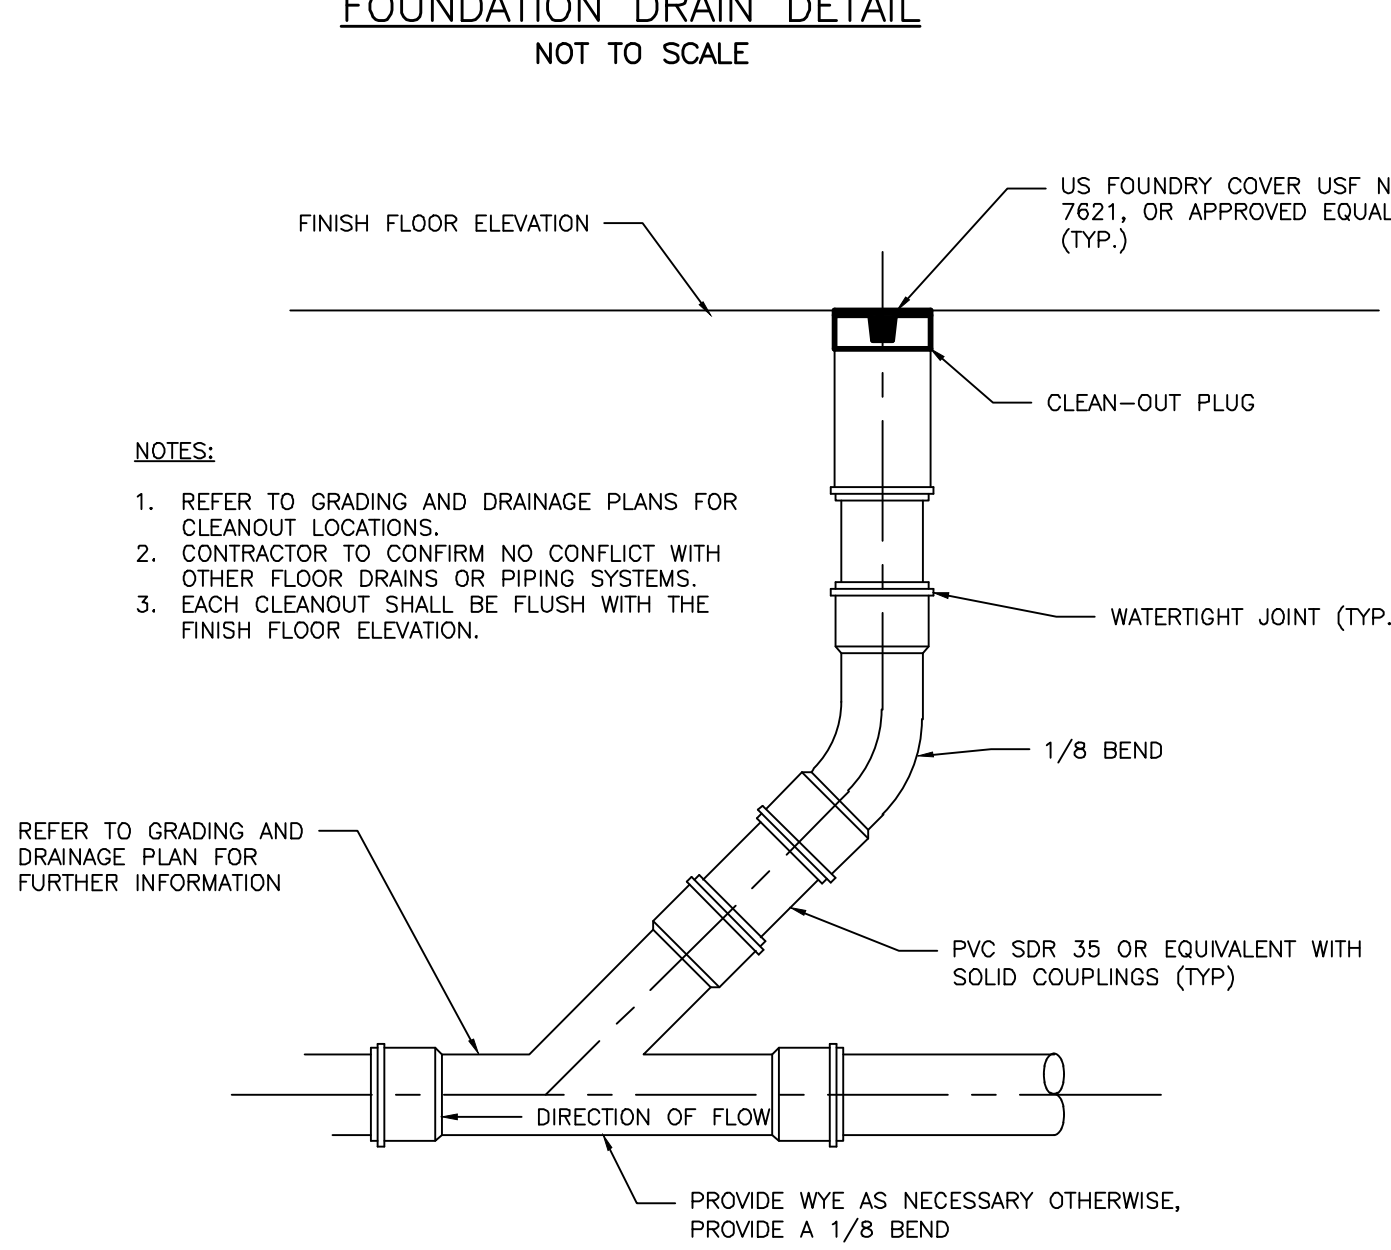


CLEANOUT DETAIL NOT TO SCALE

- NOTES:
1. REFER TO GRADING AND DRAINAGE PLANS FOR CLEANOUT LOCATIONS.
 2. CONTRACTOR TO CONFIRM NO CONFLICT WITH OTHER FLOOR DRAINS OR PIPING SYSTEMS.
 3. EACH CLEANOUT SHALL BE FLUSH WITH THE FINISH FLOOR ELEVATION.

SOIL FILTER BED - TRANSITION ZONE (TYPE B)	
SIEVE SIZE	% PASSING BY WEIGHT
1"	90-100
1/2"	75-100
#4	50-100
#20	15-80
#50	0-15
#200	0-5


SOIL FILTER BED - UNDERDRAIN BEDDING (TYPE C)	
SIEVE SIZE	% PASSING BY WEIGHT
1"	100
3/4"	90-100
3/8"	0-75
#4	0-25
#10	0-5

REFER TO GRADING AND DRAINAGE PLAN FOR FURTHER INFORMATION

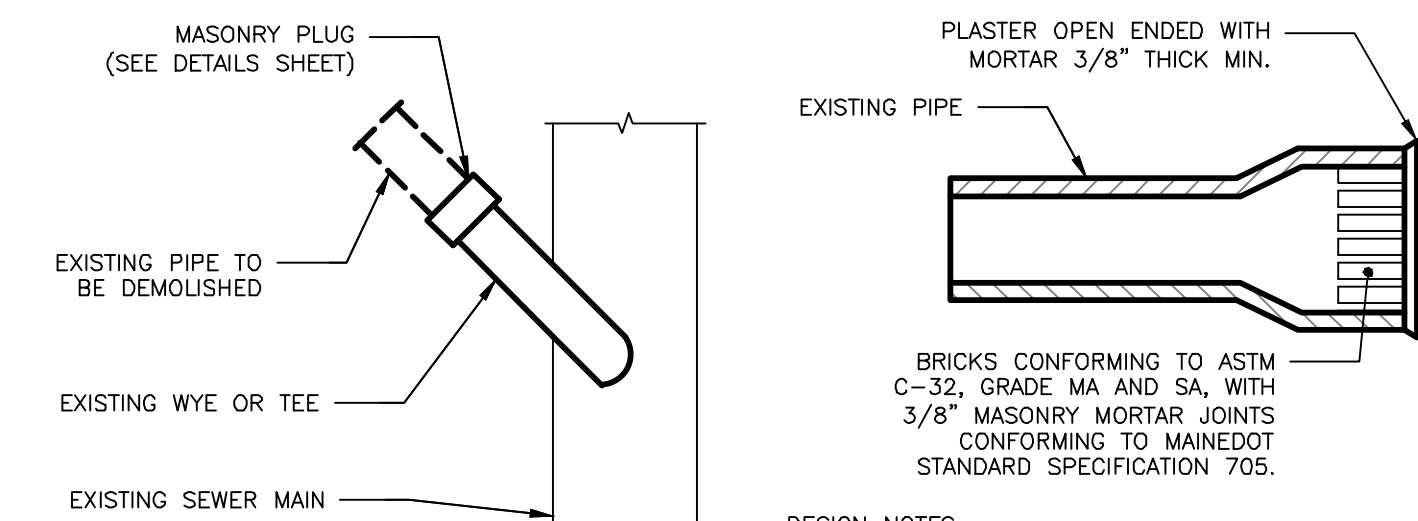


MASONRY PLUG DETAIL NOT TO SCALE

- DESIGN NOTES:
1. IT IS ASSUMED THAT THE EXISTING PIPE IS OF VITRIFIED CLAY CONSTRUCTION. USE CAP OR PLUG FOR PVC PIPE

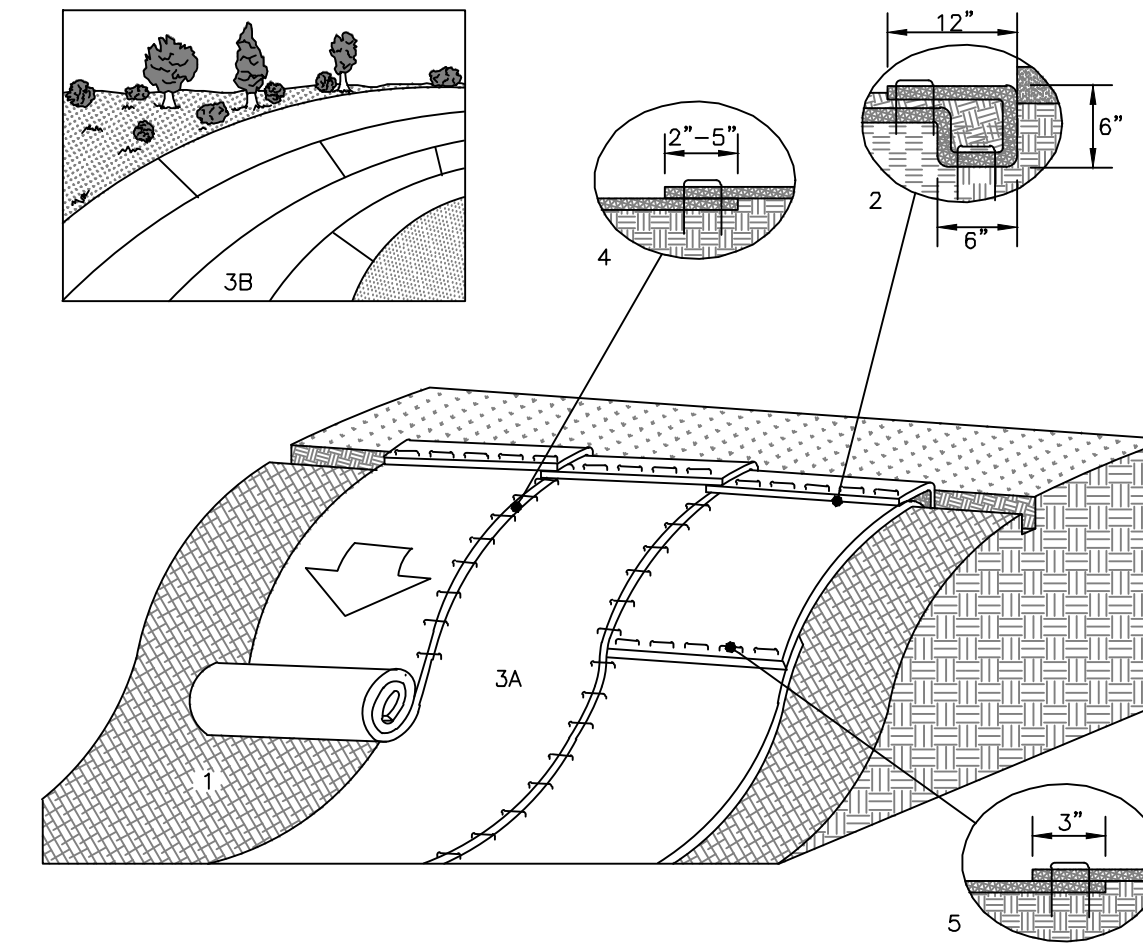

EROSION CONTROL BLANKET SLOPE INSTALLATION NOT TO SCALE

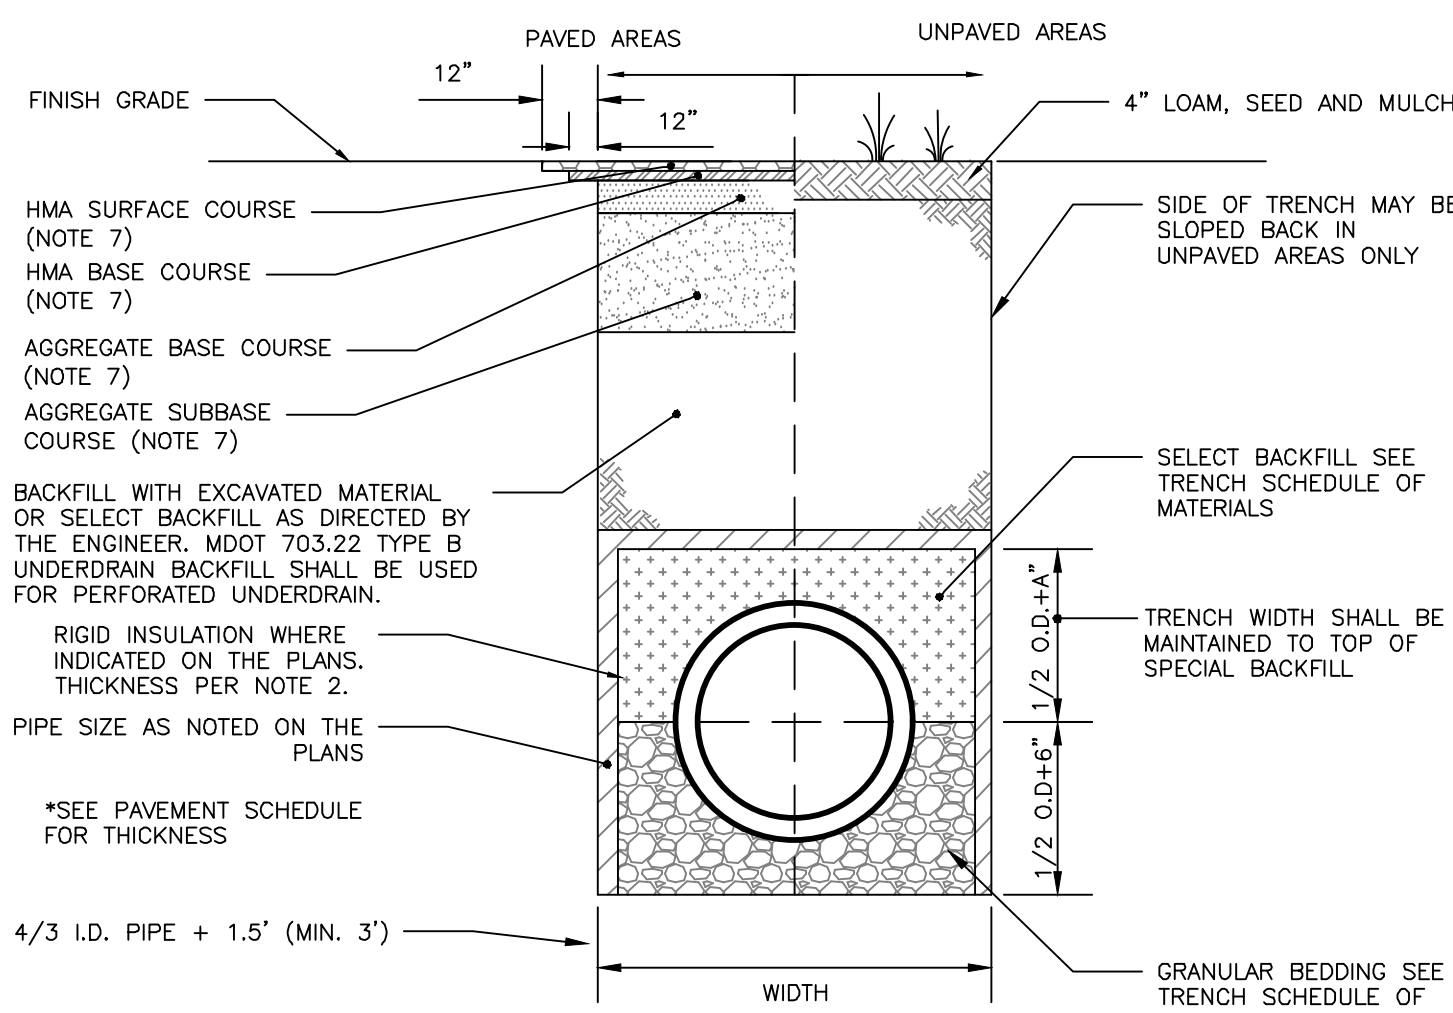

STORM DRAIN AND SEWER TYPICAL TRENCH SECTION NOT TO SCALE

- ALLOWABLE PIPE MATERIALS:
- REINFORCED CONCRETE PIPE (RCP) MIN. STRENGTH OF CLASS III
 - PVC RING TYPE SEWER (SDR 35) OR EQUIVALENT, MIN PS-46 RATING
 - PVC RING TYPE SEWER PIPE MEETING ASTM F 789
 - DUCTILE IRON PIPE (DIP)
 - ADS N-12 HP TRIPLE-WALL MIN PS-46 RATING
 - ADS SANITITE HP MIN. PS-46

SCHEDULE OF MATERIALS		
TYPE OF PIPE	GRANULAR BEDDING	SELECT BACKFILL
CMP DUCTILE IRON RCP	MDOT 703.22 TYPE B UD CRUSHED STONE	MDOT 703.22 TYPE B UD BACKFILL
PVC/HDPE	MDOT 703.22 TYPE C 3/4" CRUSHED STONE	MDOT 703.22 TYPE B UD BACKFILL
CMP	MDOT 703.22 TYPE C 3/4" CRUSHED STONE	MDOT 703.22 TYPE C 3/4" CRUSHED STONE

- NOTES:
1. BRACING AND SHEETING OR OTHER TRENCH PROTECTION TO BE PROVIDED TO MEET APPLICABLE STATE AND O.S.H.A. SAFETY STANDARDS. ALL SUCH TRENCH PROTECTION TO BE THE RESPONSIBILITY OF THE CONTRACTOR.
 2. STORM DRAIN COVER BETWEEN 2' AND 3' SHALL INCLUDE 4" OF RIGID INSULATION, COVER BETWEEN 3' AND 4' SHALL INCLUDE 2" RIGID INSULATION. OTHER UTILITIES: ADD 2" OF RIGID INSULATION FOR EACH FOOT ABOVE MINIMUM DEPTH.
 3. INSTALL WARNING TAPE DIRECTLY ABOVE UTILITIES AT THE TOP OF SUBGRADE.
 4. MINIMUM COVER
 - 4.1. 2'-0" - STORM DRAIN
 - 4.2. 5'-0" - SEWER PIPE OR SERVICE
 5. NO TREES SHALL BE PLANTED WITHIN 5' OF A SEWER PIPE OR SERVICE
 6. THIS DETAIL SHALL BE APPLIED ONLY TO DRAINAGE PIPE TRENCHES OUTSIDE OF THE CITY OF PORTLAND ROW.
 7. THICKNESS AS NOTED BY SURFACE DETAILS

BUILDING PERMIT ISSUED FOR CONSTRUCTION

ISSUED FOR	BY
PRELIM. APPLICATION	WHS
FINAL APPLICATION	WHS
REV. GRADES	WHS
BUILDING PERMIT	WHS
COA	WHS
REVISION	REV. DATE

DRAINAGE DETAILS
 PROJECT NAME: 31 FORE STREET REDEVELOPMENT
 CLIENT: PENINSULA PROPERTY DEVELOPMENT, LLC.
 59 MOODY STREET, PORTLAND MAINE 04101

ACORN ENGINEERING, INC. MAINE 04102
 158 DANFORTH (207) 779-2665

FILE: 1068_DETAILS
 DATE: 12/28/15
 JN: 1068
 SCALE: NTS
 DESIGNED BY: WHS
 DRAWN BY: WHS
 CHECKED BY: WHS

STATE OF MAINE
 WILLIAM J. SAVAGE
 No. 1416
 5-12-16

DRAWING NO. C-43