

ENGINEERING DATA

THERMALLY CONDUCTIVE, PATENTED ALUMINUM CORE

The counter-flow heat recovery core transfers heat between the two airstreams. It is easily removed for cleaning or service.

MOTORS AND BLOWERS

Each airstream has one centrifugal blower driven by a common PSC motor, with multiple fanspeed operations.

FILTERS

Washable air filters in exhaust and supply airstreams.

MOUNTING THE HRV

Threaded inserts at corners of the cabinet designed to accept the "S" hooks and hanging straps supplied with the unit.

DEFROST

Recirculating damper defrost system.

CASE

20 gauge prepainted galvanized steel for superior corrosion resistance, insulated to prevent exterior condensation. Drain connections: Two 1/2 in (12 mm) OD. Balancing ports are located on unit.

ELECTRONICS

Control included with the unit can be wall mounted in a central location of the home. 3 wire 20 gauge (min.) 100 ft length (max.).

CONTROLS

99-DXPL01 Lifestyle MAX Digital Control

- 5 speed operation on each mode
- 4 user selectable operational modes: Continuous Ventilation, 20 ON/40 OFF, 20 ON/40 Recirculation, Continuous Recirculation
- Humidity control through dehumidistat
- Adjustable dehumidistat function built into main wall control
- Built in relay for interfacing to furnace

OPTIONAL CONTROLS

99-LS01 Lifestyle MAX Programmable Control - Contains all the features of the Lifestyle MAX Digital Control with 24/7 programmable ventilation, 3 wire connection.

OPTIONAL TIMERS

99-DET01 Lifestyle 20/40/60 Minute Timer - Initiates high speed ventilation for 20, 40, or 60 minutes, 3 wire connection.

99-20M01 Lifestyle 20 Minute Timer - Initiates high speed ventilation for 20 minutes, 3 wire connection.

99-101 Mechanical Timer - Initiates high speed ventilation for up to 60 minutes, 2 wire connection.

OPTIONAL ACCESSORIES


99-DH01 Lifestyle Dehumidistat - Initiates high speed ventilation when the indoor humidity level is above the set point. 3 wire connection.

99-163 Duct Heater w/Electronic SCR Thermostat - 1 kW, 6 in (152 mm).

99-186 Weatherhoods - Two 6 in (152 mm)

WEIGHT 71 lbs (32.3 kg) **SHIPPING WEIGHT** 73 lbs (33.2 kg)

DIMENSIONS 155MAX

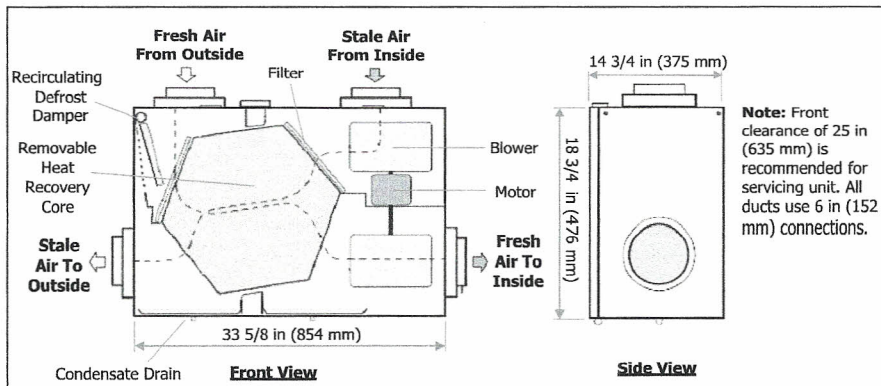


Performance (HVI certified)	
Net supply air flow in cfm (L/s) against external static pressure	
External Static Pressure	Airflow
@ 0.1 in (25 Pa)	184 cfm (87 L/s)
@ 0.2 in (50 Pa)	163 cfm (77 L/s)
@ 0.3 in (75 Pa)	146 cfm (69 L/s)
@ 0.4 in (100 Pa)	132 cfm (62 L/s)
@ 0.5 in (125 Pa)	115 cfm (54 L/s)
@ 0.6 in (150 Pa)	92 cfm (43 L/s)
@ 0.7 in (175 Pa)	60 cfm (28 L/s)
Max. Temperature Recovery	86%
Sensible Effectiveness @ 59 cfm (28 L/s)	32°F (0°C) 84%
Sensible E efficiency @ 59 cfm (28 L/s)	32°F (0°C) 75%
Sensible E efficiency @ 64 cfm (51 L/s)	-13°F (-25°C) 72%
VAC @ 60Hz	115
Watts / Low speed	66
Watts / High speed	118
Amp rating	1.4

Sensible Efficiency: Thermal

Effectiveness: Based on temperature differential between the 2 airstreams

Efficiency: Takes into account all power inputs

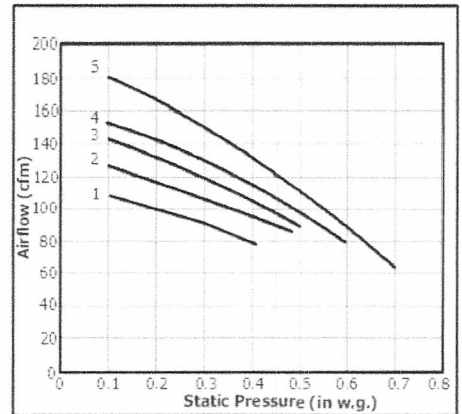

WARRANTY

Units carry a lifetime warranty on the HRV core and a 5 year replacement parts warranty.

NOTE: All specifications are subject to change without notice.

All units conform to CSA and UL standards



Date: _____

Tag: _____ Qty: _____

Project: _____

Engineer: _____

Contractor: _____

Supplier: _____

Quote #: _____

Submitted By: _____

Installation

Location

Install the unit in a heated space that provides convenient space for service access. A typical location is in either a mechanical room or an area close to the outside wall within close proximity to where the weatherhoods are mounted. If a basement area is inconvenient or non-existent, install the unit in a utility or laundry room.

Attic installations are not recommended due to:

- A) the complexity of work to install
- B) freezing conditions in the attic
- C) difficulty of access for servicing and cleaning

Leave sufficient clearance at the front of the access door for servicing the air filters and core. The recommended clearance is a minimum of 25" (635 mm) for opening and closing the door. Airia provides four straps for hanging the unit from the basement floor joists.

⚠ WARNING

Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury or loss of life. Installation and service must be performed by a qualified installer or service agency.

Using Adjustable Hanging Straps to Suspend the Unit


The adjustable hanging straps are designed to reduce the possibility of noise, resonance and harmonics.

NOTE: Provide a front clearance of 25 inches (635 mm) for servicing the unit.


⚠ CAUTION

Unit must be installed level to ensure proper condensate drainage. Due to the broad range of installation and operational conditions, consider the possibility of condensation forming on either the unit or connecting ducting. Objects below the installation may be exposed to condensate.


1. Insert screws (not included) through the Hanging Strap grommets and fasten to the joists. Ensure the screw head is wider than the eyelet of the grommet.

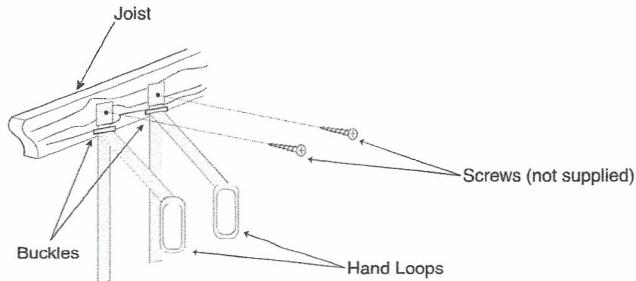

2. Unscrew the 4 machine screws located on the upper side of the unit. Attach the "S" hooks and reinsert the machine screws.

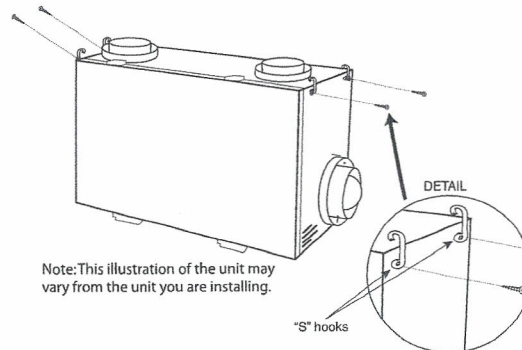

3. Hook the bottom grommets of the straps through the "S" hooks. Pull down on the hand loops while lifting up the bottom of the unit. Repeat at opposite end of the unit.

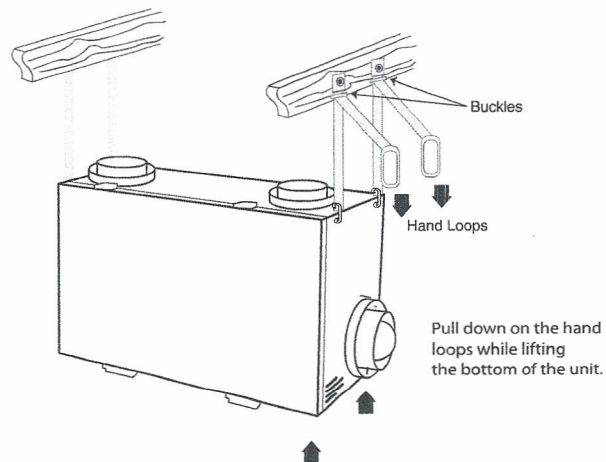

4. Make certain the unit is level. Adjust the unit down by lifting up on the buckle. Fold the hand loops and excess strap and secure with a nylon tie.

Electrical

Plug the unit into a standard designated (120 VAC) electrical outlet with ground. The use of an extension cord with this unit is not recommended. If the installation requires further wiring, have a licensed electrician make all of the electrical connections. The recommended circuit is a separate 15 amp/120 volt circuit.

WARNING:

To prevent electrical shock while either cleaning or servicing the unit, it is *extremely important* to confirm the polarity of the power line that is switched by the safety (disconnect) switch. The hot line (black) is the proper line for switching. To confirm the proper polarity, use a voltmeter or test lamp to ensure there is no voltage after the switch when the door is open. Check between that point and ground (on the cabinet). This procedure must be followed, as dwellings are occasionally wired improperly. Always ensure the proper grounding of the unit.