
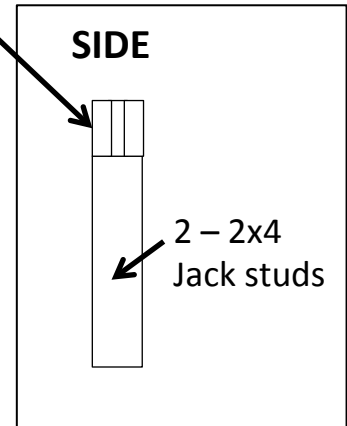


**FRONT**

2 – 9'7" x 1-3/4" x 7-1/4" 2.0 E Microlam LVL (see next page) and  
1 - 9'7" x 1/2" x 7-14" CDX plywood

Existing 4x6" top plate

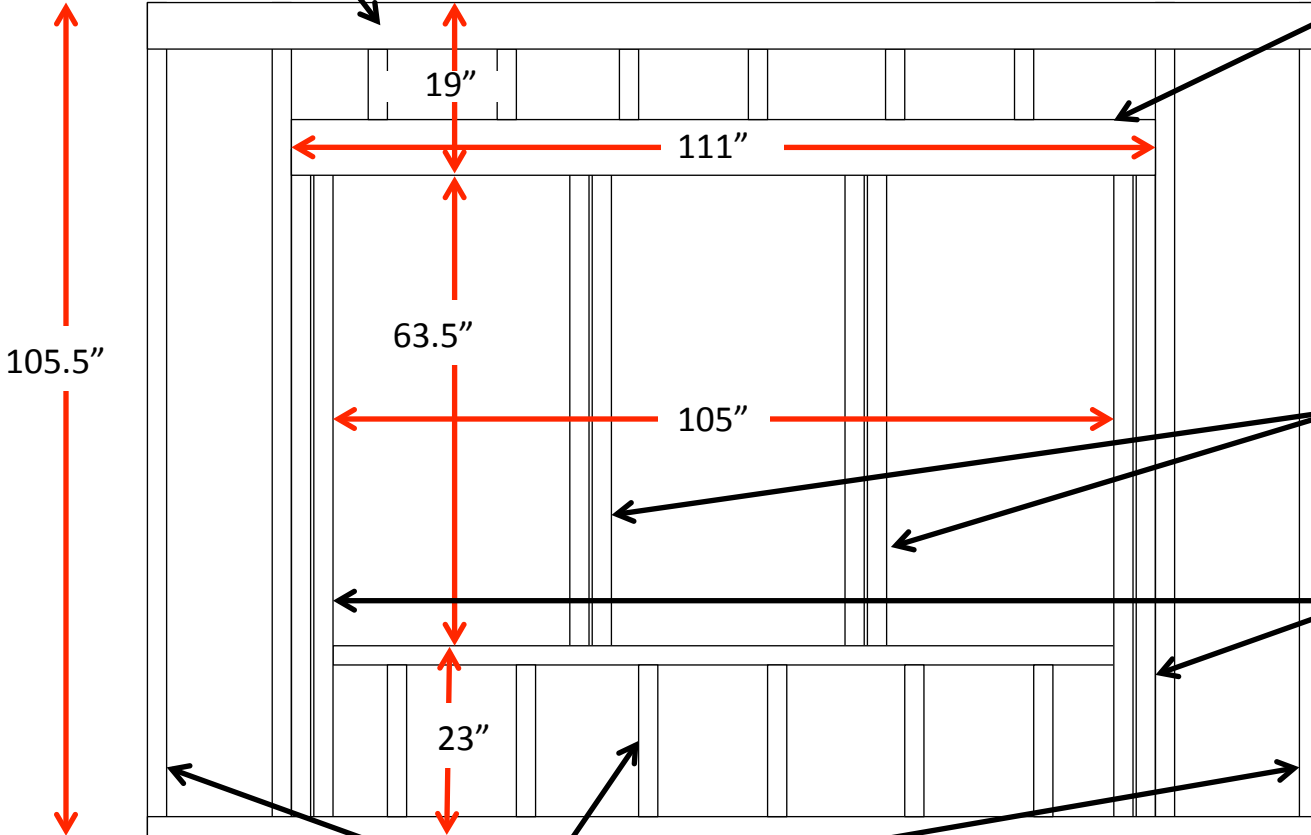

2x4 stud  
pockets  
for trim

2 - 2x4  
Jack studs


Existing full 2" x 4" 16" O.C.



Scale: 1/2" = 1'

**2 piece(s) 1 3/4" x 7 1/4" 2.0E Microllam® LVL**

Overall Length: 9' 7.00"

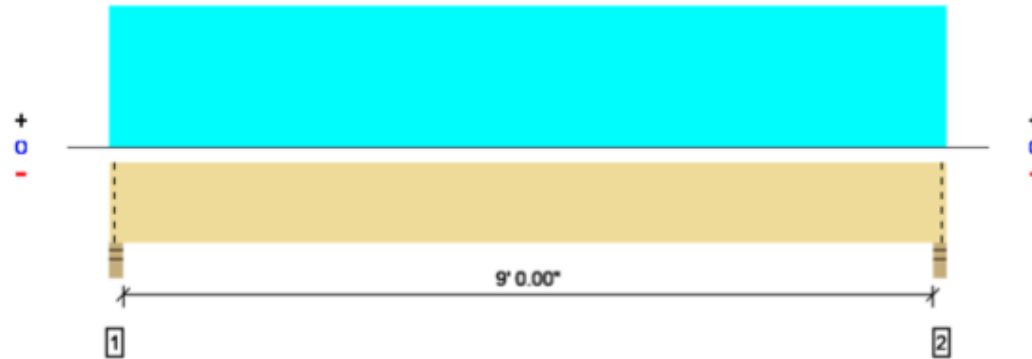

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load: Combination (Pattern)
Member Reaction (lbs)	2370 @ 2.00"	4961 (3.50")	Passed (48%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	1927 @ 10.75"	5544	Passed (35%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	5289 @ 4' 9.50"	8182	Passed (65%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.308 @ 4' 9.50"	0.308	Passed (L/360)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.390 @ 4' 9.50"	0.463	Passed (L/284)	--	1.0 D + 1.0 S (All Spans)

 System : Floor  
 Member Type : Flush Beam  
 Building Use : Residential  
 Building Code : IBC  
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 9' 7.00" o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Stud wall - HF	3.50"	3.50"	1.67"	501	1869	2370	Blocking
2 - Stud wall - HF	3.50"	3.50"	1.67"	501	1869	2370	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 9' 7.00"	6' 6.00"	15.0	60.0	ROOF LOAD

**Weyerhaeuser Notes**

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Refer to current Weyerhaeuser literature for installation details. (www.woodbywy.com) Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator