



ROOF

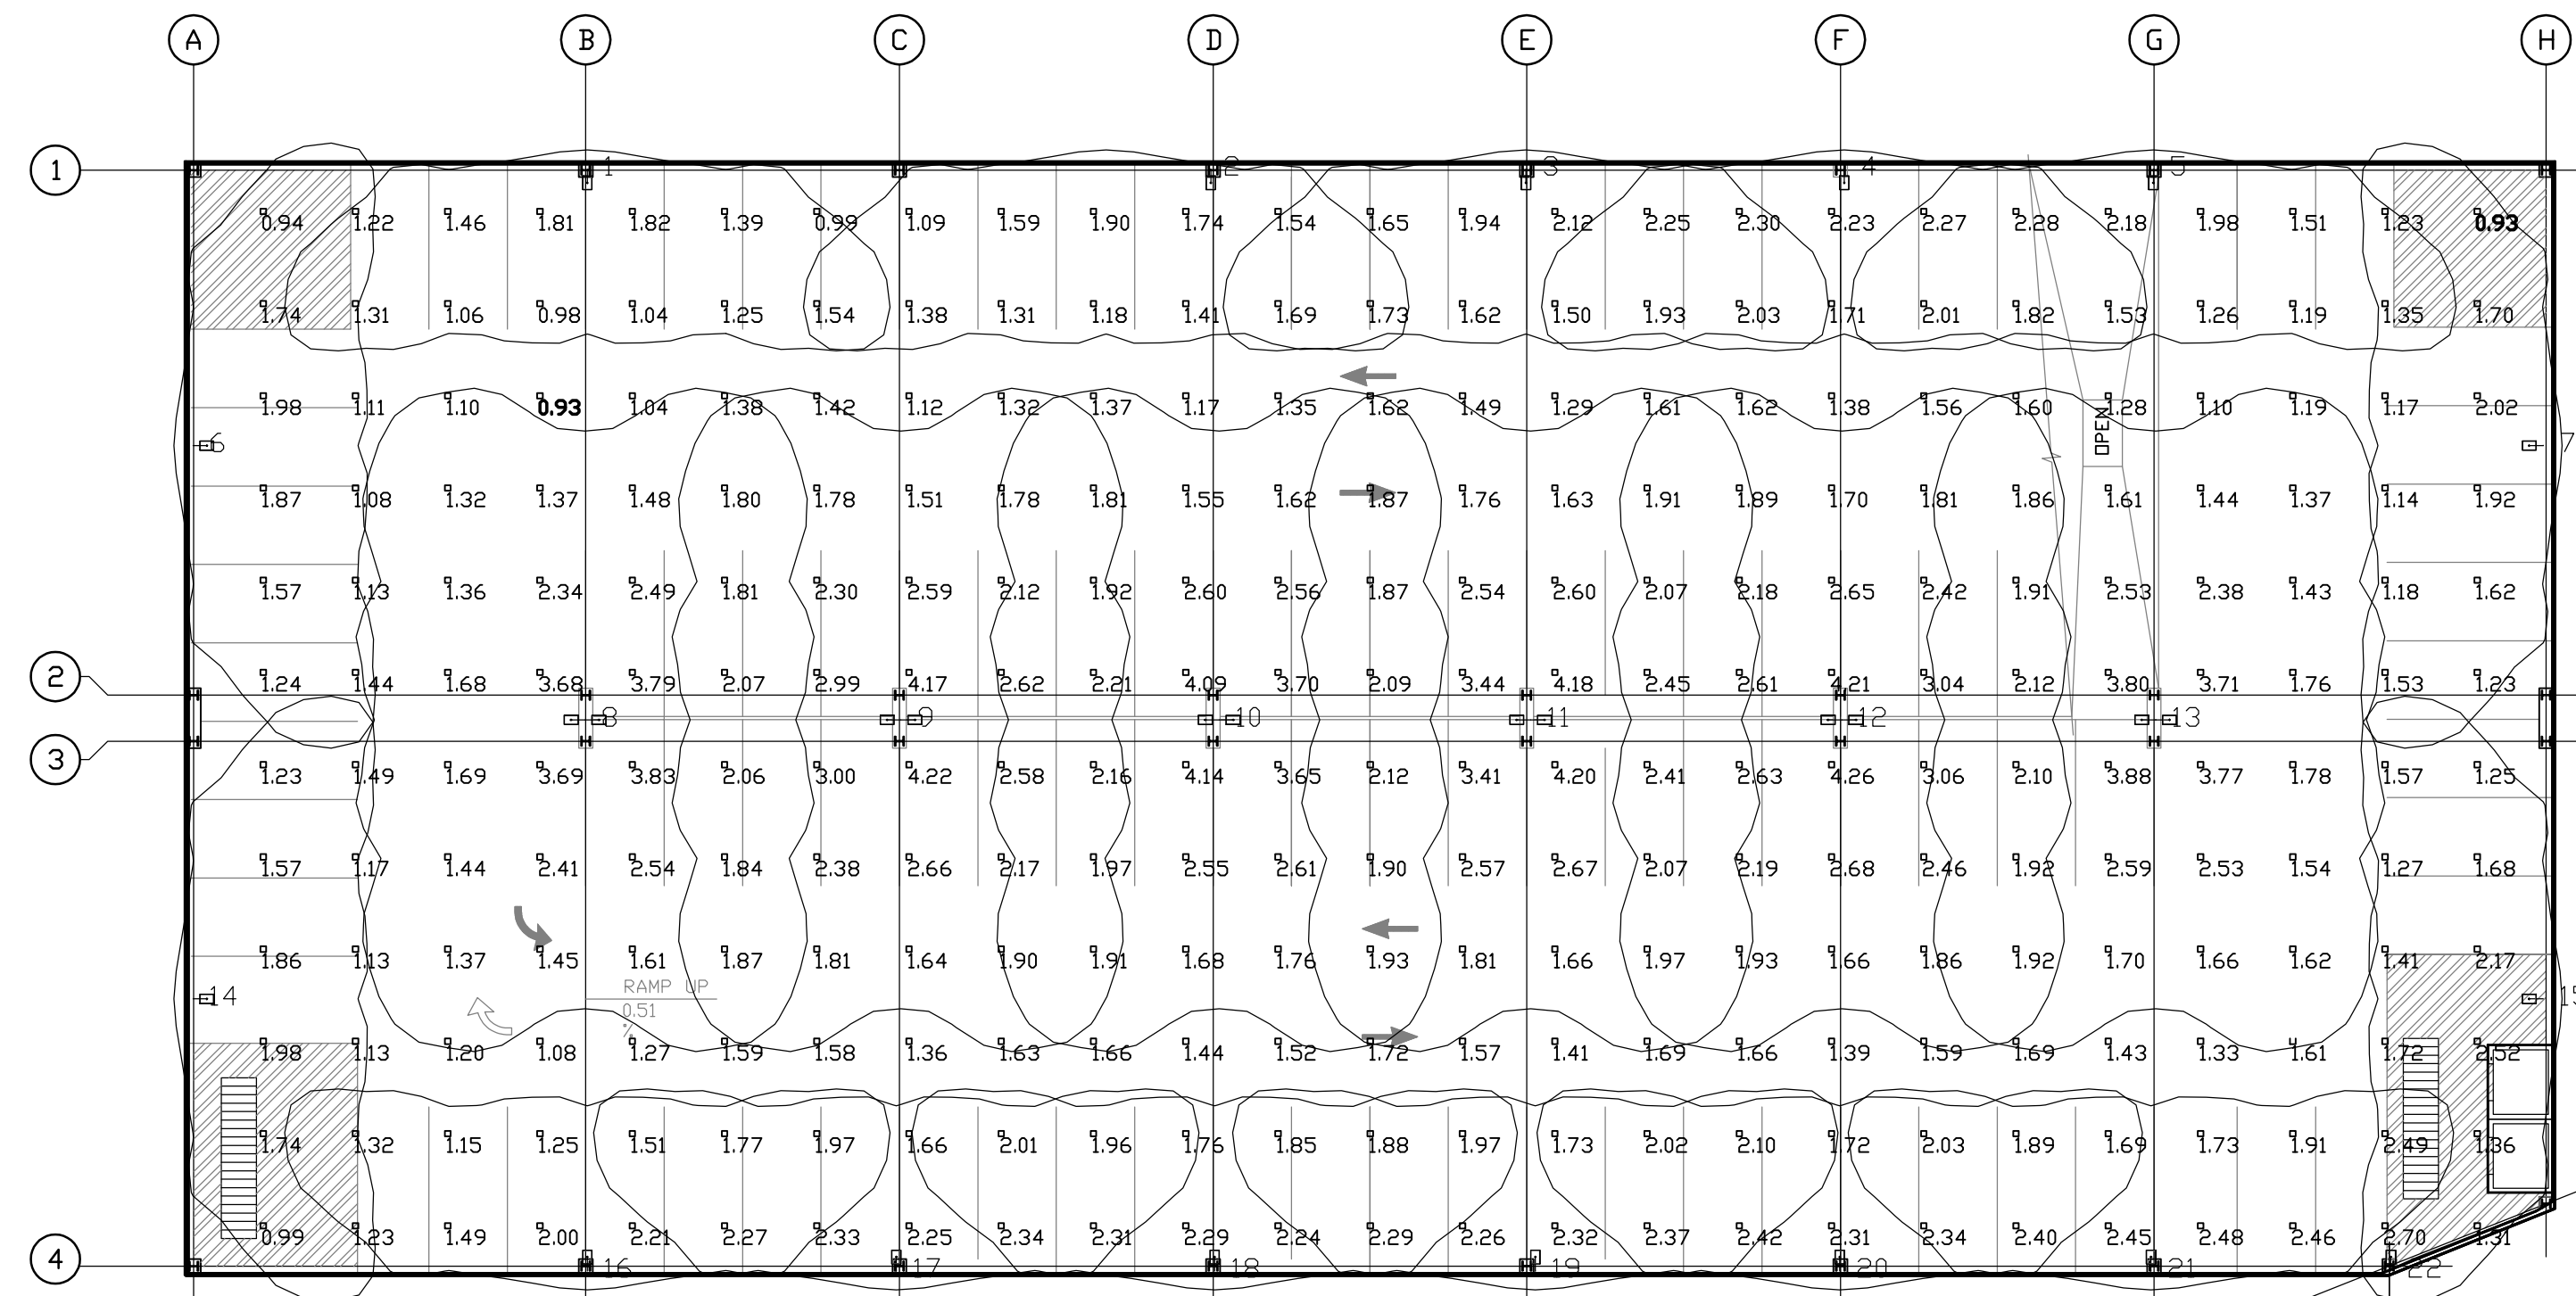

Symbol	Qty	Label	Description	Lumens	LLF	Filename
□	15	S3hs	1A/SAR3_70Mhxxx_xx_HS	5900	0.720	SAR3-070M-HSies
□	6	S3z	2B/SAR3_70Mhxxx_xx	5900	0.720	SAR3-070Mies
□	1	S4hs	1A/SAR4_70Mhxxx_xx_HS	5900	0.720	SAR4-070M-HSies

SeqNo	Status	Label	X	Y	Z	Orient	Tilt
1	Dn	S3hs	5283.25	-1439	15	270	0
2	Dn	S3hs	5339.5	-1439	15	270	0
3	Dn	S3hs	5385	-1439	15	270	0
4	Dn	S3hs	5419.5	-1439	15	270	0
5	Dn	S3hs	5453	-1439	15	270	0
6	Dn	S3hs	5240.5	-1469	15	0	0
7	Dn	S3hs	5495.25	-1469	15	180	0
14	Dn	S3hs	5240.5	-1529	15	0	0
15	Dn	S3hs	5495.25	-1529	15	180	0
16	Dn	S3hs	5283.25	-1558.5	15	90	0
17	Dn	S3hs	5316.75	-1558.5	15	90	0
18	Dn	S3hs	5351.25	-1558.5	15	90	0
19	Dn	S3hs	5386	-1558.5	15	90	0
20	Dn	S3hs	5419	-1558.5	15	90	0
21	Dn	S3hs	5452.75	-1558.5	15	90	0
8	Dn	S3z	5283	-1498.75	15	0	0
9	Dn	S3z	5317.25	-1498.75	15	0	0
10	Dn	S3z	5351.75	-1498.75	15	0	0
11	Dn	S3z	5385.5	-1498.75	15	0	0
12	Dn	S3z	5419.25	-1498.75	15	0	0
13	Dn	S3z	5453.25	-1498.75	15	0	0
22	Dn	S4hs	5478.75	-1558.5	15	90	0

Label	CalcType	Units	Avg	Max	Mn	Avg/Mn	Max/Mn
Structure_Top	Illuminance	Fc	1.94	4.26	0.93	2.09	4.58
Grid_Level	Illuminance	Fc	0.01	0.08	0.00	NA	NA

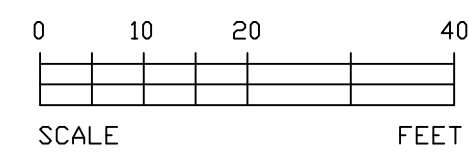

OMNI-LITE, INC. 263 WYNN STREET BURLINGTON, MA 01803 PH # 781-272-2300, FAX # 781-272-0759 www.omnilight.com	
PROJECT: OCEAN GATEWAY GARAGE	
CLIENT: SIMON DESIGN ENGINEERING, LLC	
SCALE: FEET	FILE: ocean_gateway_roof_01.adm
DATE: 12/22/2006	SALES PERSON: JOHN CUOCO
THESE DRAWINGS ARE FOR CONCEPTUAL USE ONLY AND ARE NOT INTENDED FOR CONSTRUCTION. VALUES REPRESENTED ARE AN APPROXIMATION GENERATED FROM DATA SUPPLIED BY LAMP MFG. AND TESTING LABS.	