



NOTES:

1. MINIMUM SLOPE FOR ALL SANITARY SEWER SERVICES SHALL BE 1/8" / FT
2. MINIMUM SLOPE FOR ALL STORM DRAIN SERVICES SHALL BE 0.005
3. REFER TO SECTION II, FIGURE II-19 OF THE CITY OF PORTLAND, MAINE TECHNICAL AND DESIGN STANDARDS AND GUIDELINES FOR WYE CONNECTION DETAIL
4. UTILITY SERVICES SHALL BE CAPPED 3' FROM R.O.W. AND FIELD STAKED. 2X4 STAKE TO BE CUT OFF 6" BELOW FINISH GRADE WITH 16D NAIL DRIVEN IN END/TOP

6" D.I. DOMESTIC WATER SERVICE WITH 6" GATE VALVE AND 6"x12" TAPPING SLEEVE. CAP END AND PROVIDE BLOW OFF VALVE IN ACCORDANCE WITH PWD STANDARDS. PROVIDE THRUST BLOCK AT MAIN. STA 13+30

8" D.I. FIRE SERVICE WITH 8" GATE VALVE AND 8"x12" TAPPING SLEEVE. CAP END AND PROVIDE BLOW OFF VALVE IN ACCORDANCE WITH PWD STANDARDS. PROVIDE THRUST BLOCK AT MAIN. STA 13+11

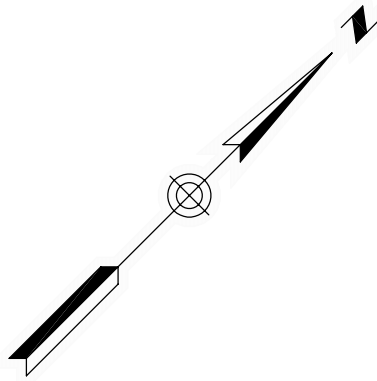

WOODARD & CURRAN
 Engineering • Science • Operations
 41 Hutchins Drive - Portland, Maine 04102
 DESIGN BY: JBC/INTD/CHECK BY: DAS DATE: 08/03/2006

STATE OF MAINE DEPARTMENT OF TRANSPORTATION	OCEAN GATEWAY PHASE 1 CITY OF PORTLAND CUMBERLAND COUNTY	SK-C007 LONGFELLOW UTILITY SERVICES COMMERCIAL STREET
PROJECT NUMBER: MH-9215(500)X, NH-9215(600)X, & STP-9215(700)X PIN NUMBER: 9215.50, 9215.60, & 9215.70		