





























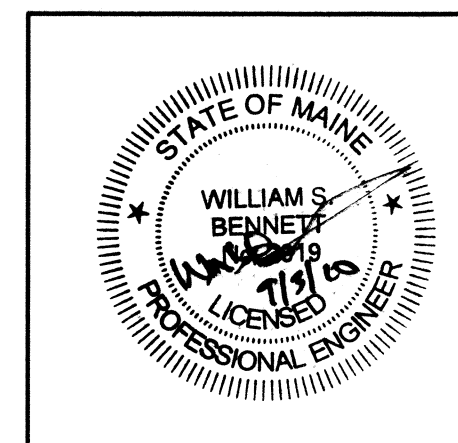


LEGEND

	CABLE TRAY FOR COMMUNICATIONS AT BAR JOIST
	NIGHT LIGHT FIXTURE
	2X4 LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE)
	1X4 LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE, DIAGONAL LINE DENOTES NIGHT LIGHT)
	DOWN LIGHT FIXTURE (# INDICATES TYPE PER FIXTURE SCHEDULE)
	SINGLE POLE SWITCH - MOUNTED 48" AFF TO TOP
	THREE WAY SWITCH - MOUNTED 48" AFF TO TOP
	FOUR WAY SWITCH - MOUNTED 48" AFF TO TOP
	SPECIALTY OUTLET
	DUPLEX CONVENIENCE OUTLET 18" AFF TO CENTER EXCEPT AS NOTED
	208 V RECEPTACLE
	DOUBLE DUPLEX CONVENIENCE OUTLET 18" AFF TO CENTER EXCEPT AS NOTED
	JUNCTION BOX - SIZED AS REQUIRED
	POWER POLE CONNECTION. PANEL AND CIRCUITING AS INDICATED
	DISCONNECT SWITCH - FUSED AS REQUIRED (DIAGONAL LINE INDICATES FUSED)
	ELECTRIC MOTOR CONTROLLER
	EXIT LIGHT ATLITE #PNLRU W/LED LAMPS BATTERY BACKUP
	EBU - EMERGENCY LIGHT BATTERY UNIT. 120V VOLT AC. BATTERIES TO BE RATED FOR 90 MINUTES FOR CONNECTED LOAD.
	TEL/DATA RECEPTACLES (HALF SHADED DENOTES TELEPHONE AND DATA, CLEAR TELEPHONE ONLY)
	POWER FLOOR BOX
	FRACTIONAL HP MOTOR
	MECHANICAL EQUIPMENT
	PANELXX - PANELBOARD- SEE SCHEDULES FOR CIRCUITING
	NURSE CALL DOME LIGHT
	NURSE CALL PULL STATION
GFI	GROUND FAULT INTERRUPTER /W SURGE SUPPRESSOR
EWC	ELECTRIC WATER COOLER
EF	EXHAUST FAN
WP	WEATHERPROOF
PC	PARTIAL CIRCUIT
FBO	FURNISHED BY OTHERS
C	COUNTER HEIGHT (SEE MILLWORK DRAWINGS FOR HEIGHT)
H	HOSPITAL GRADE W/RED FACE AND PLATE. IF GFI, DEVICE TO HAVE SURGE SUPPRESSOR
IG	ISOLATED GROUND OUTLET /W SURGE SUPPRESSOR. ORANGE FACE AND PLATE
ST	MANUAL THERMAL OVERLOAD SWITCH
BD	BUSS DUCT
DTT	DRY TYPE TRANSFORMER
<u>FIRE ALARM SYSTEM</u>	
	FIRE ALARM MANUAL STATION 48" AFF
	FIRE ALARM HORN AND LIGHT UNIT - MOUNT 80" AFF EXCEPT NO CLOSER THAN 6" TO CEILING. NUMBER DENOTES CANDELA RATING
	SPRINKLER TAMPER SWITCH
	SPRINKLER WATERFLOW SWITCH
	FIRE ALARM VISUAL UNIT (NUMBER DENOTES CANDELA RATING) 6'8" AFF

- NOTES:
 1) HOSPITAL GRADE WIRING AND DEVICES IN EXAM AREAS.
 2) WIRING TO BE HOSPITAL GRADE MC IN ALL AREAS.
 3) SECURITY PANEL AND DEVICES ARE FURNISHED AND WIRING BY OTHERS.
 4) MOTIONS DETECTOR IN MEDICATION AND COMM. ROOMS WILL BE SUPPLIED AND WIRED BACK TO PANEL IN ELECTRIC ROOM

SHEETS	
E100	LEDGEND
E200	SITE
E300	LIGHTING
E400	POWER
E500	DETAILS
E600	SCHEDULES



B.H. Milliken
 ELECTRICAL CONTRACTORS
 175 ANDERSON STREET
 PORTLAND, MAINE 04101
 PHONE 879-1877
 FAX: 774-1492

THESE ELECTRICAL DRAWINGS ARE THE PROPERTY OF B.H. MILLIKEN ELECTRICAL CONTRACTORS INC. AND FOR THEIR USE ONLY.

PORTLAND DEPARTMENT OF VETERANS
 AFFAIRS
 FORE STREET
 PORTLAND, MAINE

TITLE

LEGEND

SCALE: NONE
 DATE: 9-1-10

SHEET

E100