

Prepared For:
0 Hancock Street
LLC

Consulting Engineer:
VEITAS SVEITAS
engineers


Architect:
ARCHETYPE
architects

Project:
0 HANCOCK STREET
PORTLAND, MAINE

Revisions:	08-11-17	Issued for Foundation Permit
	08-31-17	Permit Set
	09-15-17	Steel Bid Set
	09-29-17	Pile Bid Set
	10-06-17	Concrete Bid Set
	10-06-17	Issued for Permit

Date: 08/11/17
Scale:
Third Floor Framing Plan

S103

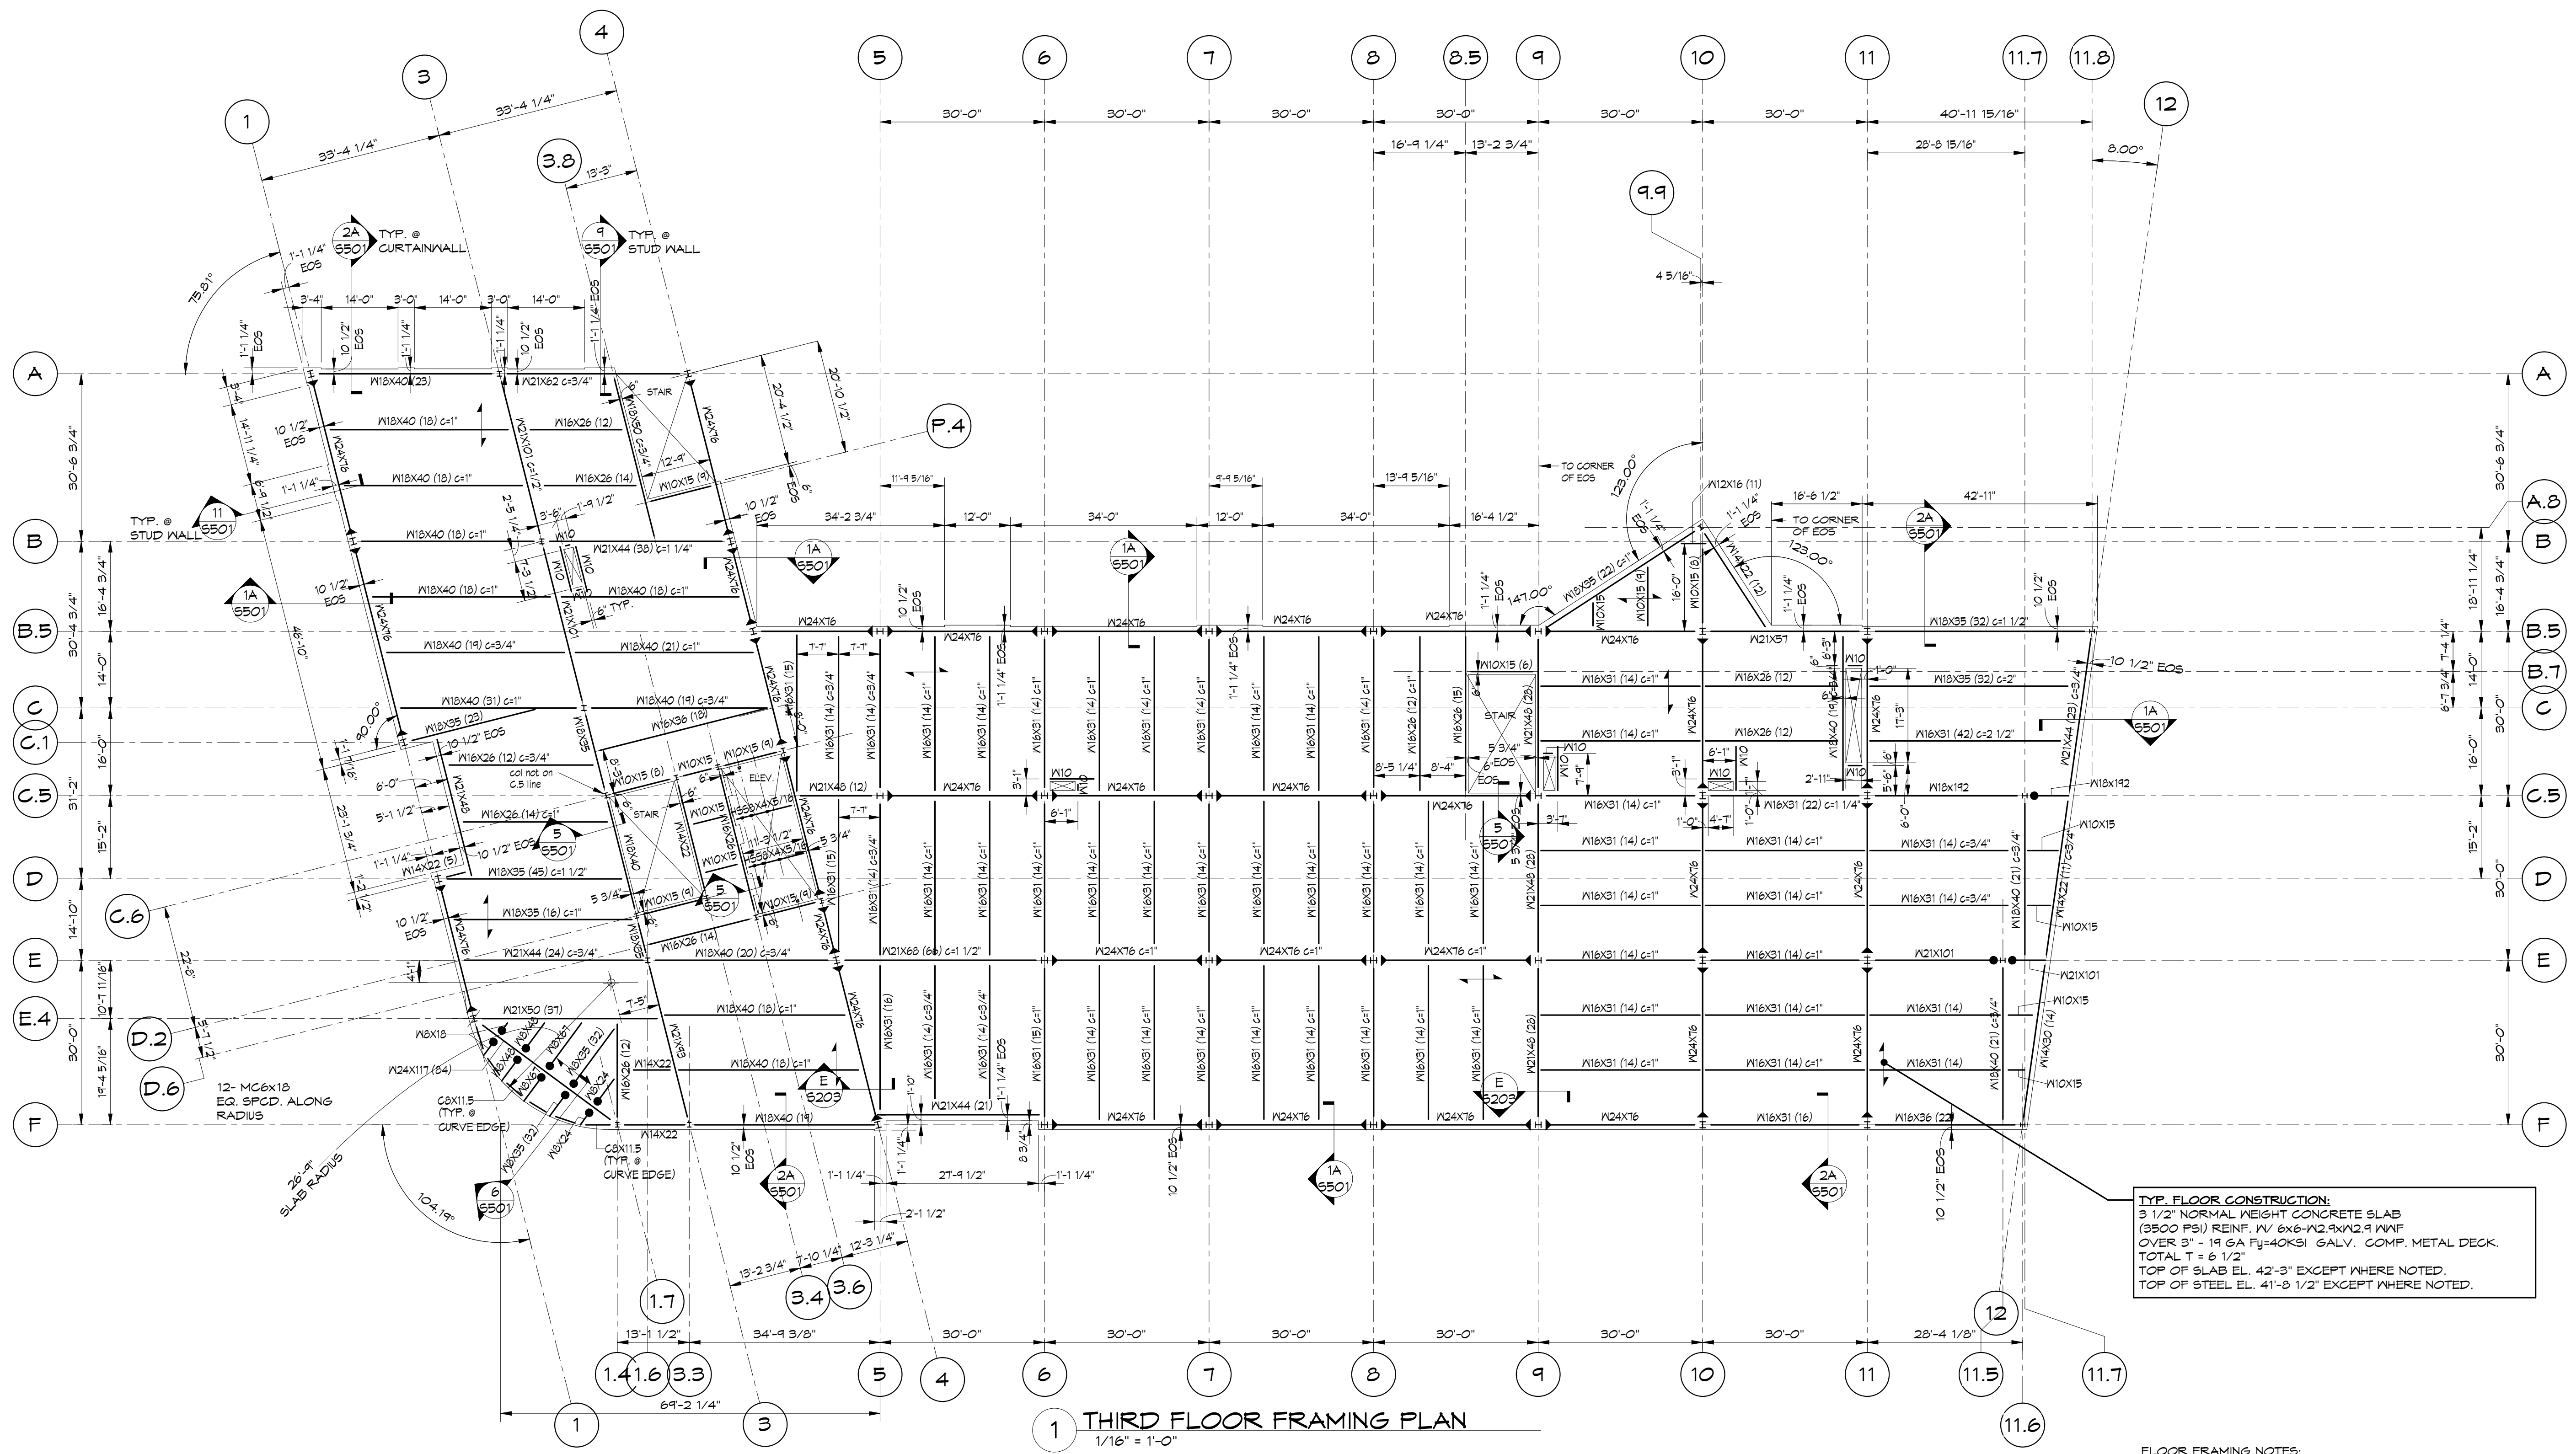

TYP. FLOOR CONSTRUCTION:
3 1/2" NORMAL WEIGHT CONCRETE SLAB
(3500 PSI) REINF. W/ 6x6-W2.9xW2.9 W/WF
OVER 3" - 19 GA Fy=40KSI GALV. COMP. METAL DECK.
TOTAL T = 6 1/2"
TOP OF SLAB EL. 42'-3" EXCEPT WHERE NOTED.
TOP OF STEEL EL. 41'-8 1/2" EXCEPT WHERE NOTED.

1 THIRD FLOOR FRAMING PLAN
1/16" = 1'-0"

- FLOOR FRAMING NOTES:**
- FOR TYPICAL DETAILS AND GENERAL NOTES SEE DRAWINGS S201 THRU 206.
 - TOP OF SLAB SHALL BE EL. 42'-3" UNLESS NOTED OTHERWISE.
TOP OF STEEL SHALL BE AT EL. 41'-8 1/2" UNLESS NOTED OTHERWISE.
 - (± 0") INDICATES DEVIATION FROM TOP OF STEEL ELEVATION.
 - "C..." INDICATES COLUMN MARK. FOR COLUMN AND BASE PLATE SIZES SEE COLUMN SCHEDULE DRAWING S301.
 - "(X)" INDICATES THE NUMBER OF EQUALLY SPACED 3/4" DIA. x 4 1/2" LONG HEADED SHEAR STUDS.
 - "EOS" INDICATES EDGE OF FOUR STOP AND / OR EDGE OF DECK DIMENSION FROM COLUMN GRIDLINE OR CL. OF BEAM IF NO COLUMN GRIDLINE. COORDINATE ALL EOS DIMENSIONS WITH ARCH. DIMS.
 - USE CHAIRS SPACED AT 4'-0" O.C. TO SUPPORT #4 BARS TO PROVIDE 1" CLEAR COVER.
 - "4R" INDICATES CONNECTION DESIGN SHEAR (ASD). IF REACTION IS NOT SHOWN, REFER TO SPECIFICATIONS & GENERAL NOTES.
 - "G..." INDICATES AMOUNT OF GAMBER.
 - INDICATES GRAVITY MOMENT CONNECTION. FOR DETAILS SEE DRAWING S205.
 - "BRACE X" INDICATES A BRACED FRAME. SEE DRAWING S302, FOR BRACE ELEVATIONS AND DETAILS.
 - "TOC EL." INDICATES TOP OF CONCRETE SLAB ELEVATION.
 - "TOS EL." INDICATES TOP OF STEEL ELEVATION.
 - "BOS EL." INDICATES BOTTOM OF STEEL ELEVATION.
 - INDICATES SPAN OF METAL DECK.
 - INDICATES SEISMIC MOMENT CONNECTION. FOR DETAILS SEE DRAWING S205.
 - "W10" INDICATES W10x12 STEEL BEAM.
 - PROVIDE 5/8" DIA. PUDDLE WELD @ 36/1 PATTERN AT ROOF DECK. PROVIDE 5/8" DIA. PUDDLE WELDS @ 36/4 PATTERN AT FLOOR DECK. PROVIDE #10 SCREWS @ 18" O.C. AT SIDELAPS (ALL LEVELS).