


# HORIZONTAL ASSEMBLY SCHEDULE

<p><b>20</b></p> <p>STC 60 IBC 721.2.2.1.3 1 HR.</p>	<p><b>24</b></p> <p>STC 55 IBC 721.2.2.1.3 3 HR.</p>	<p><b>28</b></p> <p>STC 60 IBC 721.2.2.1.3 3 HR.</p>	<p><b>32</b></p> <p>STC 60 IBC 721.2.2.1.3 3 HR.</p>
<p><b>21</b></p> <p>STC 55 IBC 721.2.2.1.3 1 HR.</p>	<p><b>25</b></p> <p>STC 65 IBC 721.2.2.1.3 3 HR.</p>	<p><b>29</b></p> <p>UL # Q201 1 HR. STC 60 IBC 721.2.2.1.3 3 HR.</p>	<p><b>32</b></p> <p>STC 60 IBC 721.2.2.1.3 3 HR.</p>
<p><b>22</b></p> <p>STC 60 IBC 721.2.2.1.3 3 HR.</p>	<p><b>26</b></p> <p>IBC 721.2.2.1.3 3 HR.</p>	<p><b>30</b></p> <p>NER-258 SYSTEM G 1 HR.</p>	<p><b>B-1</b></p> <p>UL DESIGN N505 3 HR BEAM ONLY</p>
<p><b>23</b></p> <p>STC 60+ IBC 721.2.2.1.3 3 HR.</p>	<p><b>27</b></p> <p>UL # Q501 1 HR.</p>	<p><b>31</b></p> <p>NER-258 SYSTEM G 2 HR.</p>	<p><b>B-1</b></p> <p>UL DESIGN N505 3 HR BEAM ONLY</p>

**HORIZONTAL ASSEMBLY NOTES:**

- THICKNESS OF MATERIALS, GAUGE OR SPACING SHOWN ARE MINIMUM OR MAXIMUM AS INDICATED TO COMPLY WITH FIRE RATED ASSEMBLY REQUIREMENTS. REFER TO ARCHITECTURAL DETAIL DRAWINGS, STRUCTURAL DRAWINGS ETC. FOR SPECIFIC MATERIAL REQUIREMENTS.
- REFER TO SPECIFIC U.L. ASSEMBLY FOR APPROVED PRODUCTS AND SPECIFIC INSTALLATION REQUIREMENTS.
- REFER TO U.L. GUIDE INFORMATION FOR FIRE-RESISTANCE RATINGS FOR GENERAL REQUIREMENTS.
- ENCLOSURES SHALL BE PROVIDED FOR RECESSED LUMINAIRES IN ACCORDANCE WITH THE SPECIFIC DESIGN OR LUMINAIRES SHALL BE SPECIFICALLY INVESTIGATED AND LABELED FOR INSTALLATION IN FIRE RATED FLOOR-CEILING DESIGNS.
- WHERE CEILING IS SUPPORTED DIRECTLY FROM STRUCTURAL MEMBERS, IT MAY BE LOWERED AS FOLLOWS: AS AN ALTERNATE, FURRING CHANNELS MAY BE SECURED TO 1-1/2\"/>

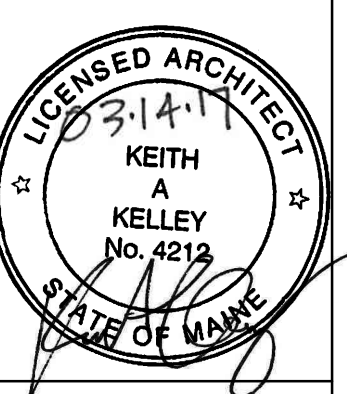

**AC HOTELS by MARRIOTT**  
Fore Street / Hancock Street / Thames Street  
Portland, Maine

REVISION:  
12-30-16 ASSEMBLY TYPE 26 ADDED

ISSUED:  
11-23-16 FOR PRICING  
03-14-17 BUILDING PERMIT

project architect: KAK  
drawn by: DLS

**HORIZONTAL ASSEMBLY SCHEDULE**

sheet number:  
**LS2.03**