


Copyright 2015, Opechee Construction Corporation
Tuesday, December 13, 2016 3:04:37 PM

FIRE ALARM NOTES		FIRE ALARM LEGEND		FIRE ALARM LEGEND	
1. THESE PLANS ARE PROVIDED AS A MEANS OF ESTABLISHING THE MINIMUM DESIGN CRITERIA FOR THE ELECTRICAL WORK. THE REFERENCED PLANS ARE SCHEMATIC IN NATURE AND ARE NOT TO BE RELIED UPON FOR CODE COMPLIANCE OR SUITABILITY OF PURPOSE. IT IS THE RESPONSIBILITY OF THE DESIGN-BUILD SUBCONTRACTOR, IN CONJUNCTION WITH THE DESIGN ENGINEER, TO ASSURE ALL WORK IS IN ACCORDANCE WITH APPLICABLE CODES, RULES, STATUTES, ORDINANCES AND GOOD ENGINEERING PRACTICES.	8. ALL EXPOSED WIRING SYSTEMS TO BE RUN IN E.M.T. OR RIGID CONDUITS AND RUN TIGHT TO ROOF OR FLOOR DECK OR CONTINUOUSLY ALONG STRUCTURAL COMPONENTS.	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
2. SIGNIFICANT DESIGN ALTERATIONS, ADDITIONS, OR DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL BEFORE PROCEEDING.	10. ADDRESSABLE SMOKE DETECTORS MUST BE PROVIDED IN INTERIOR GUEST SUITE CORRIDORS, ELEVATOR LOBBIES, MECHANICAL AND ELECTRICAL ROOMS, COMPUTER/TELEPHONE/PBX ROOMS, AND STORAGE ROOMS.	AP	ANNUNCIATION PANEL	F	PULL STATION
3. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE ELECTRICAL SYSTEM INSTALLATION WITH ALL TRADES INCLUDING MECHANICAL, ARCHITECTURAL, STRUCTURAL, AND PLUMBING.	11. A SPEAKER/HORN MUST BE PROVIDED IN EACH GUESTROOM AND AREA USED FOR SLEEPING PURPOSE OR NOTIFICATION MAY BE VIA A INTERCONNECTED SYSTEM USING A SOUNDER BASE AS SHOWN.	FACP	FIRE ALARM CONTROL PANEL	CO	CARBON MONOXIDE DETECTOR
4. ELECTRICAL WORK SHALL CONFORM TO ALL LOCAL, STATE, AND FEDERAL STANDARDS, CODES, AND GUIDELINES.	12. WHERE SMOKE DETECTOR AND CARBON MONOXIDE DETECTORS ARE SHOWN TOGETHER A COMBINATION SMOKE/CARBON MONOXIDE DETECTOR IS ALLOWED.	KB	KNOX BOX	CO _B	CARBON MONOXIDE DETECTOR WITH SOUNDER BASE
5. ALL FIRE ALARM DEVICES TO BE CAT. 30 KEYED.	13. FIRE ALARM SYSTEM TO BE INSTALLED AS REQUIRED MARRIOTT MODULE 14 AND BY CODE. IF ELEMENTS OF TRANSMITTING EQUIPMENT, INCLUDING ANTENNAS ARE PHYSICALLY SEPARATED, THE WIRING OR CABLING BETWEEN THEM SHALL BE PROTECTED BY CONDUIT.	FS	FLOW SWITCH	S	SMOKE DETECTOR
6. FIRE ALARM CONTRACTOR IS TO PROVIDE FIXTURE SUBMITTALS AND CIRCUITED DRAWINGS, INCLUDING PANEL DIAGRAMS FOR APPROVAL PRIOR TO INSTALLATION.		PS	PRESSURE SWITCH	S _B	SMOKE DETECTOR WITH SOUNDER BASE
7. FIRE ALARM SYSTEM TO BE INSTALLED AS REQUIRED BY CODE. IF ELEMENTS OF TRANSMITTING EQUIPMENT, INCLUDING ANTENNAS ARE PHYSICALLY SEPARATED, THE WIRING OR CABLING BETWEEN THEM SHALL BE PROTECTED BY CONDUIT.		TS	TAMPER SWITCH	S _D	DUCT SMOKE DETECTOR
		HS	HORN AND STROBE LIGHT	H	HEAT DETECTOR
		H	HORN UNIT	H _D	DUCT HEAT DETECTOR
		S	STROBE LIGHT	I _B	FIRE ALARM BELL
				MHO	MAGNETIC HOLD OPEN

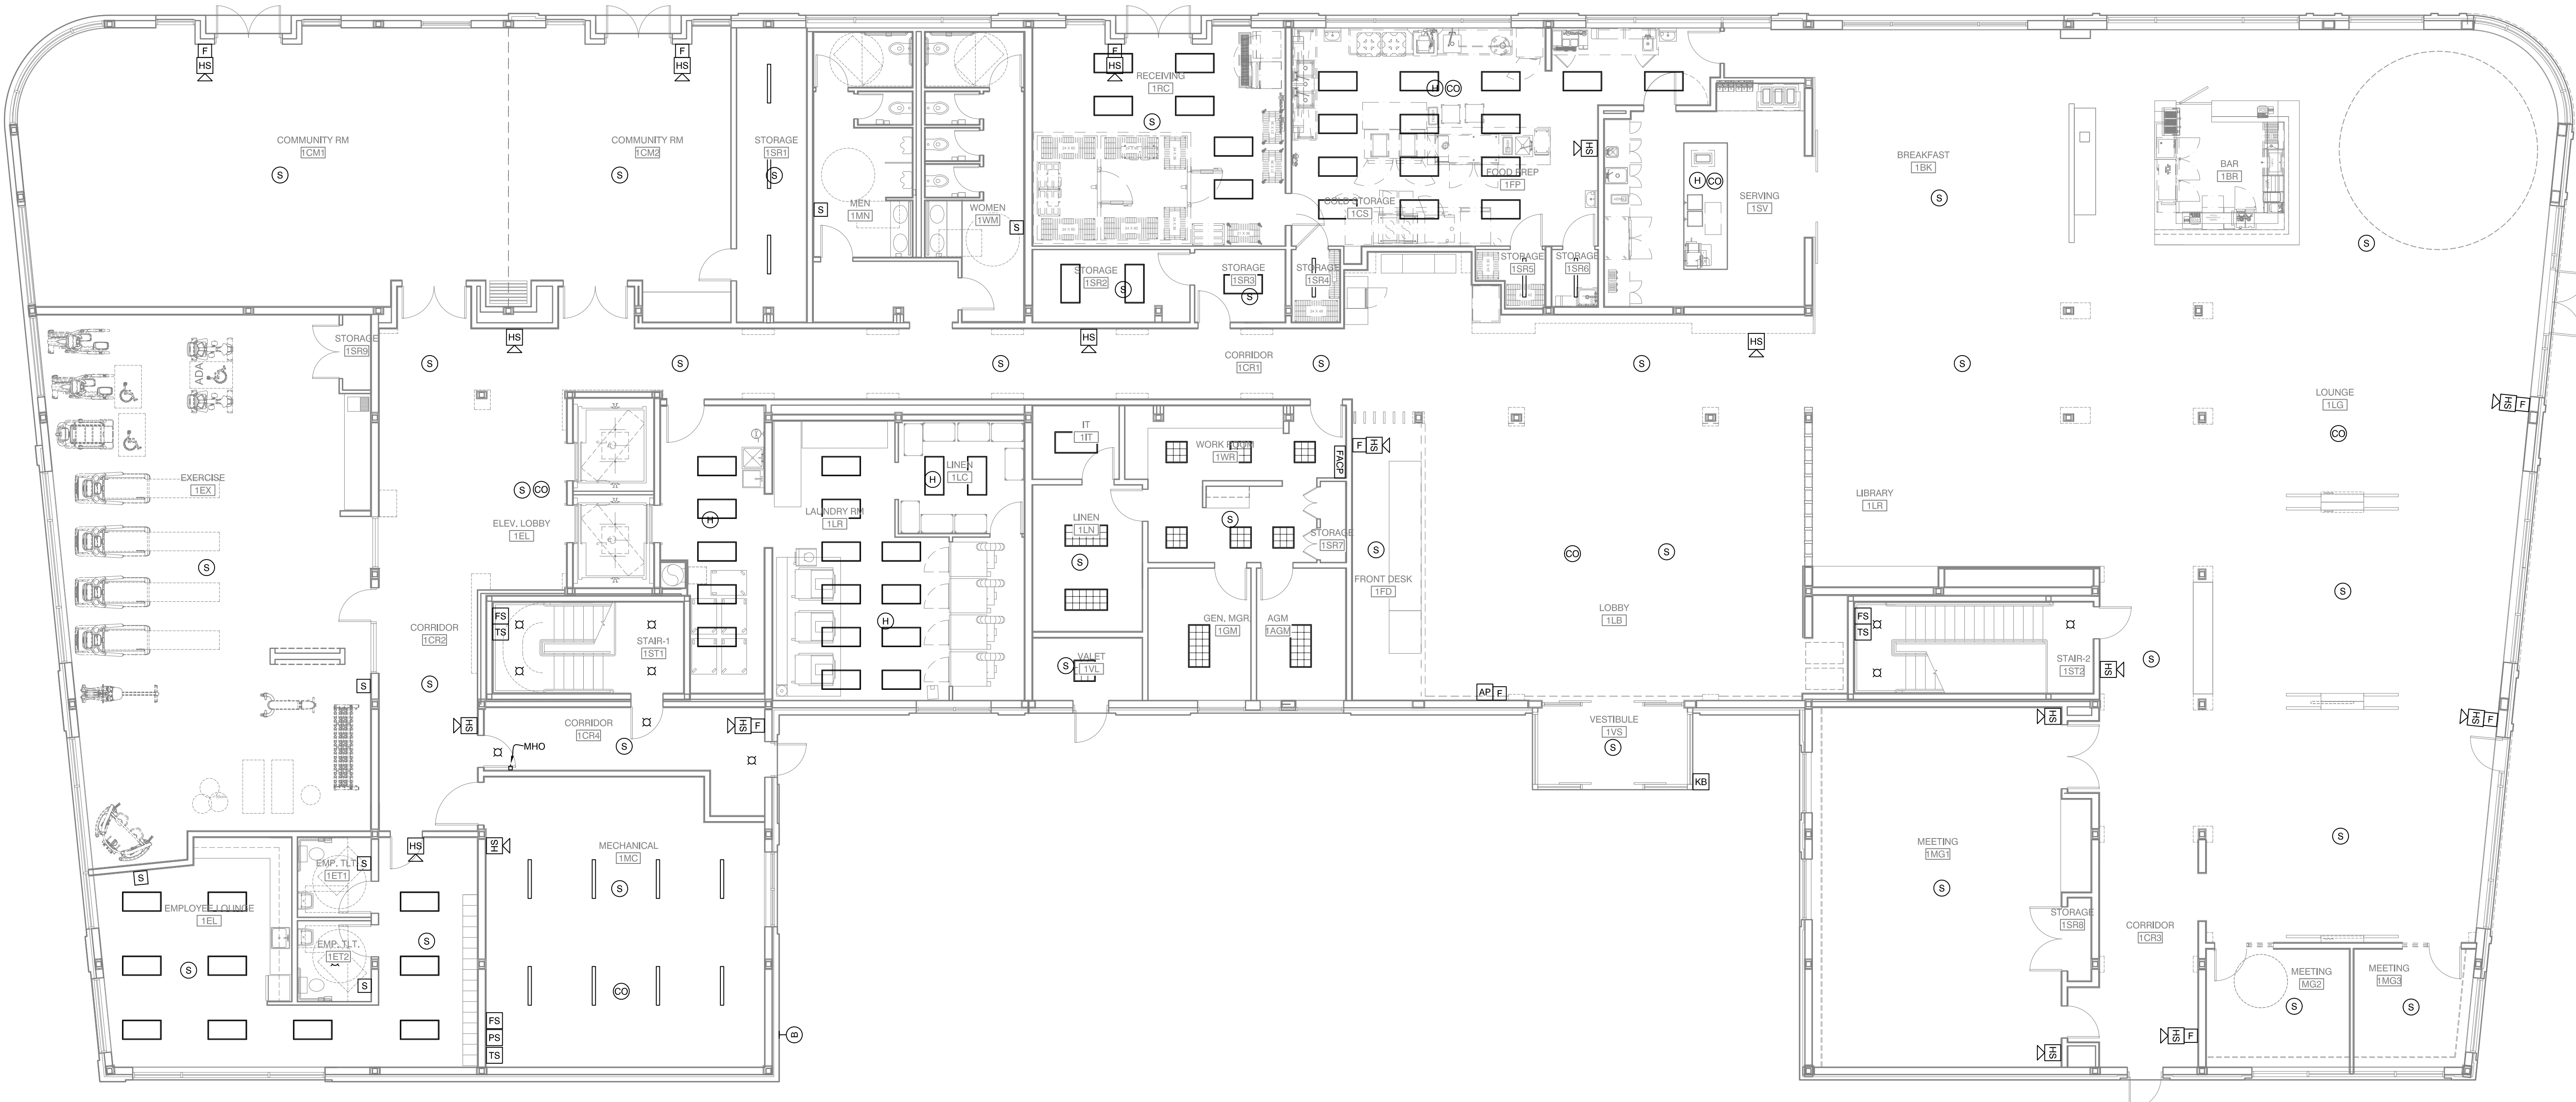

PLAN NORTH 1 FIRST FLOOR FIRE ALARM PLAN 1/8" = 1'-0"

REVISION:

ISSUED: 12-13-16

project architect: KAK
drawn by: DLS

**FIRST LEVEL
FIRE ALARM
PLAN**

sheet number:
FA1.01