


NOTE - UNIT SUPPLY AND EXHAUST DUCTS CONNECTED TO THE ERV SHALL BE RUN IN THE TRUSS SPACE WHERE THEY MUST CROSS SAC UNIT DUCTWORK. CEILING RADIATION DAMPERS SHALL BE INSTALLED AT ALL ERV SUPPLY AND EXHAUST GRILLES AND AT THE MEMBRANE PENETRATION BY ANY DUCT LARGER THAN 4\".


NOTE - FIELD ROUTE REFRIGERANT PIPING FROM ROOF SCU UNITS TO INDOOR SAC UNITS.

NOTES -
 1. MAXIMUM FLEX DUCT LENGTH SHALL BE 4'-0"
 2. DUCT SHALL BE LINED FOR 10'-0" ON BOTH SUPPLY AND RETURN TO SAC UNITS. FOR LINED DUCTS, DIMENSIONS NOTED ARE CLEAR DIMENSION, INSIDE LINER. ALL SUPPLY DUCT THAT IS NOT LINED SHALL BE INSULATED WITH 1-1/2" DUCTWRAP, FSK.


SIXTH FLOOR MECHANICAL PLAN
 SCALE - 1/8" = 1'-0"

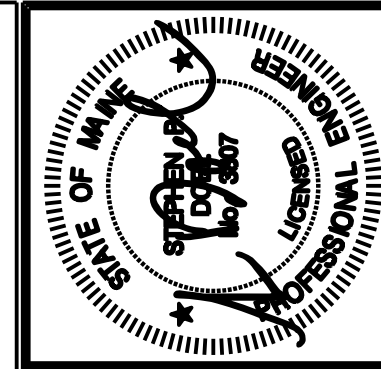

Prepared For:
**EssexNorth
 Portland LLC**
 P.O. Box 394
 Topsfield, MA 01983

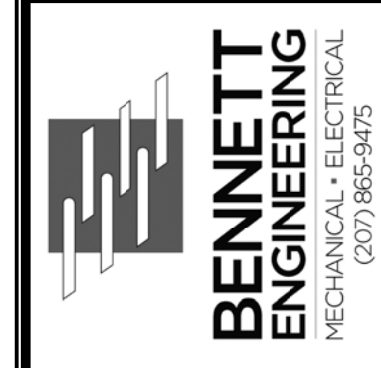

Consultant:

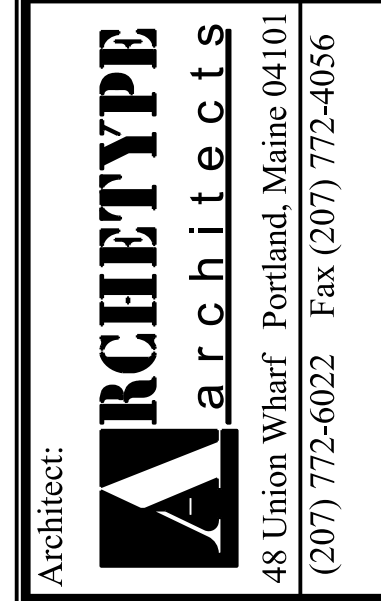

Architect:
**ARCHETYPE
 architects**
 48 Union Wharf Portland, Maine 04101
 (207) 772-6022 Fax (207) 772-4056

Project:
**THAMES STREET
 BUILDING**
 20 Thames Street, Portland Maine

Revisions:
 3 AUG 2017 - ADDENDUM 1
 15 AUG 2017 - ADDENDUM 2
 11 OCT 2017 - ADDENDUM 3

Date:
 3 AUG 2017

Scale:
 SIXTH FLOOR
 MECHANICAL PLANS

M1.06